

2023

# WATER SYSTEM ANNUAL REPORT



# TABLE OF CONTENTS

A.	System Makeup.....	1
B.	System Maintenance.....	4
C.	Flushing Maintenance.....	6
D.	System Budget .....	8
E.	Water Sampling & Testing Program.....	9
F.	Water Quality Inquiries.....	12
G.	Water Quality Response Notification.....	14
H.	Water Quality Test Results.....	15
I.	Water System Security .....	20
J.	Backflow Prevention and Cross Connection Control .....	20
K.	Water Emergency Response Plan .....	20
L.	Fraser Health Authority Flush Message.....	21

APPENDIX A: 2023 Water Quality Laboratory Test Results

APPENDIX B: Metro Vancouver Drinking Water Management Plan

APPENDIX C: BC Drinking Water Protection Regulation

APPENDIX D: Guidelines for Canadian Drinking Water Quality

## **TABLES & GRAPHS**

Table 1: City of Surrey 2023 Water Main Inventory.....	3
Table 2: City of Surrey Water Quality Maintenance Budgets 2023 and 2024 .....	8
Table 3: Comparison of Chlorine Residuals Above & Below 0.2 ppm (2021-23).....	17
Table 4: 2013 to 2023 HPC Positive Samples Summary >500 .....	18
Graph 1: Comparison of Annual HPC Results >500 CFU/ml (2000-2023) .....	19

## **FIGURES**

Figure 1: Supply Feeds, Reservoirs, Mains and Pump Stations.....	2
Figure 2: City of Surrey Water Operations Organization Chart.....	4
Figure 3: Unidirectional Flushing Program - 2023 .....	7
Figure 4: Water Sampling Sites Legend.....	10
Figure 5: 2023 Water Sampling Sites .....	11
Figure 6: 2023 Chlorine Residuals.....	16

## **CHARTS**

Chart 1: Water Inquiries (2015-2023).....	12
---	----

# REPORT SUMMARY

The drinking water for the City of Surrey is provided by the Greater Vancouver Water District, which falls under the jurisdiction of Metro Vancouver. The urban water distribution system spans approximately 1876 kilometers, marking it as British Columbia's most extensive network. The system includes 30 distinct pressure zones and is supported by nine pumping stations.

In order to preserve the quality of water in the distribution network, the City employs a unidirectional flushing strategy to clean all water mains. The goal of this program is to systematically flush the entire municipal water distribution system every five years. Water quality assessments are performed at 51 different sampling sites. Every week, samples are gathered and examined by Metro Vancouver. The evaluations cover bacterial content, chlorine residue levels, pH value, water temperature, and clarity measurements.

In the analysis of 3,135 water samples conducted in 2023, E-coli bacteria were not found. While ten samples initially showed the presence of total coliform bacteria, further testing after flushing the system confirmed negative results.

In cases of water quality concerns or infrastructure malfunctions like water main breaks, the City adheres to established response protocols. These include specific measures for repairs and ensure coordination among the City, Metro Vancouver, and the Fraser Health Authority.

Monitoring of chlorine levels is consistently performed across the water distribution network. In 2023, a total of 3135 samples were collected, with 84% registering chlorine concentrations above 0.2 mg/L, marking a 7% decline from the previous year's figures. In instances where elevated heterotrophic plate counts (HPC) occur due to diminished chlorine residuals and circulation issues, operational staff conduct flushing operations in the affected zones to refresh mainline water and enhance chlorine residual levels. Efforts to ameliorate low flow regions are ongoing, including the integration of dead-end mains through looping, which helps boost water movement in these areas. Moreover, the city procures quarterly samples to test for disinfection by-products like Haloacetic Acids and Trihalomethanes and conducts biannual assessments for pH levels and metal content. Test outcomes align with the Guidelines for Canadian Drinking Water Quality established in 2022.

In 2023, there have been no instances of tampering or vandalism reported within the municipal water system. Security measures for the system include lighting, locking mechanisms, and alarm systems at pump locations, in addition to backflow preventers installed on service connectors. Additionally, the City has a program in place to prevent contamination from improper connections called the cross connection control program.

In the year 2023, there were 615 new backflow preventers that were registered for testing with the City. The cumulative total of registered assemblies reached 16,542, marking a 3.8% growth compared to the previous year. These devices have been fitted as part of new construction, renovation projects, or due to the requirements of cross-connection control surveys. It's mandatory for these assemblies to undergo testing annually. The City monitors and ensures that institutional, commercial, and industrial (ICI) operations comply with the Surrey Waterworks Cross Connection Control By-law, 2013, No. 17988.

Surrey continues to uphold rigorous standards in its water distribution maintenance, guaranteeing that residents and businesses receive superior quality water.

# 2023 WATER SYSTEM ANNUAL REPORT

## A. System Makeup

Surrey's water supply comes from the Greater Vancouver Water District (GVWD). The water is sourced from precipitation and snowmelt that is stored in three reservoirs located on the Capilano, Seymour, and Coquitlam rivers. Monitoring, treating, and distributing this water to its member municipalities is handled by Metro Vancouver. The treatment process eliminates all pathogens. To ensure no microbial regrowth, secondary chlorination is applied before the water enters Surrey's network. After this point, the water goes through no additional treatment within Surrey's distribution system. A visual representation of the distribution system can be seen in Figure 1 on page 2. For an in-depth look at the water main details, refer to Table 1 on page 3, titled "City of Surrey 2023 Water Main Inventory".

With roughly 1876 km of water distribution mains, the City boasts British Columbia's most expansive distribution network. The system consists of components such as pump stations, mains, pressure valves, sampling stations, service connections, and meters. In 2023, service connections grew by 0.3% (281), reaching a total of 95,919. Surrey's population estimate stood at 603,970 as of 2022.




To illustrate 1876 km of water main, this would be from Surrey to approximately 145 km east of Regina Saskatchewan

By employing pressure reducing valves, pumping stations, closed valves, check valves, the distribution system is divided into 30 distinct pressure zones. The pressure in each zone is adjusted according to the area's topography to ensure adequate water pressure for all residents.

The urban layout features numerous dead-ends due to the boundaries of pressure zones, cul-de-sacs, extended water mains in thinly populated country regions, and natural barriers like gullies, streams, coastlines, and flood areas. Whenever water quality concerns occur in these locales, municipal teams address them by flushing the mains.

The municipality provides eight water fill stations for construction firms to access water. These stations reduce reliance on fire hydrants to fill tankers and enable the City to track water usage. Where feasible, these stations are placed on dead end mains to enhance flow and better water quality in those zones.

<sup>1</sup> Surrey Population (2022) 603,970 Population Estimates and Projections, <https://www.surrey.ca/business-economic-development/business-data/population-estimates-projections>

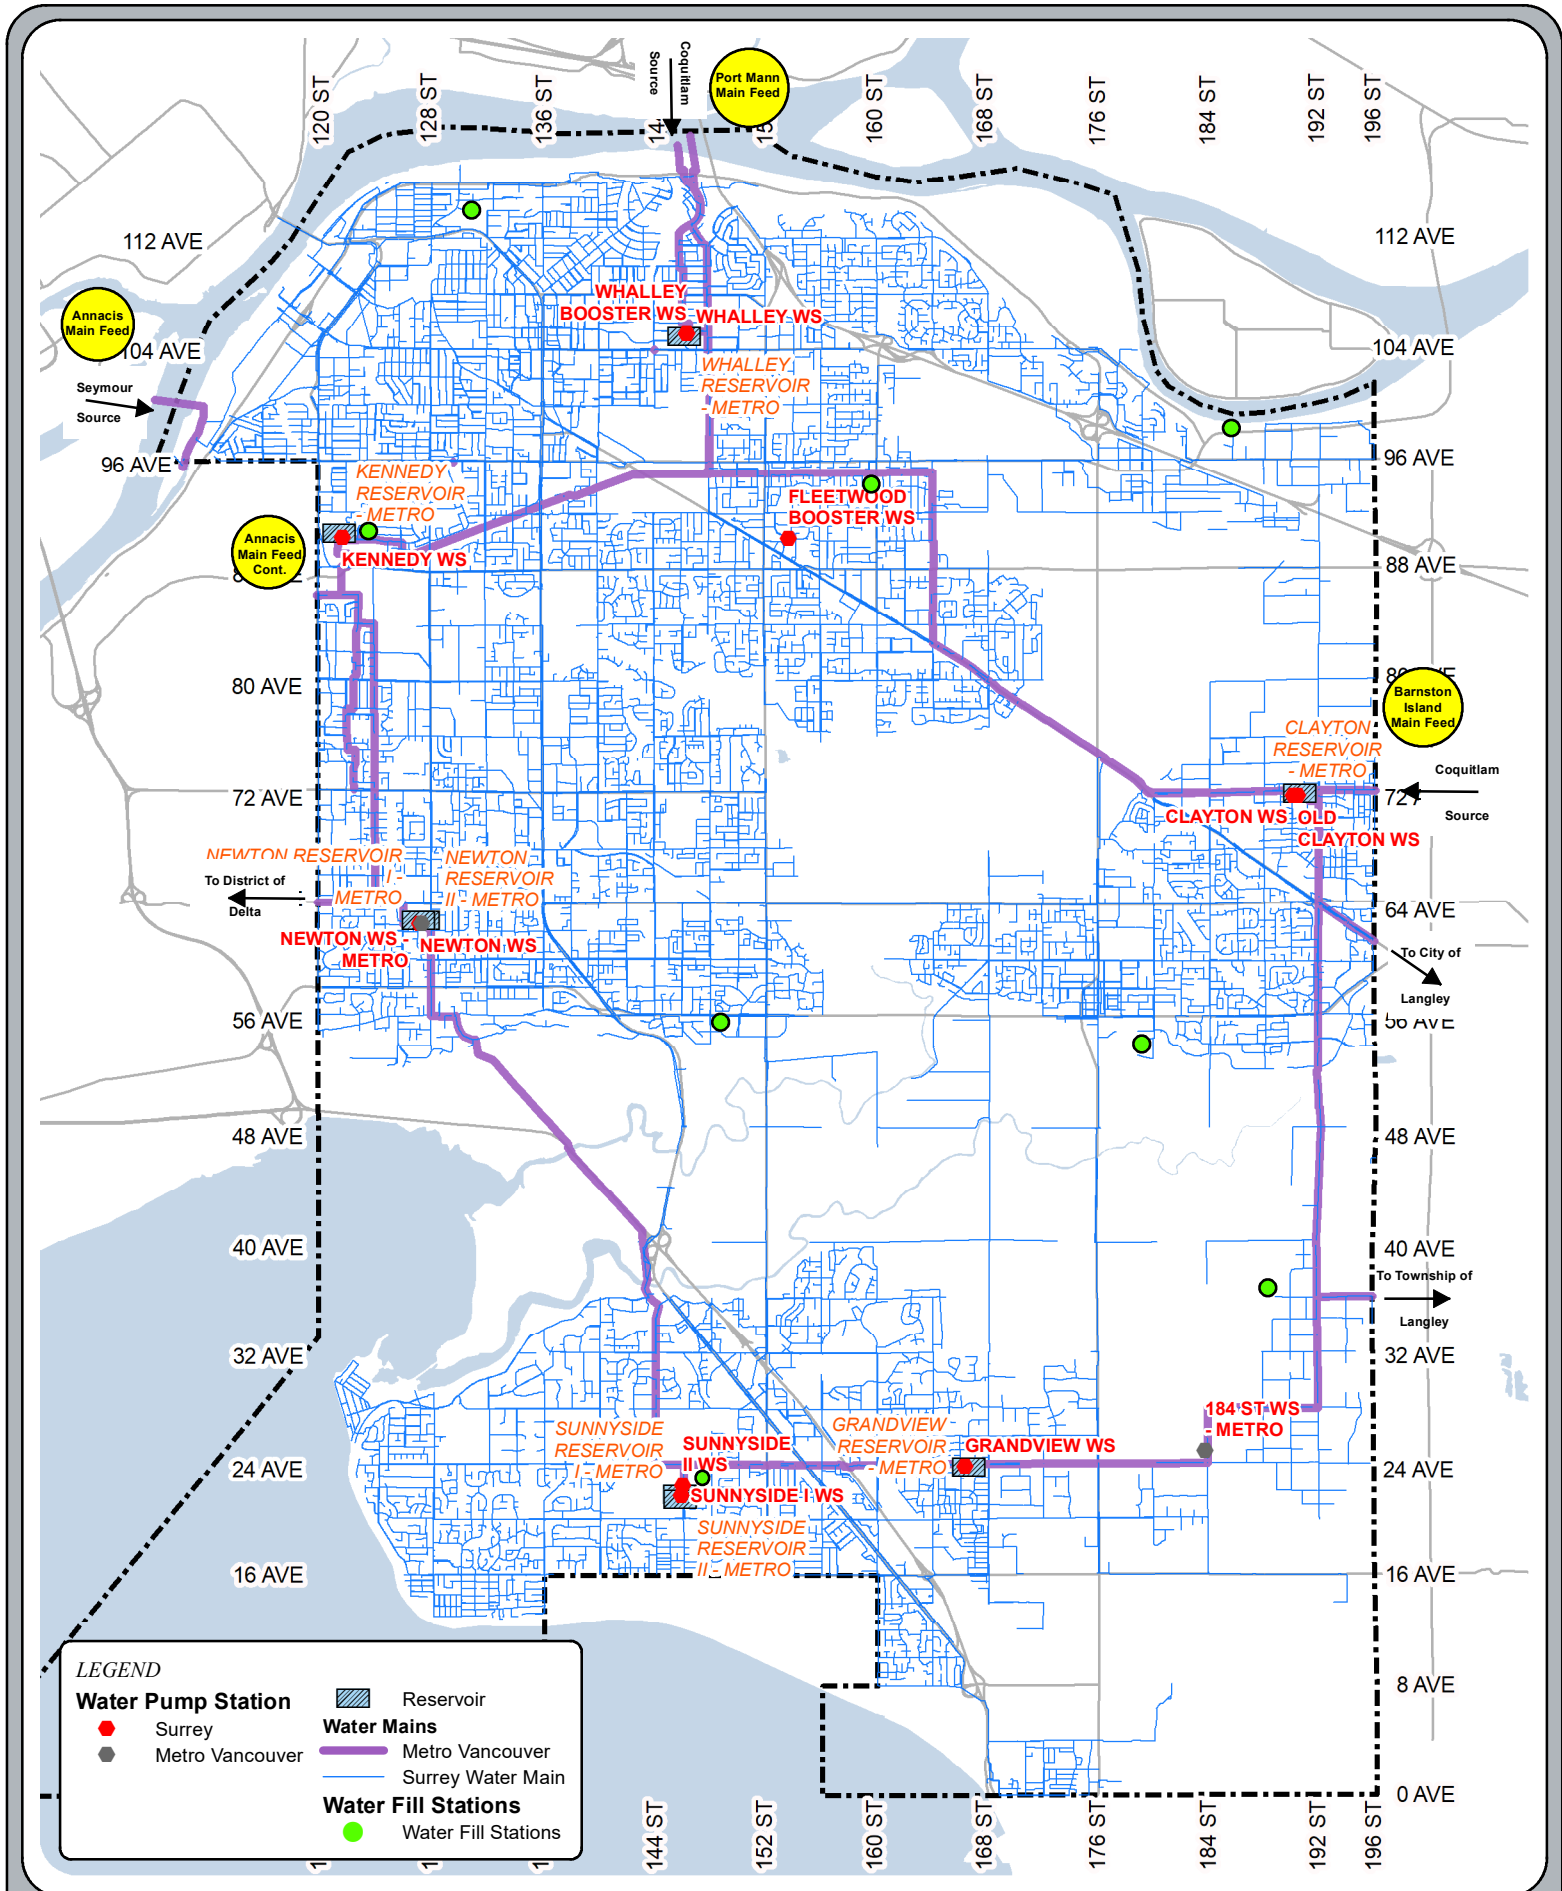

**Fig 1: WATER DISTRIBUTION SYSTEM**  
**(Supply Feeds, Reservoirs, Mains and Pump Stations)**

0 470 940 1,880 2,820 3,760  
 Meters  
 SCALE: 1:110,000




ENGINEERING OPERATIONS  
 CITY OF SURREY

**Table 1:**  
**2023 Water Main Inventory (City of Surrey)**

Main Size (mm)	AC	CC	CAS	CU	DI	DI-TR	GI	PE	PVC	PVCO	ST	Total by Size (m)
50				11	55		1,363	4,574	3,541			9,544
75					163			418	611			1,192
100	2,075		2,722		65,787			33,970	10,720		110	115,384
125								923				923
150	13,401		31,044		300,677	46	4	6,850	87,159		175	439,356
200	6,240		9,840		203,750	527		88	342,239	503	1,111	564,298
250	337		2,094		67,452				74,181		51	144,115
300	7,841	2	11,392		278,307	564		221	112,629		1,026	411,982
350					47,061				1,320		691	49,072
400					43,967				36		10	44,013
450	10	8,633			41,354				7		124	50,128
500					7,667						17	7,684
525											3,323	3,323
560											721	721
600	23	8,769			12,236				762		2,458	24,248
750		305			3,738			2			2,986	7,031
900		33			1,520						313	1,866
1050								855			62	917
1200											50	50
<b>Total by Material (m)</b>	<b>29,927</b>	<b>17,742</b>	<b>57,092</b>	<b>11</b>	<b>1,073,734</b>	<b>1,137</b>	<b>1,367</b>	<b>47,901</b>	<b>633,205</b>	<b>503</b>	<b>13,228</b>	<b>1,875,847</b>
<b>% change from 2021</b>	<b>-0.1%</b>	<b>-0.7%</b>	<b>-1.0%</b>	<b>0.0%</b>	<b>-0.1%</b>	<b>136.9%</b>	<b>0.0%</b>	<b>0.9%</b>	<b>0.4%</b>	<b>0.0%</b>	<b>-0.5%</b>	<b>0.1%</b>

**Total Main Length (2023): 1,875,847 m (0.1% increase from 2022)**

Pipe Material Legend	
AC	Asbestos-Cement
CC	Concrete Cylinder
CI	Cast Iron
CU	Copper
DI	Ductile Iron
DI-TR	Ductile Iron with TR Restrained Joint
GI	Galvanized Iron
PE	Polyethylene
PVC	Polyvinyl Chloride
PVCO	Biaxially Oriented Polyvinyl Chloride
ST	Steel

Colour Legend	Comparison to 2020 Inventory
	Increasing Main Inventory
	Decreasing Main Inventory
	No Change in Main Inventory


## B. System Maintenance

Surrey's water distribution system is managed and maintained by 55 employees. Of these, 38 hold EOCP certifications, with 17 at WD I level, 19 at WD II, and 2 at WD III.

The water operations organization structure is shown in Figure 2 (below).



**Figure 2:**  
**City of Surrey Water Operations Organizational Chart**

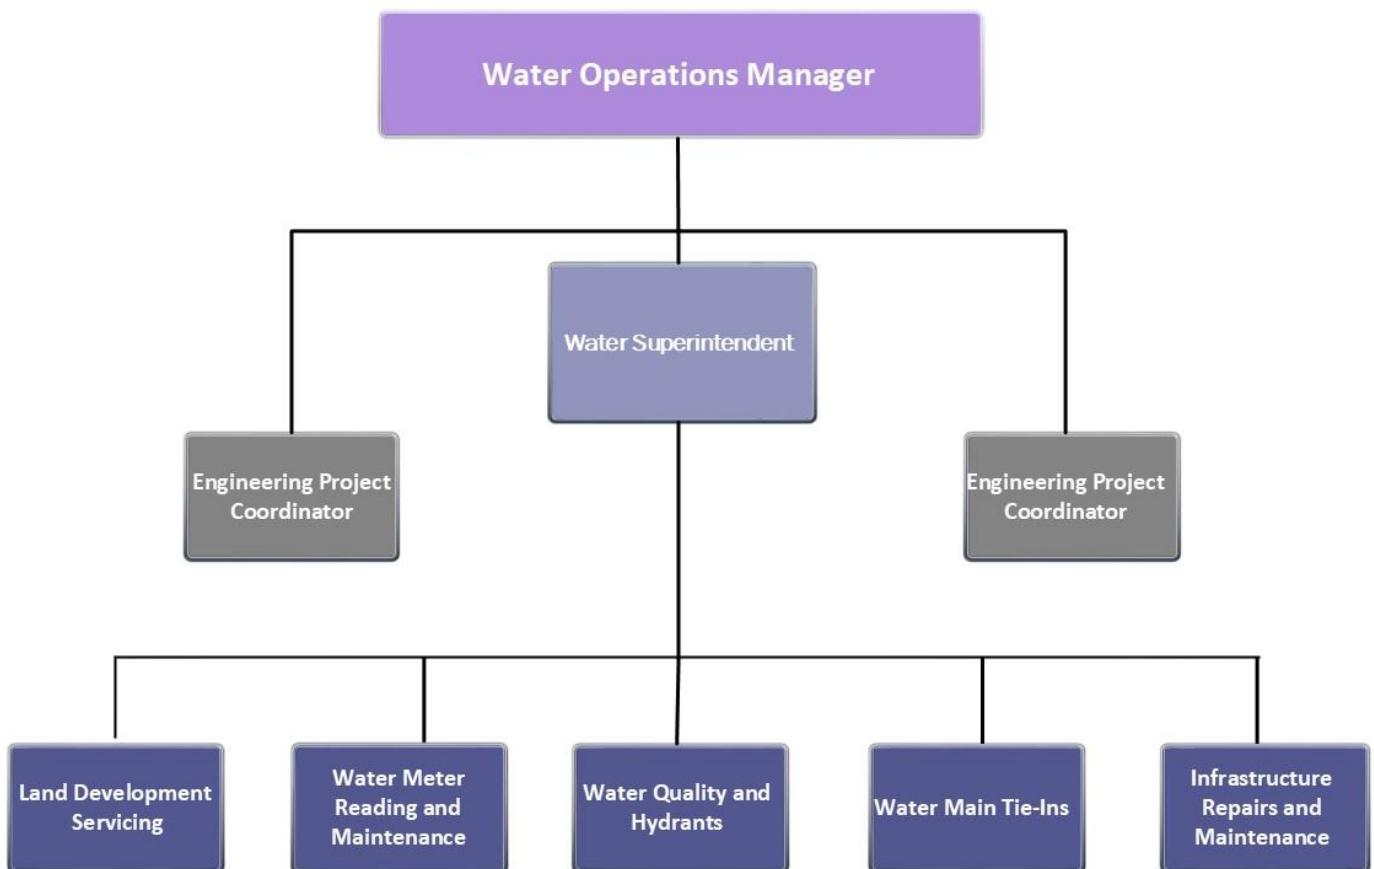



The duties and responsibilities of the various crews and staff members are as follows:

- a) **Water Operations Superintendent**  
Oversees the work of Operations Crews and offers technical support, as well as guidance on the maintenance and expansion of distribution systems.
- b) **Engineering Project Coordinators**  
Offer support in both technical and administrative capacities to the Operations Teams and their Supervisors. Aid in managing data, conducting research, and perform any tasks assigned by the Water Manager.
- c) **Land Development Servicing**  
Handles the installation and renewal of both domestic and fire line services across the city.
- d) **Infrastructure Repairs and Maintenance**  
Upholds water services, mains, and connected components. Delivers urgent repairs for the water system when necessary. Engages in proactive and responsive work to find and repair leaks. Aids in precisely pinpointing the location of identified leaks.

- e) **Water Main Tie-ins**  
Links new mains to established ones, oversees the tie-in work performed by private contractors, and documents the specifics of the construction process.



Water Main Tie in at 145 St & 109 Ave

- f) **Water Quality & Hydrants**  
Conducts regular and as-needed flushing of municipal water mains, performs chlorine residual tests and bacteriological assessments on active and new city mains when required, and carries out maintenance on fire hydrants.
- g) **Water Meter Reading and Maintenance**  
Manages the entire scope of water meter functions, catering to residential, business, institutional, and industrial establishments. The program encompasses inspections, maintenance, calibration, replacement, and recording of meter readings.

## C. Flushing Maintenance

The City upholds the quality of water within its distribution network by implementing a yearly unidirectional flushing schedule, ensuring that all mains are flushed at minimum once within a five-year cycle. The flushing process clears out any standing water and sediment build-up inside the pipes. Additionally, the City performs "on-demand" flushing when necessary, typically in response to line repairs or the outcomes of water quality assessments.

On page 7, Figure 3 titled "Unidirectional Flushing Program" illustrates the areas of water service that underwent flushing. In 2023, a total of 533 kilometers of mains were flushed, representing 28% of the entire length of mains.

Flush operations are often scheduled during the fall and spring to bypass the high water use periods of summer. Uni-directional flushing begins at the primary source within a service area and progresses through successive downstream hydrants, which prevents water from unflushed mains from mixing with that from flushed mains. The dechlorination of water expelled through fire hydrants is performed to adhere to the Ministry of Environment standards for discharge into water bodies.


As the City generally does not face limits on pipeline flow, abrasive cleaning techniques like pigging and swabbing are not employed. When water mains near the end of their viability, they're substituted in accordance with prevailing pipe material specifications and fire flow criteria.





Typical set-up for water main flushing

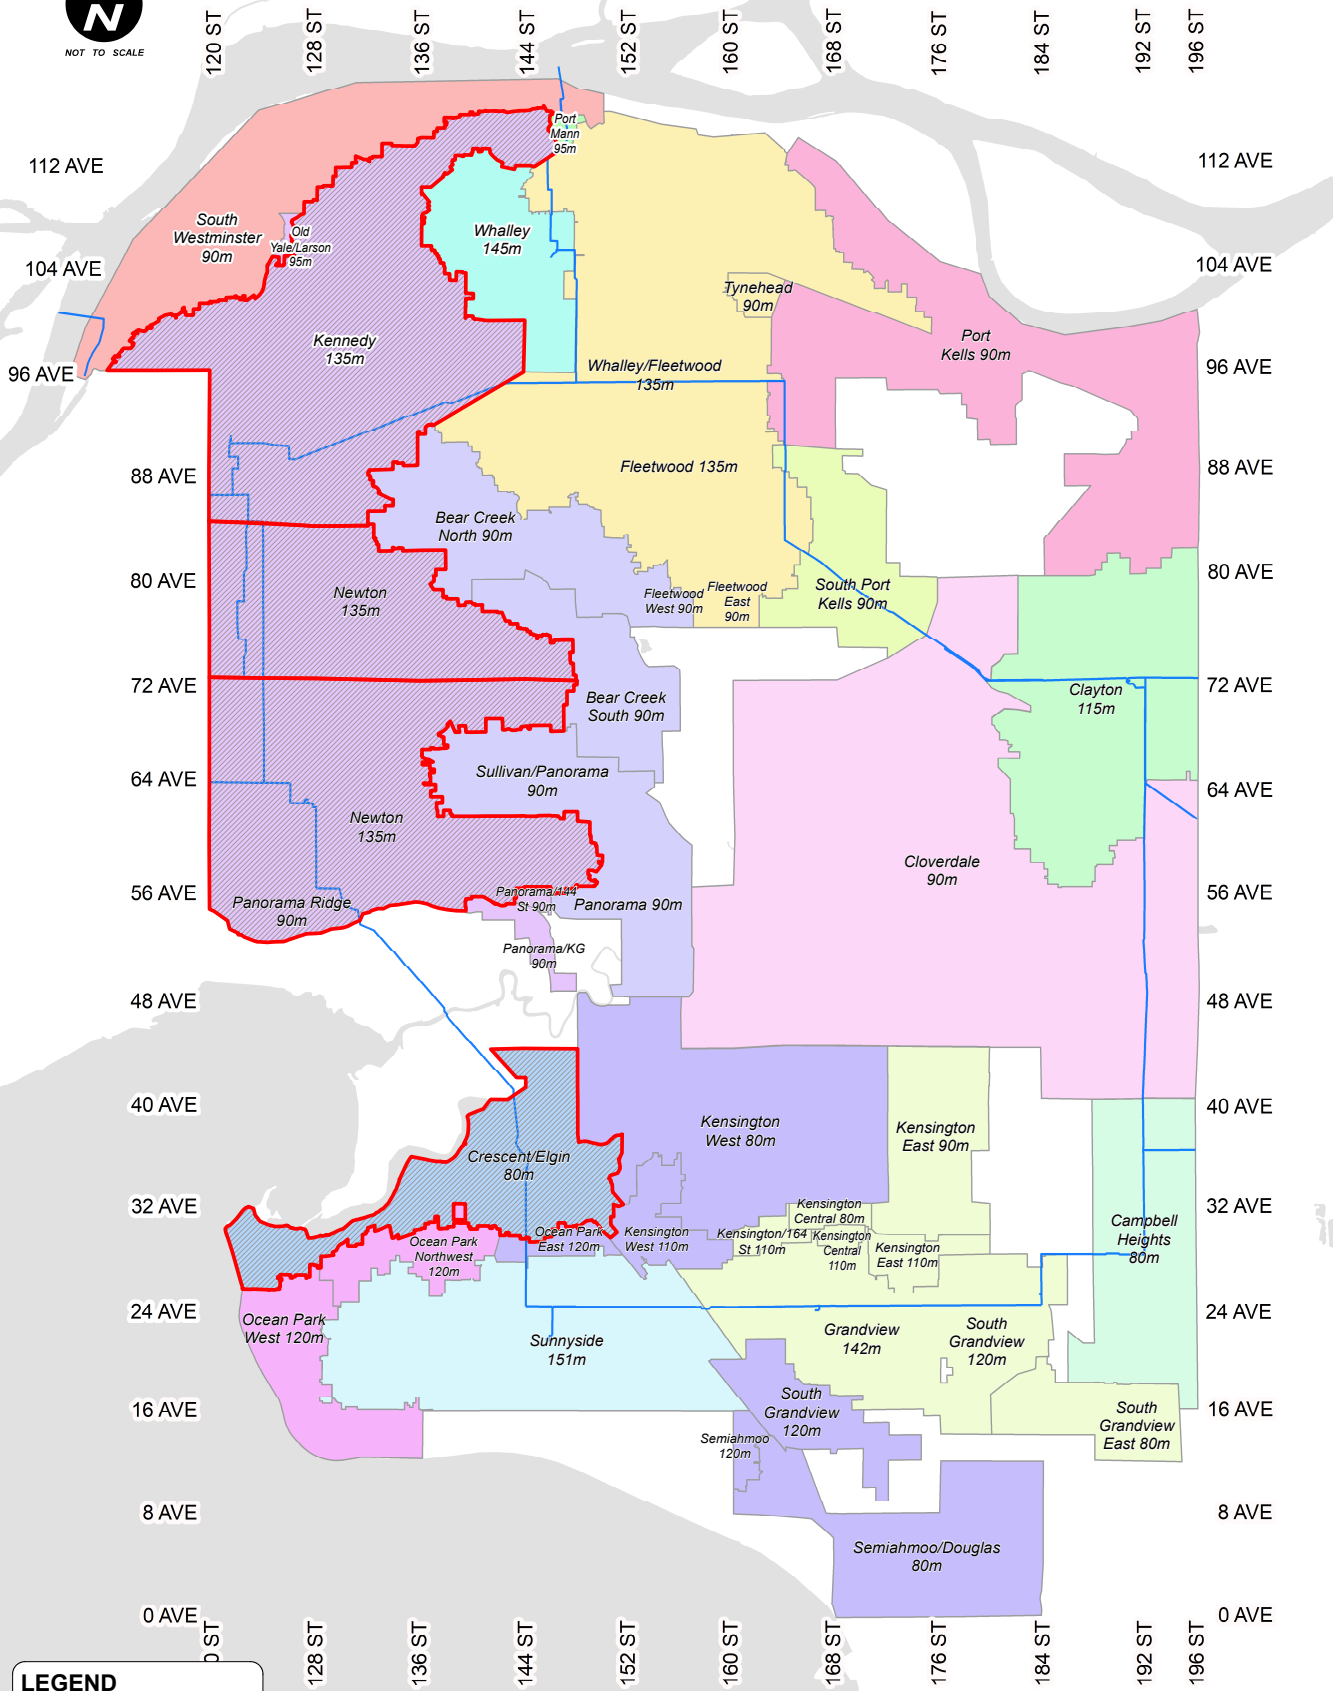


NOT TO SCALE



**LEGEND**

-  GVRD Water Mains
-  Areas Flushed in 2023

**FIG 3: UNIDIRECTIONAL FLUSHING PROGRAM - 2023**



## D. System Budget

Table 2 (below) outlines the summary of activities and yearly budgets dedicated to maintaining water quality. The 2024 budget accounts for 21% of the City's yearly Water Utility Operations & Maintenance budget, with the other 79% allocated for managing the City's water valves, meters, service connections, operational support services, and electricity for the water pump stations.

**Table 2: City of Surrey Water Quality Maintenance Budgets 2023 and 2024**

<b>Description</b>	<b>2023 Budget</b>	<b>2024 Budget</b>
Main Line Repairs	\$600,263	\$627,654
Line Flushing	\$422,380	\$440,794
Hydrant Repair/Maintenance	\$792,727	\$821,895
PRV Maintenance	\$254,854	\$254,976
Pump Stations Maintenance	\$580,806	\$562,869
Water Quality Monitoring	\$85,696	\$85,696
<b>TOTALS*</b>	<b>\$2,736,999</b>	<b>\$ 2,793,884</b>

\* Total Water Distribution System Operations & Maintenance Budget is: \$12,630,000 for 2023, and \$13,085,262 for 2024.

## **E. Water Sampling & Testing Program**

The City's water quality is checked at 51 sites where Metro Vancouver staff collect samples weekly. The laboratory, sanctioned by the Provincial Health Officer for bacteriological tests and accredited by CALA, assesses various components such as metals, THMs, coliforms, and E. coli. Details of these sites can be found in Figure 4 on page 10 and their locations in Figure 5 on page 11. Weekly testing data for 2023 is provided in Appendix A.

In accordance with the B.C. Drinking Water Protection Regulation, under Schedule B, the City's minimum requirement for monthly sampling is set at 137. The City of Surrey exceeds this requirement, averaging 252 samples each month. For a detailed breakdown of the sampling frequency at individual stations, please refer to Appendix A, titled "2023 Sampling Station Results."



Water Sampling Station at 148 Street

In 2023, E-coli bacteria were not found in any of the 3135 water samples examined. There were ten instances of total coliform bacteria found, all at separate sampling locations, but no further evidence of coliforms was found upon retesting. Along with tests for bacteria, pH levels, Haloacetic acids (HAA5), Trihalomethanes (THMs), and metals are also monitored. The water system's quality has met the standards established in the Guidelines for Canadian Drinking Water Quality found in Appendix A.

The pH levels were tested four times a year at three different monitoring points, yielding an average of 7.8. These findings can be found in Appendix A titled "2023 DBP Data". In June 2021, Metro Vancouver started a corrosion control strategy by raising the pH and alkalinity of drinking water with natural mineral additives. This initiative aims to minimize pipe leaks due to copper erosion and extend the durability of plumbing systems and water heaters. Additional details are available through Metro Vancouver's online resource:

<http://www.metrovancouver.org/services/water/engagement/projects-and-initiatives/corrosion-control-program/Pages/default.aspx>

The average THM disinfection by-product levels were 47 parts per billion (ppb) across seven sampling locations. The complete test outcomes can be found in Appendix A, titled "2023 DBP Data."

The average level of HAA5 disinfection by-products was measured at 28 parts per billion across seven sampling sites. Detailed test outcomes can be found in Appendix A, entitled "2023 DBP Data."


Analysis of metals such as copper, iron, lead, zinc, chromium, and manganese was conducted in March and October at three different locations. The findings are presented in Appendix A, titled "2023 Semi-Annual Metal Analysis."

No traces of vinyl chloride were found at the four testing locations during the June and November samplings. The findings can be reviewed in Appendix A, titled "2023 Vinyl Chloride Results."

Since the source water comes from a protected watershed that is free from pesticides and herbicides, and is transported to the City through a sealed pipe system from Metro Vancouver, there is no testing for these substances.

SITE NUMBER	LOCATION	SAMPLED BY
901	17988 93A ST	Metro Vancouver
902	18995 87A AVE	Metro Vancouver
903	19287 98A AVE	Metro Vancouver
904	17815 TRIGGS RD	Metro Vancouver
905	17052 102 AVE	Metro Vancouver
906	10184 161 ST	Metro Vancouver
907	10796 155A ST	Metro Vancouver
908	15985 112 AVE	Metro Vancouver
909	14617 Wellington Dr	Metro Vancouver
910	14396 115 AVE	Metro Vancouver
911	12893 114A AVE	Metro Vancouver
912	10619 TIMBERLAND RD	Metro Vancouver
913	11878 98A AVE	Metro Vancouver
914	10478 132 ST	Metro Vancouver
915	14620 105A AVE	Metro Vancouver
916	13705 97A AVE	Metro Vancouver
917	13031 LANARK PL	Metro Vancouver
918	13738 GLEN PL	Metro Vancouver
919	15091 92A AVE	Metro Vancouver
920	16222 90 AVE	Metro Vancouver
921	17079 80 AVE	Metro Vancouver
922	15508 77 Ave	Metro Vancouver
923	8241 120A ST	Metro Vancouver
924	13710 74 AVE	Metro Vancouver
925	6204 128 ST	Metro Vancouver
926	12049 56 AVE	Metro Vancouver
927	6651 148 ST	Metro Vancouver
928	15335 57 AVE	Metro Vancouver
929	14488 LOMBARD PL	Metro Vancouver
930	3031 139 ST	Metro Vancouver
931	12390 24 Ave	Metro Vancouver
932	1463 126A ST	Metro Vancouver
933	1547 133B ST	Metro Vancouver
934	1662 146 ST	Metro Vancouver
935	16391 11 AVE	Metro Vancouver
936	17195 0 AVE	Metro Vancouver
937	2158 180 ST	Metro Vancouver
938	17214 31 AVE	Metro Vancouver
939	3831 156 ST	Metro Vancouver
940	15877 Croydon Dr	Metro Vancouver
941	16602 Bell Rd	Metro Vancouver
942	5963 176 ST	Metro Vancouver
943	18425 53 AVE	Metro Vancouver
944	6008 189 ST	Metro Vancouver
945	5517 PRODUCTION BLVD	Metro Vancouver
946	6332 195B ST	Metro Vancouver
947	6803 192 ST	Metro Vancouver
948	66 AVE & 172 ST	Metro Vancouver
949	7362 182 ST	Metro Vancouver
951	19255 21 Ave	Metro Vancouver
952	19026 28 AVE	Metro Vancouver


**Fig. 4: WATER SAMPLING SITES LEGEND**

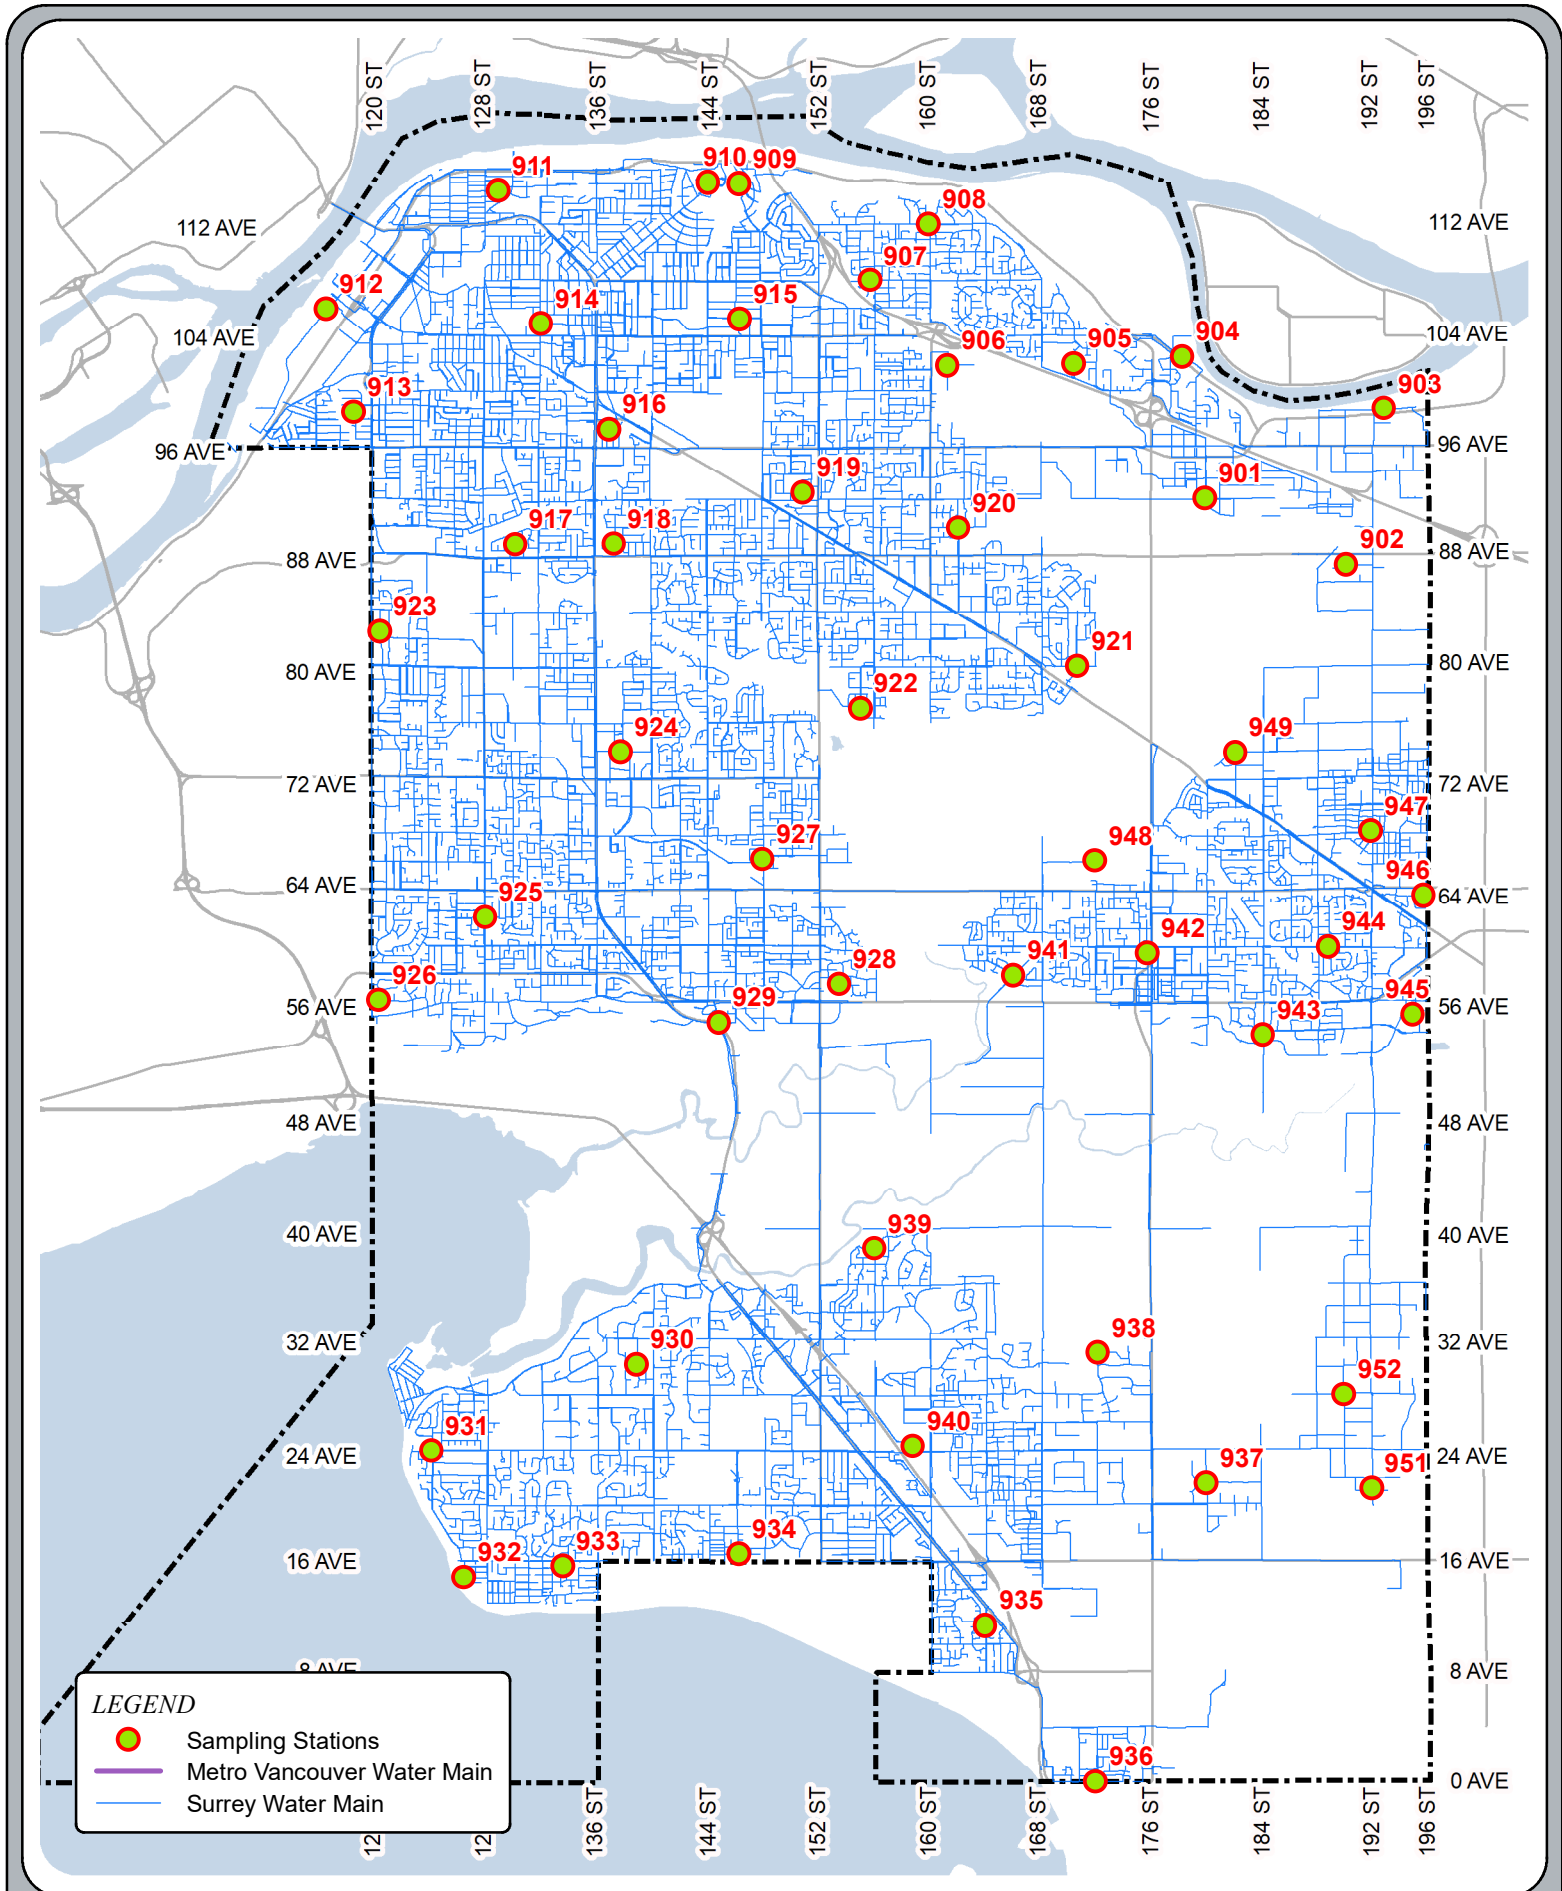

**Fig. 5: 2023 WATER SAMPLING SITES**

## F. Water Quality Inquiries

In 2023, City teams addressed 365 water quality concerns reported, marking an uptick of 84 compared to 2022. The following chart shows the issues brought up in 2023 alongside comparisons with past years.

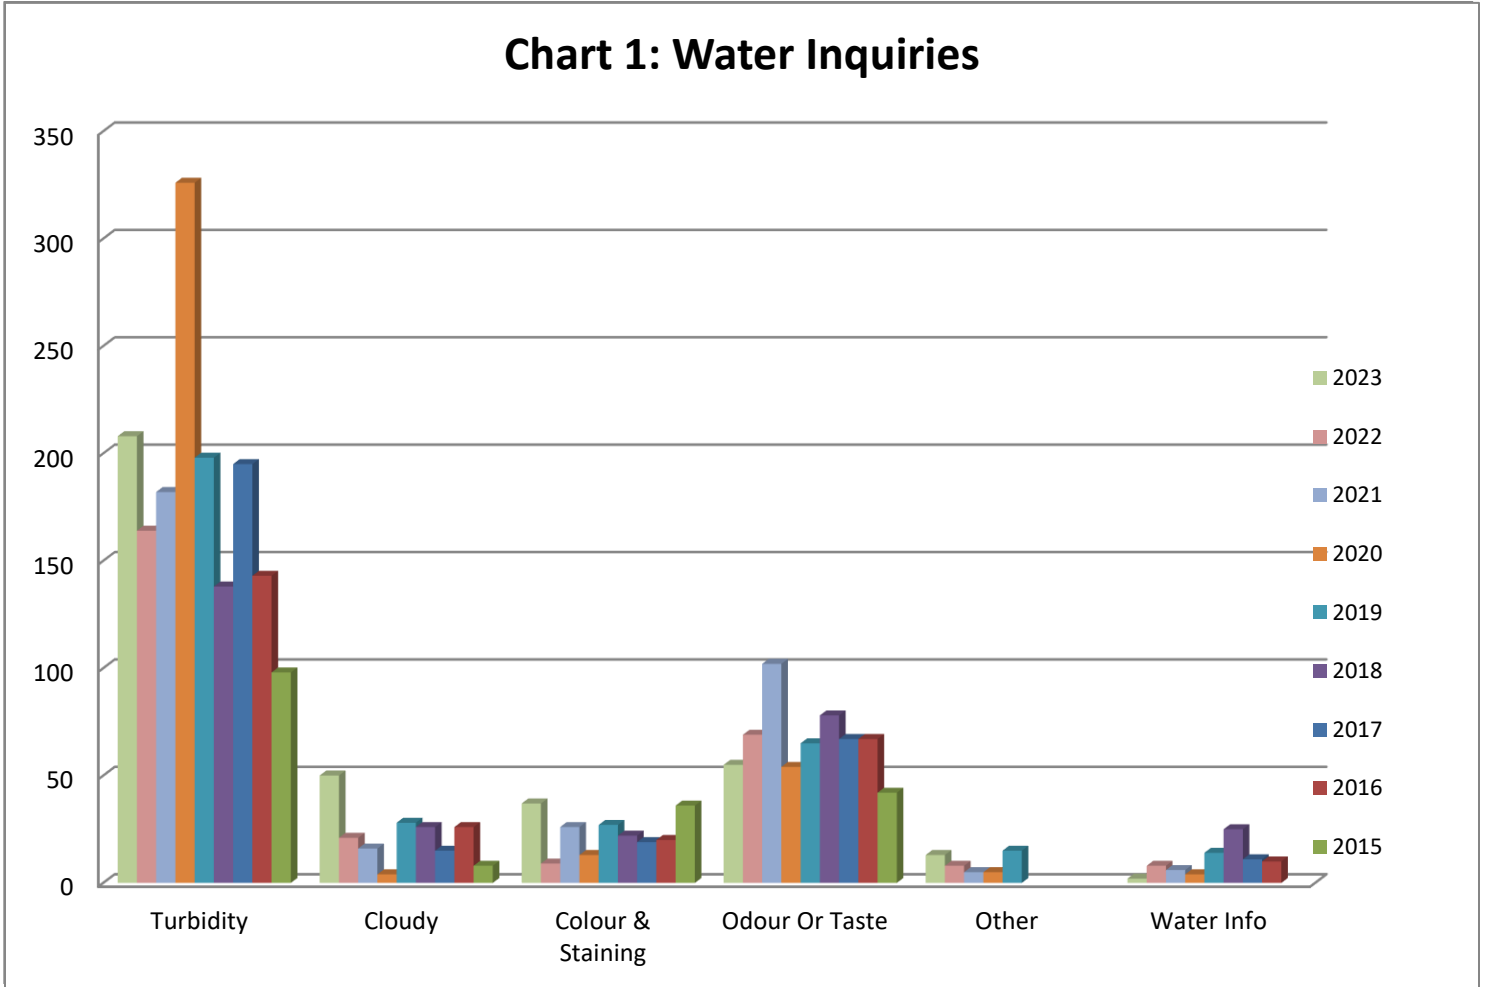

Turbidity problems can occur from abrupt changes in water flow within a distribution system caused by valve usage, firefighting activities, or power outages at pump stations. Typically, these issues can be resolved rapidly by flushing the system.

Flavor and smell sensitivities can arise from trace amounts of chlorine residual in the system for some individuals. To mitigate this, one can store water in an open container in the refrigerator or employ a charcoal water filter. Additional taste and odor issues may stem from stagnant water, which can be addressed through system flushing.



Cloudy water occurs when the speed of water flowing through our system rises, trapping air bubbles that are safe. If you fill a glass with this water, it will become clear from the bottom up in a few minutes.

Additional concerns can arise such as a pink hue on fixtures or white particles in the hot water, which stem from problems with the internal plumbing. Tiny stones and sand often originate from a disruption in the water service or mains. Flushing usually eliminates these particulates.

The Water Info category addresses public queries about water quality in Surrey, including water testing, sampling, and issues related to lead. This category ensures adherence to the Guidelines for Canadian Drinking Water Quality.

Based on Surrey's projected population of 603,970 in 2022, there's a response rate for water quality concerns at about 0.06%, which equates to roughly 6 inquiries for every 10,000 customers.

## **G. Water Quality Response Notification**

The City, together with Metro Vancouver and its member municipalities, and FHA, have established a notification protocol for instances that impact water quality. This protocol is followed by the City in cases of line breakages or suspected contamination. Additionally, if E. coli bacteria are found, the City informs FHA via Metro Vancouver's testing lab. The details of this procedure are presented below.

### **Water Quality Response Procedure**

<b>Situation</b>	<b>Notifying Agency</b>	<b>Agency Notified</b>	<b>Time Frame for Notification</b>
<b>Metro Vancouver E. Coli Positive Sample</b>	Metro Vancouver	Metro Vancouver, MHO, City of Surrey	Immediate
<b>Municipal E.Coli Positive Sample</b>	Laboratory <sup>2</sup> City of Surrey <sup>3</sup>	MHO (or delegate)	Immediate
<b>Chemical Contamination – Metro Vancouver</b>	Metro Vancouver	Metro Vancouver, MHO, City of Surrey <sup>1</sup>	Immediate
<b>Chemical Contamination – City of Surrey</b>	City of Surrey	MHO (or delegate)	Immediate
<b>Turbidity   5NTU</b>	Metro Vancouver	Metro Vancouver, MHO, and City of Surrey <sup>1</sup>	Immediate
<b>Disinfection Failure – Source Water (Primary Disinfection)</b>	Metro Vancouver	Metro Vancouver, MHO, and City of Surrey <sup>1</sup>	Immediate (As per DWPA)
<b>Disinfection Failure – Rechlorination (Secondary Disinfection)</b>	Metro Vancouver	Metro Vancouver, MHO, and City of Surrey <sup>1</sup>	Immediate, in any situation in which the BCDWPR or the GCDWQ may not be met.
<b>Loss of Pressure Due to High Demand</b>	City of Surrey	MHO (or delegate), Metro Vancouver	Immediate
<b>Line Break – City of Surrey<sup>4</sup></b>	City of Surrey	MHO (or delegate)	As soon as possible
<b>Line Break – Metro Vancouver<sup>4</sup></b>	Metro Vancouver	City of Surrey	Optional
<b>Line Break – City of Surrey<sup>5</sup></b>	City of Surrey	MHO (or delegate)	Immediate
<b>Line Break – Metro Vancouver<sup>5</sup></b>	Metro Vancouver	Metro Vancouver, MHO, City of Surrey <sup>1</sup>	Immediate

<sup>1</sup>City of Surrey to notify Fraser Health Authority.

<sup>2</sup>Laboratory to immediately notify the MHO, DWO (or FHA delegates) and the water supplier as per section 12(1) of the DWPA.

<sup>3</sup>City of Surrey to immediately notify the MHO, DWO (or FHA delegates) as per section 12(2) of the DWPA.

<sup>4</sup>With no suspected contamination.

<sup>5</sup>With suspected contamination.

## **H. Water Quality Test Results**


While ten samples initially showed the presence of total coliform bacteria, subsequent testing following system flushing and re-sampling indicated no contamination. E-coli bacteria were not detected at any stage. Furthermore, water quality is regularly assessed using key indicators such as heterotrophic plate counts (HPC), chlorine residuals, and turbidity.

The growth of harmful bacteria may be encouraged by rising levels of HPC and turbidity alongside falling chlorine residuals. The City undertakes flushing and additional sampling if HPC test results exceed 500 heterotrophic bacteria colonies per milliliter. Such instances are more common in warmer seasons within areas of low circulation or at dead ends in the water distribution network.

In the year 2023, it was found that 1.6% of the tested samples had heterotrophic plate counts (HPCs) exceeding 500 colony forming units (CFU) per milliliter. This issue was addressed by performing flushing and elevating the levels of chlorine residuals. Table 4 presents a summary of cases with HPCs over 500 CFUs spanning from the years 2013 to 2023, as detailed on page 18. Additionally, these occurrences are depicted in a chart for the same duration on page 19.

As demonstrated on page 16 in Figure 6, titled "Chlorine Residuals," chlorine residual levels are tracked throughout the distribution network. The target minimum concentration has been set at 0.2 mg/L. Across the city, it was observed that 84% of the chlorine residual measurements exceeded 0.2 mg/L, as detailed in Table 3 on page 17. Chlorine analyzers have been put in place at the municipality's water pumping stations to maintain real-time tracking of the chlorine residuals emitted from the reservoirs.

The City is observing regions with low chlorine levels and high HPC counts (>500 CFU/ml) to find a viable solution for enhancing water quality, potentially by connecting dead-end mains.

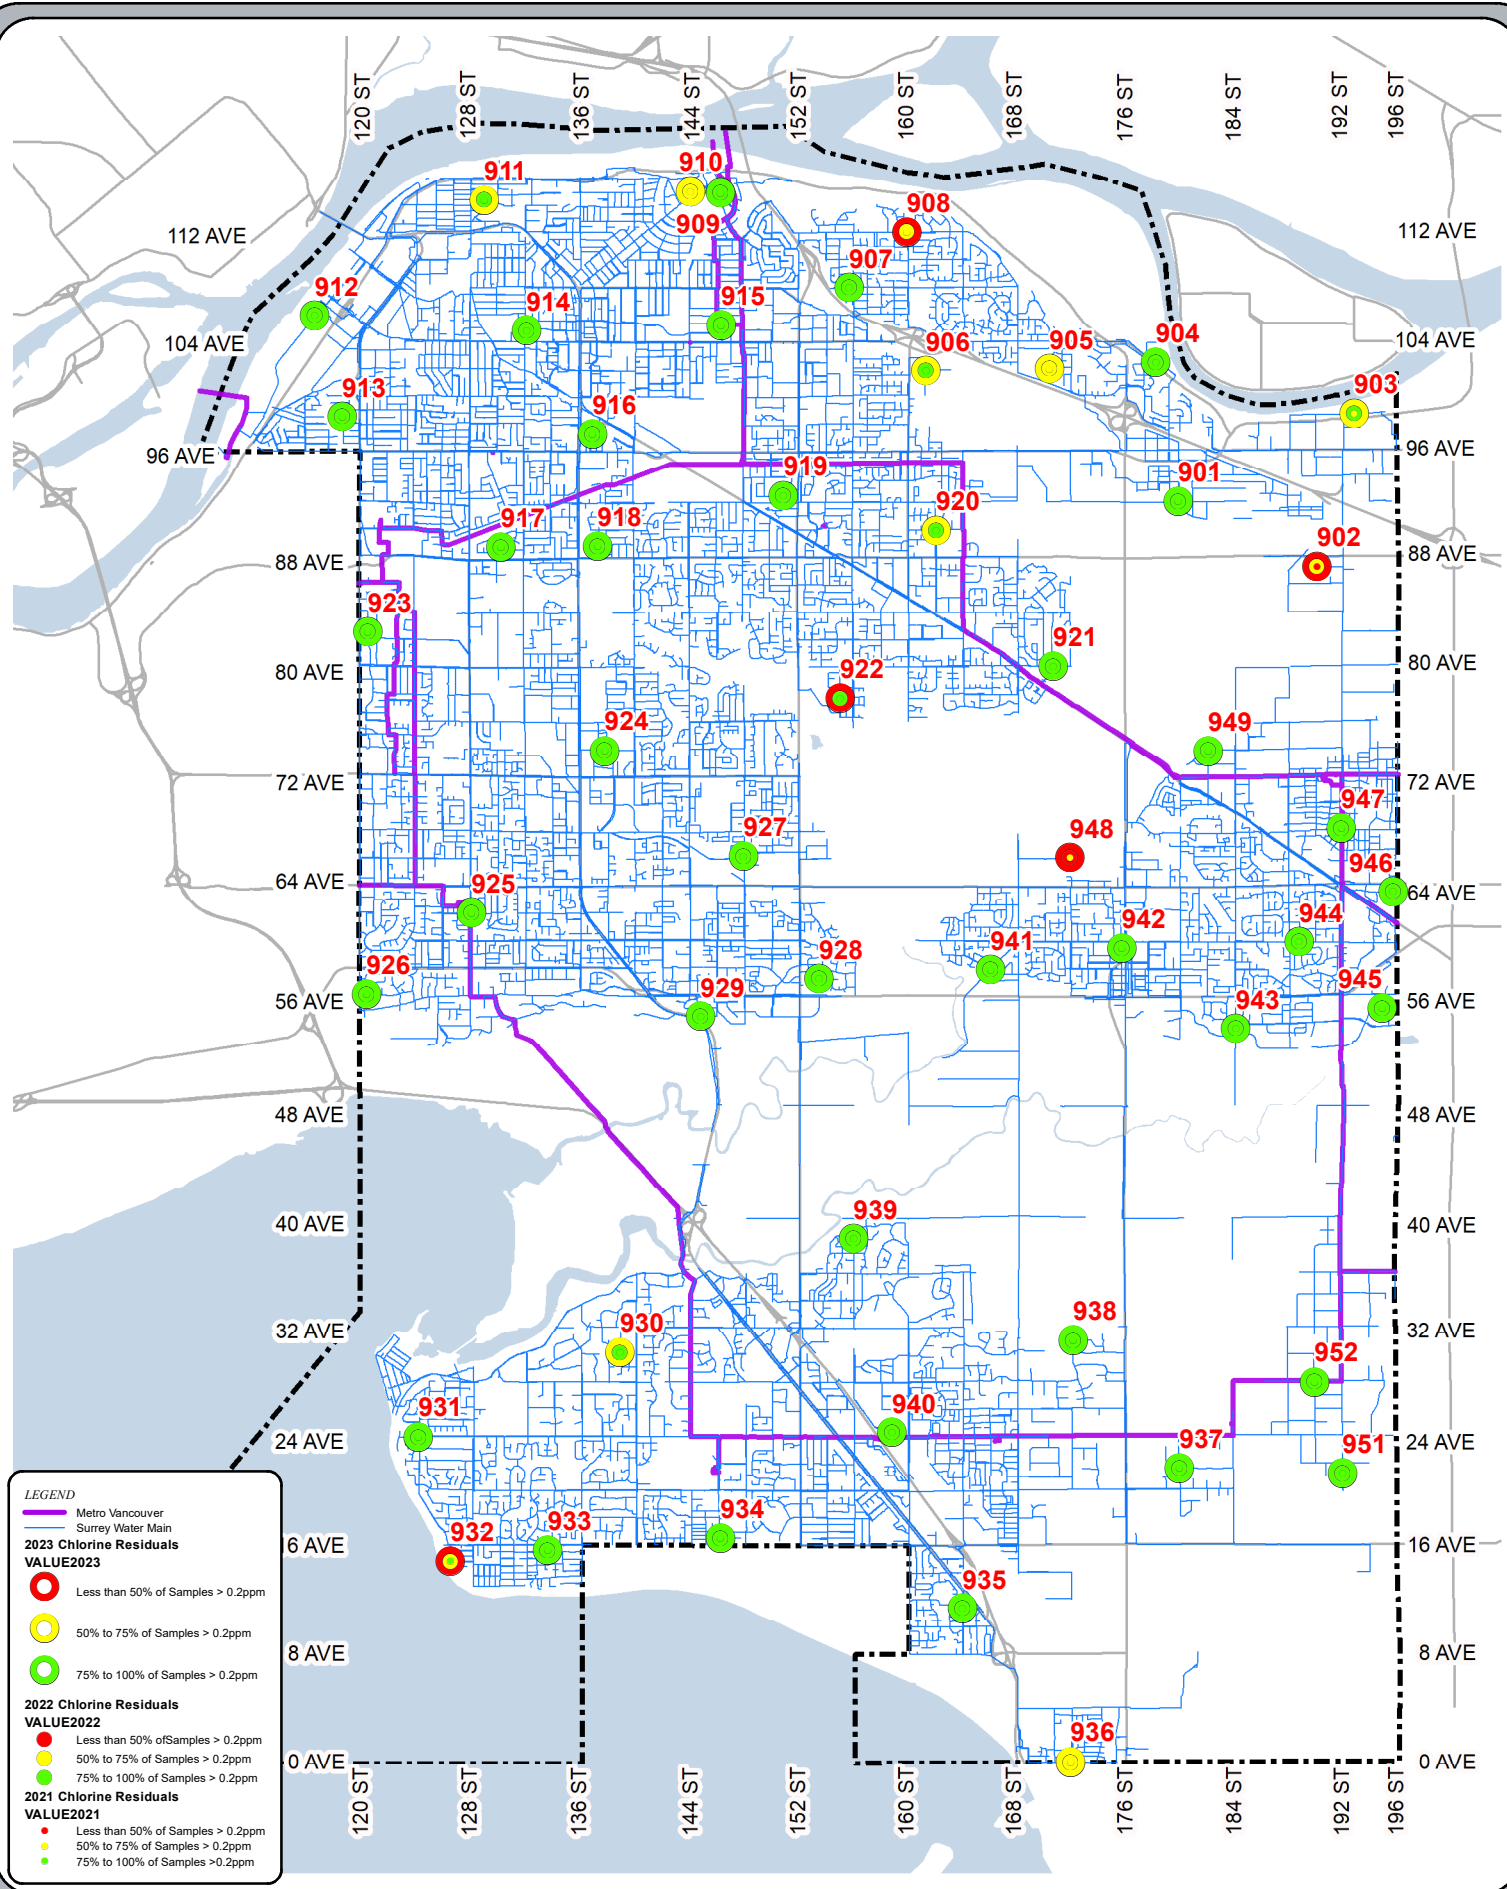

**Fig. 6: 2023 CHLORINE RESIDUALS**

SCALE: 1:112,000  
GIS SECTION  
CITY OF SURREY


**Table 3 Comparisons of Chlorine Residuals Above & Below 0.2 ppm (2021-2023)**

Sampling Site	2021	2022	2023	2021	2022	2023	2021	2022	2023	2021	2022	2023	2021	2022	2023
	No. of Samples Tested	No. of Samples Tested	No. of Samples Tested	< 0.2 ppm	< 0.2 ppm	< 0.2 ppm	> 0.2 ppm	> 0.2 ppm	> 0.2 ppm	< 0.2 ppm	< 0.2 ppm	< 0.2 ppm	> 0.2 ppm	> 0.2 ppm	> 0.2 ppm
SUR 901	74	61	75	2	4	6	72	57	69	3%	7%	8%	97%	93%	92%
SUR 902	75	61	62	39	28	39	36	33	23	52%	46%	63%	48%	54%	37%
SUR 903	70	49	52	31	12	24	39	37	28	44%	24%	46%	56%	76%	54%
SUR 904	57	56	56	0	0	0	57	56	56	0%	0%	0%	100%	100%	100%
SUR 905	68	63	72	29	16	33	39	47	39	43%	25%	46%	57%	75%	54%
SUR 906	63	64	63	8	4	16	55	60	47	13%	6%	25%	87%	94%	75%
SUR 907	68	66	79	3	3	7	65	63	72	4%	5%	9%	96%	95%	91%
SUR 908	71	65	73	34	25	44	37	40	29	48%	38%	60%	52%	62%	40%
SUR 909	59	63	60	0	0	0	59	63	60	0%	0%	0%	100%	100%	100%
SUR 910	56	56	61	19	16	27	37	40	34	34%	29%	44%	66%	71%	56%
SUR 911	55	65	59	3	16	29	52	49	30	5%	25%	49%	95%	75%	51%
SUR 912	53	55	54	9	12	8	44	43	46	17%	22%	15%	83%	78%	85%
SUR 913	58	58	57	0	0	1	58	58	56	0%	0%	2%	100%	100%	98%
SUR 914	55	55	36	1	2	5	54	53	31	2%	4%	14%	98%	96%	86%
SUR 915	57	53	52	0	0	0	57	53	52	0%	0%	0%	100%	100%	100%
SUR 916	54	55	49	0	0	3	54	55	46	0%	0%	6%	100%	100%	94%
SUR 917	54	62	60	0	0	0	54	62	60	0%	0%	0%	100%	100%	100%
SUR 918	53	56	55	0	0	0	53	56	55	0%	0%	0%	100%	100%	100%
SUR 919	62	62	56	1	0	2	61	62	54	2%	0%	4%	98%	100%	96%
SUR 920	64	57	54	7	4	17	57	53	37	11%	7%	31%	89%	93%	69%
SUR 921	59	63	63	0	0	0	59	63	63	0%	0%	0%	100%	100%	100%
SUR 922	63	63	64	11	13	33	52	50	31	17%	21%	52%	83%	79%	48%
SUR 923	56	55	58	2	0	0	54	55	58	4%	0%	0%	96%	100%	100%
SUR 924	53	54	54	0	0	0	53	54	54	0%	0%	0%	100%	100%	100%
SUR 925	49	52	48	0	0	0	49	52	48	0%	0%	0%	100%	100%	100%
SUR 926	58	54	61	0	0	2	58	54	59	0%	0%	3%	100%	100%	97%
SUR 927	55	51	47	1	0	3	54	51	44	2%	0%	6%	98%	100%	94%
SUR 928	55	70	89	7	12	12	48	58	77	13%	17%	13%	87%	83%	87%
SUR 929	56	61	61	5	9	9	51	52	52	9%	15%	15%	91%	85%	85%
SUR 930	57	52	62	9	3	15	48	49	47	16%	6%	24%	84%	94%	76%
SUR 931	60	53	60	8	1	8	52	52	52	13%	2%	13%	87%	98%	87%
SUR 932	64	59	64	16	17	36	48	42	28	25%	29%	56%	75%	71%	44%
SUR 933	63	54	59	0	0	0	63	54	59	0%	0%	0%	100%	100%	100%
SUR 934	68	64	66	0	0	0	68	64	66	0%	0%	0%	100%	100%	100%
SUR 935	64	61	63	0	0	2	64	61	61	0%	0%	3%	100%	100%	97%
SUR 936	66	57	59	22	22	25	44	35	34	33%	39%	42%	67%	61%	58%
SUR 937	68	62	71	16	12	14	52	50	57	24%	19%	20%	76%	81%	80%
SUR 938	67	65	75	4	1	8	63	64	67	6%	2%	11%	94%	98%	89%
SUR 939	55	57	65	0	1	0	55	56	65	0%	2%	0%	100%	98%	100%
SUR 940	66	56	60	0	0	0	66	56	60	0%	0%	0%	100%	100%	100%
SUR 941	53	57	53	2	1	0	51	56	53	4%	2%	0%	96%	98%	100%
SUR 942	64	60	66	0	0	0	64	60	66	0%	0%	0%	100%	100%	100%
SUR 943	72	59	66	0	0	0	72	59	66	0%	0%	0%	100%	100%	100%
SUR 944	69	61	70	0	1	2	69	60	68	0%	2%	3%	100%	98%	97%
SUR 945	76	63	78	3	0	0	73	63	78	4%	0%	0%	96%	100%	100%
SUR 946	62	53	58	0	0	1	62	53	57	0%	0%	2%	100%	100%	98%
SUR 947	60	51	55	0	0	0	60	51	55	0%	0%	0%	100%	100%	100%
SUR 948	55	62	67	17	47	53	38	15	14	31%	76%	79%	69%	24%	21%
SUR 949	63	54	61	0	1	1	63	53	60	0%	2%	2%	100%	98%	98%
SUR 951	64	55	63	2	0	1	62	55	62	3%	0%	2%	97%	100%	98%
SUR 952	72	63	64	0	0	0	72	63	64	0%	0%	0%	100%	100%	100%
<b>Total</b>	<b>3138</b>	<b>2983</b>	<b>3135</b>	<b>311</b>	<b>283</b>	<b>486</b>	<b>2827</b>	<b>2700</b>	<b>2649</b>	<b>10%</b>	<b>9%</b>	<b>16%</b>	<b>90%</b>	<b>91%</b>	<b>84%</b>

## Table 4: 2013 to 2023 HPC Positive Samples Summary >500 CFU/ml

Sampling Site	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023		
901	83	69	60	60	67	60	67	61	74	61	75	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
902	81	69	65	64	74	61	60	68	75	61	62	0	0	0	0	1	0	1	0	0	0	0	0	0%	0%	0%	0%	1%	0%	2%	0%	0%	0%	0%	
903	81	72	67	64	69	64	69	65	70	49	52	0	0	0	0	1	4	1	0	1	7	0	0%	0%	0%	0%	0%	2%	6%	2%	0%	2%	13%		
904	79	70	60	57	65	60	59	59	57	56	56	0	2	0	0	0	0	0	0	0	0	0	0	0%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
905	79	70	72	58	66	55	59	64	68	63	72	0	0	13	0	0	0	0	0	0	0	0	0	0%	0%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%
906	73	74	62	55	58	64	61	60	63	64	63	1	0	0	0	0	0	0	0	0	0	0	0	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
907	80	69	68	55	63	57	53	62	68	66	79	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
908	79	70	68	57	63	56	57	64	71	65	73	0	0	0	0	1	0	0	0	0	0	0	0	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	
909	77	71	64	54	59	65	68	62	59	63	60	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
910	80	69	65	54	59	65	67	60	56	56	61	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
911	81	71	72	59	62	63	72	62	55	65	59	0	0	0	0	0	0	0	0	0	0	0	3	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	5%	
912	81	68	69	56	62	61	63	58	53	55	54	3	0	0	4	0	0	0	0	0	0	0	0	4%	0%	0%	7%	0%	0%	0%	0%	0%	0%	0%	
913	82	72	69	54	62	61	67	63	58	58	57	0	0	0	1	0	0	0	0	0	0	0	0	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	
914	80	67	68	54	63	65	66	62	55	55	36	0	0	0	0	0	0	1	0	0	4	0	0%	0%	0%	0%	0%	0%	2%	0%	0%	7%	0%	0%	
915	80	71	68	54	63	71	71	62	57	53	52	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
916	79	75	62	54	60	64	70	58	54	55	49	3	1	0	0	0	0	0	0	1	0	1	4%	1%	0%	0%	0%	0%	0%	0%	2%	0%	2%		
917	80	71	61	52	60	63	64	53	54	62	60	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
918	78	73	66	53	58	63	62	58	53	56	55	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
919	70	63	57	54	57	62	65	63	62	62	56	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
920	73	66	59	57	58	38	61	61	64	57	54	0	0	3	0	0	0	0	0	0	0	0	0	0%	0%	5%	0%	0%	0%	0%	0%	0%	0%	0%	
921	74	75	61	57	63	66	70	60	59	63	63	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
922	71	76	61	55	59	64	66	62	63	63	64	0	0	1	3	0	0	0	0	0	0	0	0	0%	0%	2%	5%	0%	0%	0%	0%	0%	0%	0%	
923	81	68	67	55	62	61	67	60	56	55	58	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
924	67	72	65	53	56	62	58	56	53	54	54	1	0	0	0	0	0	0	0	0	0	0	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%		
925	51	49	53	59	58	62	62	60	49	52	48	0	0	0	0	0	0	0	0	2	1	5	0%	0%	0%	0%	0%	0%	0%	0%	4%	2%	10%		
926	51	48	52	55	57	66	67	59	58	54	61	0	0	0	0	0	0	0	0	0	0	9	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	15%		
927	51	48	52	51	59	65	66	60	55	51	47	0	0	0	0	0	0	0	1	2	0	2	0%	0%	0%	0%	0%	0%	0%	2%	4%	0%	4%		
928	51	47	52	56	59	64	62	55	55	70	89	0	0	0	0	0	0	0	0	0	0	12	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	13%		
929	51	47	52	57	57	67	70	59	56	61	61	0	0	3	0	0	0	0	0	0	0	10	0%	0%	6%	0%	0%	0%	0%	0%	0%	0%	16%		
930	48	50	53	59	62	61	66	60	57	52	62	0	0	0	0	0	0	3	0	0	0	0	0%	0%	0%	0%	0%	0%	5%	0%	0%	0%	0%		
931	50	50	51	60	62	61	67	62	60	53	60	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
932	50	49	54	57	60	64	66	63	64	59	64	0	0	0	0	0	0	2	0	0	0	0	0%	0%	0%	0%	0%	0%	3%	0%	0%	0%	0%		
933	50	49	51	61	63	64	69	62	63	54	59	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
934	50	49	51	62	63	67	68	62	68	64	66	0	0	0	0	1	0	0	0	0	0	0	0	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	
935	50	49	51	61	59	64	71	61	64	61	63	0	0	0	1	0	0	0	1	0	0	0	0	0%	0%	0%	2%	0%	0%	0%	0%	2%	0%	0%	
936	50	50	51	56	58	63	63	67	66	57	59	1	0	1	0	0	1	6	0	0	0	0	0	2%	0%	2%	0%	0%	2%	10%	0%	0%	0%	0%	
937	51	49	51	60	62	63	68	61	68	62	71	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
938	51	49	51	60	59	67	66	60	67	65	75	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
939	50	49	51	58	63	65	60	58	55	57	65	1	0	0	0	0	0	0	0	0	0	0	0	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
940	51	49	51	60	61	65	66	62	66	56	60	1	0	0	0	0	0	0	0	0	0	0	0	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
941	51	48	51	60	59	66	66	58	53	57	53	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
942	51	47	52	57	55	57	59	62	64	60	66	0	0	0	0	1	0	0	1	0	0	0	0	0%	0%	0%	0%	2%	0%	0%	2%	0%	0%	0%	
943	51	50	51	62	63	64	69	66	72	59	66	0	0	0	1	0	0	0	0	0	0	0	0	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	
944	51	47	52	62	60	65	66	60	69	61	70	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
945	51	47	52	60	65	64	65	63	76	63	78	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
946	51	47	53	59	54	57	52	57	62	53	58	0	1	0	0	1	0	1	0	0	0	1	0%	2%	0%	0%	2%	0%	2%	0%	0%	0%	2%		
947	49	48	52	59	59	57	61	60	60	51	55	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
948	51	47	53	61	57	63	71	60	55	62	67	0	0	0	0	5	2	2	0	1	3	0	0%	0%	0%	0%	9%	3%	3%	0%	2%	5%	0%		
949	96	81	72	69	65	61	60	61	63	54	61	0	0	0	0	0	0	0	0	0	0	0	0	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	
951	51	49	50	62	62	40	51	50	64	55	63	3	1	2	1	0	2	0	0	0	0	0	0	6%	2%	4%	2%	0%	5%	0%	0%	0%	0%	0%	
952	49	49	50	62	65	63	70	64	72	63	64	0	0	1	0	0	0	0	0	0	0	0	0	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	
TOTAL	3277	3032	2971	2950	3114	3156	3289	3095	3138	2983	3135	14	5	25	11	10	6	20	3	7	9	50	0.4%	0.2%	0.8%	0.4%	0.3%	0.2%	0.6%	0.1%	0.3%	0.3%	1.6%		

**Graph 1: Comparison of Annual HPC Results >500 CFU/ml  
in the City of Surrey's Water System**

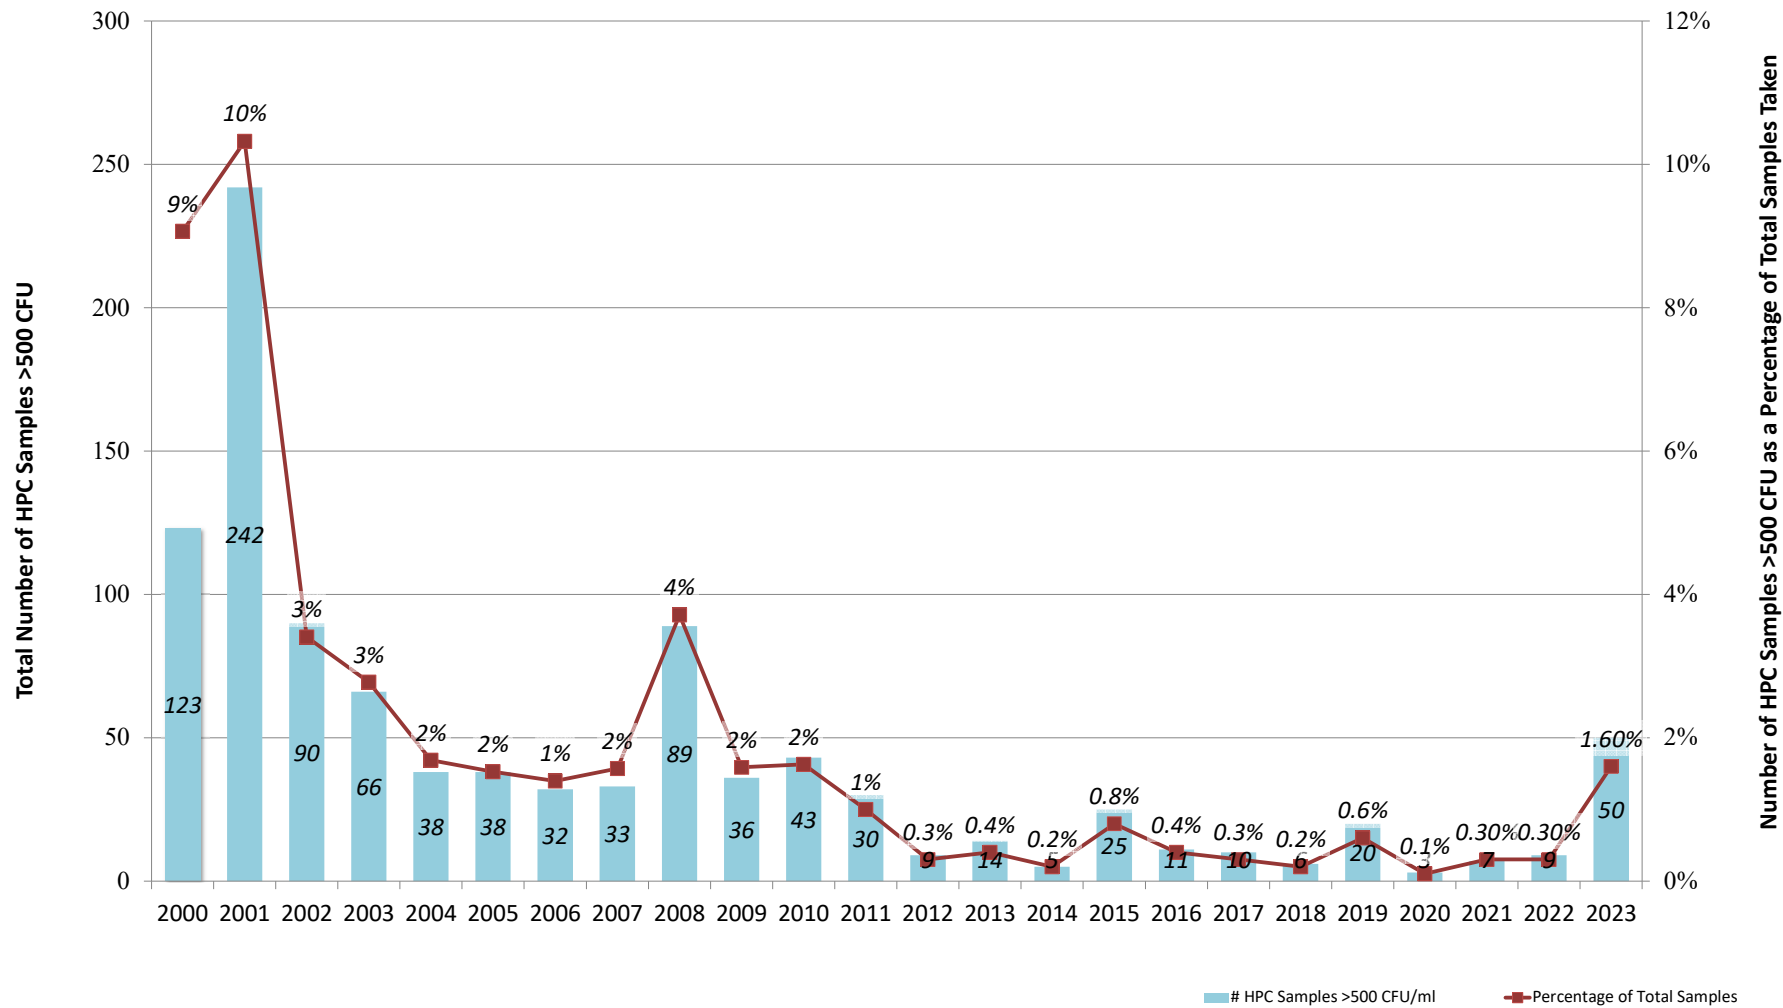

## **I. Water System Security**

The distribution system's security is ensured through various strategies. Pump stations are equipped with external security lights, secure access doors or ground hatches enclosed by fencing, and intrusion alarms connected to a SCADA monitoring system. In 2023, there were no instances of tampering or vandalism reported in the City's water system.

## **J. Backflow Prevention and Cross Connection Control**

The City safeguards water quality by preventing backflow in the system, maintaining minimum pressures of 40 psi during peak use and 20 psi during emergencies such as fires or main breaks.

Furthermore, the City manages an extensive Cross Connection Control (CCC) program aimed at reducing the chances of pollutants from private properties contaminating the municipal water system and private plumbing networks. This program mandates yearly checks of backflow prevention devices, mandates the fitting of backflow preventers in new buildings (as part of plumbing permit regulations), and enforces a cross-connection survey requirement for existing industrial, commercial, and institutional (ICI) properties.

The City mandates yearly testing for back flow prevention devices. Property owners who fail to meet these requirements have received notifications to adhere to regulations or risk facing enforcement actions under the Surrey Waterworks Cross Connection Control By-law 2013, No. 17988.

As of 2023, there has been a 3.8% increase in the number of backflow preventers listed with the City, bringing the total to 16,542 units. Currently, 90% of these assemblies comply with regulations, down by 4% compared to the previous year.

The City of Surrey is committed to the meticulous upkeep of its water distribution network, guaranteeing that residents and businesses consistently receive water that meets superior quality criteria.

## **K. Water Emergency Response Plan**

The management of water emergencies falls under the jurisdiction of both Metro Vancouver and the City of Surrey. Metro Vancouver (MV) is responsible for overseeing the transfer of source water from the North Shore watersheds to the supply mains in Surrey. In the event of an emergency caused by either human error or natural disasters, MV's Water Continuity Plan is activated. Similarly, any incidents occurring within Surrey's limits will trigger the activation of their own Water Continuity Plan. Emergency responses may deal with situations such as interruption of MV's water supply, the deterioration of water quality, and threats from earthquakes and floods. The City of Surrey regularly updates its plan to reflect the latest knowledge and best practices. In the process of updating and reviewing the plan, Surrey maintains close coordination with Fraser Health.





**fraserhealth** Better health.  
Best in health care.

February 1, 2022

*Water System Operators*

**Re: Metals in Drinking Water – “Flush” Message in Annual Reports**

---

Fraser Health has recently revised its metals at the tap “Flush” message and we are asking all water systems to please include the following health message with your next annual reports to your users.

***Anytime the water in a particular faucet has not been used for six hours or longer, “flush” your cold-water pipes by running the water until you notice a change in temperature. (This could take as little as five to thirty seconds if there has been recent heavy water use such as showering or toilet flushing. Otherwise, it could take two minutes or longer.) The more time water has been sitting in your home’s pipes, the more lead it may contain.***

***Use only water from the cold-tap for drinking, cooking, and especially making baby formula. Hot water is likely to contain higher levels of lead.***

***The two actions recommended above are very important to the health of your family. They will probably be effective in reducing lead levels because most of the lead in household water usually comes from the plumbing in your house, not from the local water supply.***

***Conserving water is still important. Rather than just running the water down the drain you could use the water for things such as watering your plants.***

If you have any questions, please contact our Drinking Water Program at 604-870-7903.

Sincerely,

Drinking Water Program  
Fraser Health Authority  
HPLand@fraserhealth.ca

**Fraser Health Authority**  
Health Protection

Suite 400 2777 Gladwin Rd  
Abbotsford BC  
V2T 4V1 Canada


Tel (604) 870-7900  
Fax (604) 852-1558  
[www.fraserhealth.ca](http://www.fraserhealth.ca)

# **APPENDIX A**

---

## **2023 Water Quality Laboratory Test Results**

## 2023 T. Coliform and E.Coli Positive Test Results

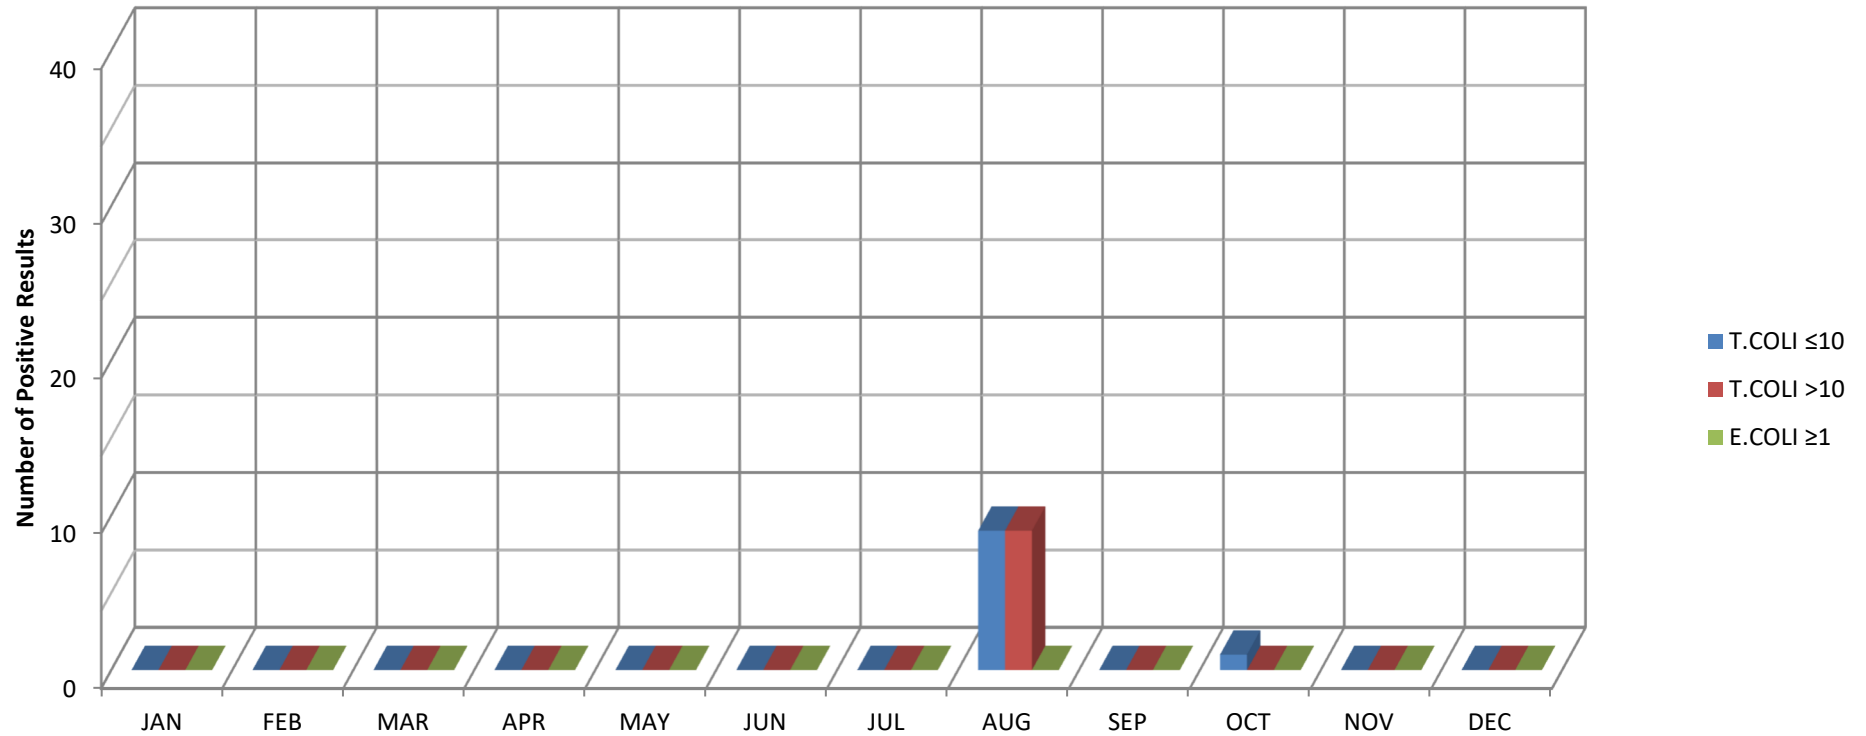


As per the BC Drinking Water Protection Regulation:  
No Samples are allowed to test positive for E. coli  
Only 10% of samples tested within a 30 day period can test positive for T. Coliform  
No samples can test positive for greater than 10 coliform bacterial per 100ml

Analysis by Metro Vancouver Laboratories



## 2023 - Number of Samples per Month

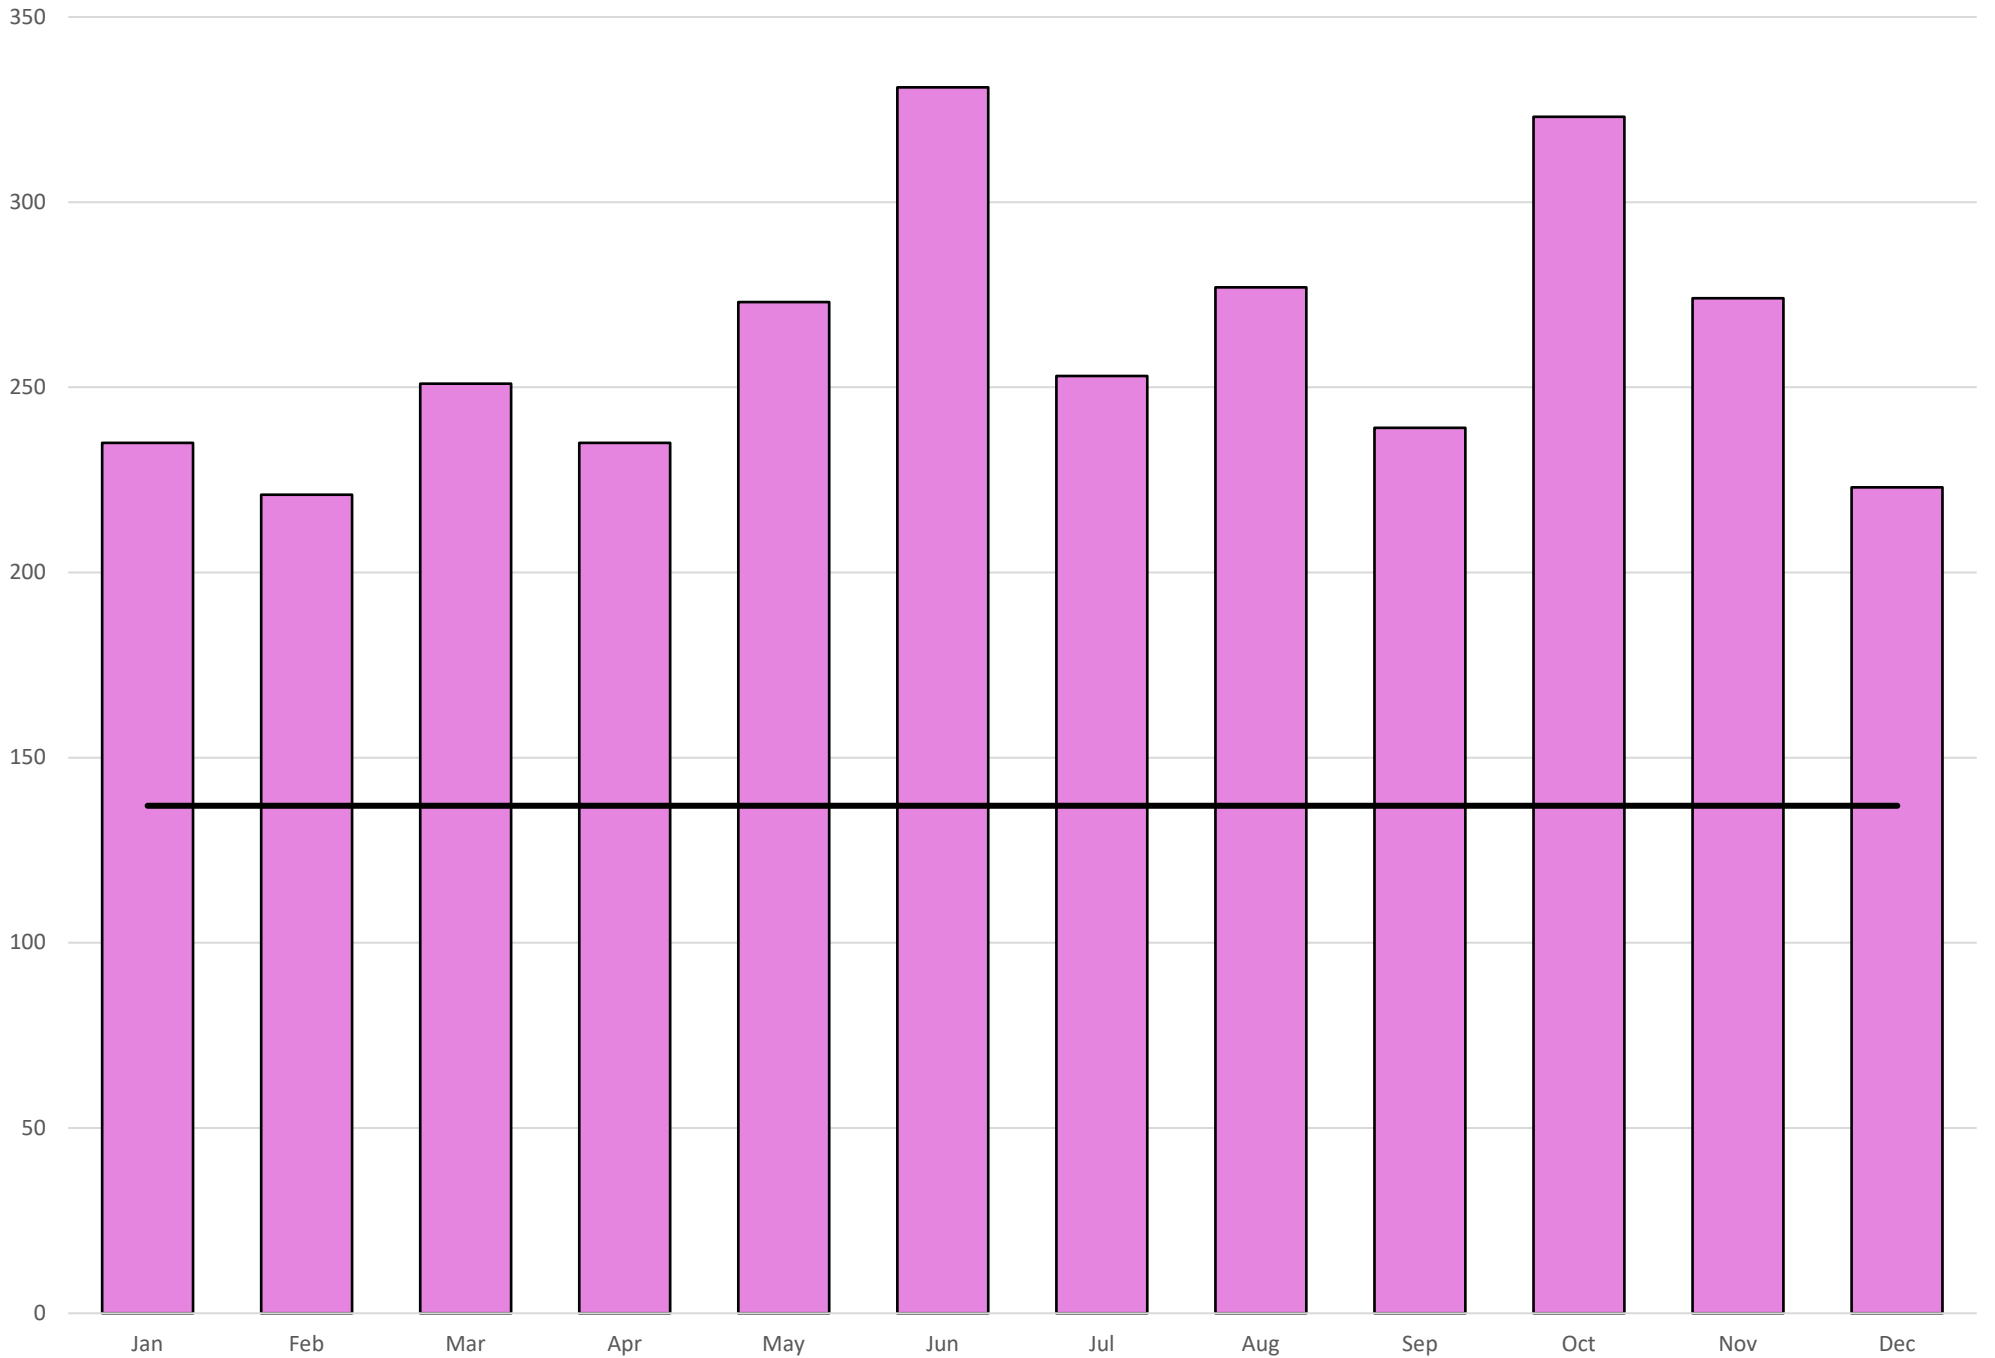

Number of Samples per Month analyzed for the presence of Coliform Bacteria


Min No. of Monthly Samples required under Schedule B of the DWPR

City of Surrey

2023 Disinfection By-Products (THM, HAA) & pH Monitoring Results

Sample Station ID	Sample Station Location	Date Sampled	THM (ppb)						HAA (µg/L)							pH units
			Bromodichloromethane	Bromoform	Chlorodibromomethane	Chloroform	Total Trihalomethanes	Total THM Quarterly Average (Guilleline Limit 100ppb/mL)	Dibromoacetic Acid	Dichloroacetic Acid	Monobromoacetic Acid	Monochloroacetic Acid	Trichloroacetic Acid	Total Haloacetic Acid	Total HAA Quarterly Average (Guilleline Limit 80ppb/mL)	
SUR-902	18995 87A Ave	3-Feb-23	<1	<1	<1	62	63	50	<0.5	3.3	<5.0	<5.0	18	21	33	
SUR-902		1-Jun-23	1	<1	<1	26	28	46	<0.5	4.2	<0.5	<0.5	16	20	25	
SUR-902		28-Aug-23	1	<1	<1	30	32	44	<0.5	1.6	<0.5	<0.5	10	12	12	
SUR-902		28-Nov-23	1	<1	<1	40	42	41	<0.5	1.2	<0.5	<0.5	23	24	18	
SUR-922	7768 155 St.	9-Feb-23	<1	<1	<1	53	54	43	<0.5	3.4	<0.5	<0.5	18	21	27	7.6
SUR-922		31-May-23	<1	<1	<1	26	28	41	<0.5	1.9	<0.5	<0.5	21	23	22	7.7
SUR-922		30-Aug-23	1	<1	<1	30	32	38	<0.5	1.9	<0.5	<0.5	18	20	20	7.7
SUR-922		28-Nov-23	<1	<1	<1	31	32	38	<0.5	3.4	<0.5	<0.5	21	25	21	7.7
SUR-926	12059 56 Ave	30-Jan-23	<1	<1	<1	21	22	30	<0.5	9.3	<0.5	0.5	7.7	18	25	
SUR-926		31-May-23	<1	<1	<1	30	31	30	<0.5	12	<0.5	0.6	8.9	21	21	
SUR-926		30-Aug-23	1	<1	<1	30	32	35	<0.5	7	<0.5	<0.5	15	22	22	
SUR-926		30-Nov-23	<1	<1	<1	30	32	37	<0.5	6.2	<0.5	1.1	9.1	16	21	
SUR-928	15349 57 Ave	30-Jan-23	<1	<1	<1	43	43	41	<0.5	11	<0.5	<0.5	8	19	19	
SUR-928		31-May-23	<1	<1	<1	25	27	39	<0.5	8.6	<0.5	0.6	7	17	19	
SUR-928		30-Aug-23	1	<1	<1	37	39	35	<0.5	1.2	<0.5	<0.5	18	20	18	
SUR-928		28-Nov-23	<1	<1	<1	32	32	36	<0.5	4.5	<0.5	<0.5	9.3	14	19	
SUR-930	SW Entrance to Parkway, South of 303 139 St.	2-Feb-23	1	<1	<1	63	64	50	<0.5	13	<0.5	<0.5	28	40	45	7.7
SUR-930		1-Jun-23	1	<1	<1	29	31	46	<0.5	9.3	<0.5	2.3	28	40	39	7.7
SUR-930		23-Aug-23	1	<1	<1	29	32	46	<0.5	3.1	<0.5	1.1	21	25	36	7.8
SUR-930		27-Nov-23	1	<1	<1	40	42	42	<0.5	0.7	<0.5	<0.5	29	30	35	7.7
SUR-931	124 St. & 24 Ave	2-Feb-23	1	<1	<1	60	61	48	<0.5	5.2	<0.5	<0.5	27	32	38	
SUR-931		1-Jun-23	1	<1	<1	29	31	44	<0.5	5.2	<0.5	<0.5	28	33	33	
SUR-931		23-Aug-23	1	<1	<1	29	32	44	<0.5	2.6	<0.5	<0.5	21	24	29	
SUR-931		27-Nov-23	1	<1	<1	44	46	41	<0.5	2.3	<0.5	<0.5	30	32	30	
SUR-940	24 Ave., by South Depot	2-Feb-23	1	<1	<1	62	63	48	<0.5	4.3	<0.5	<0.5	32	36	38	7.9
SUR-940		1-Jun-23	1	<1	<1	30	32	46	<0.5	15	<0.5	<0.5	27	42	37	7.7
SUR-940		23-Aug-23	1	<1	<1	29	32	45	<0.5	10	<0.5	1.4	21	32	34	7.9
SUR-940		27-Nov-23	<1	<1	<1	34	35	42	<0.5	8.3	<0.5	<0.5	24	32	37	7.9

## Comparison of Annual Disinfection Bi-Product Averages in the City of Surrey's Water System (2003-2023)

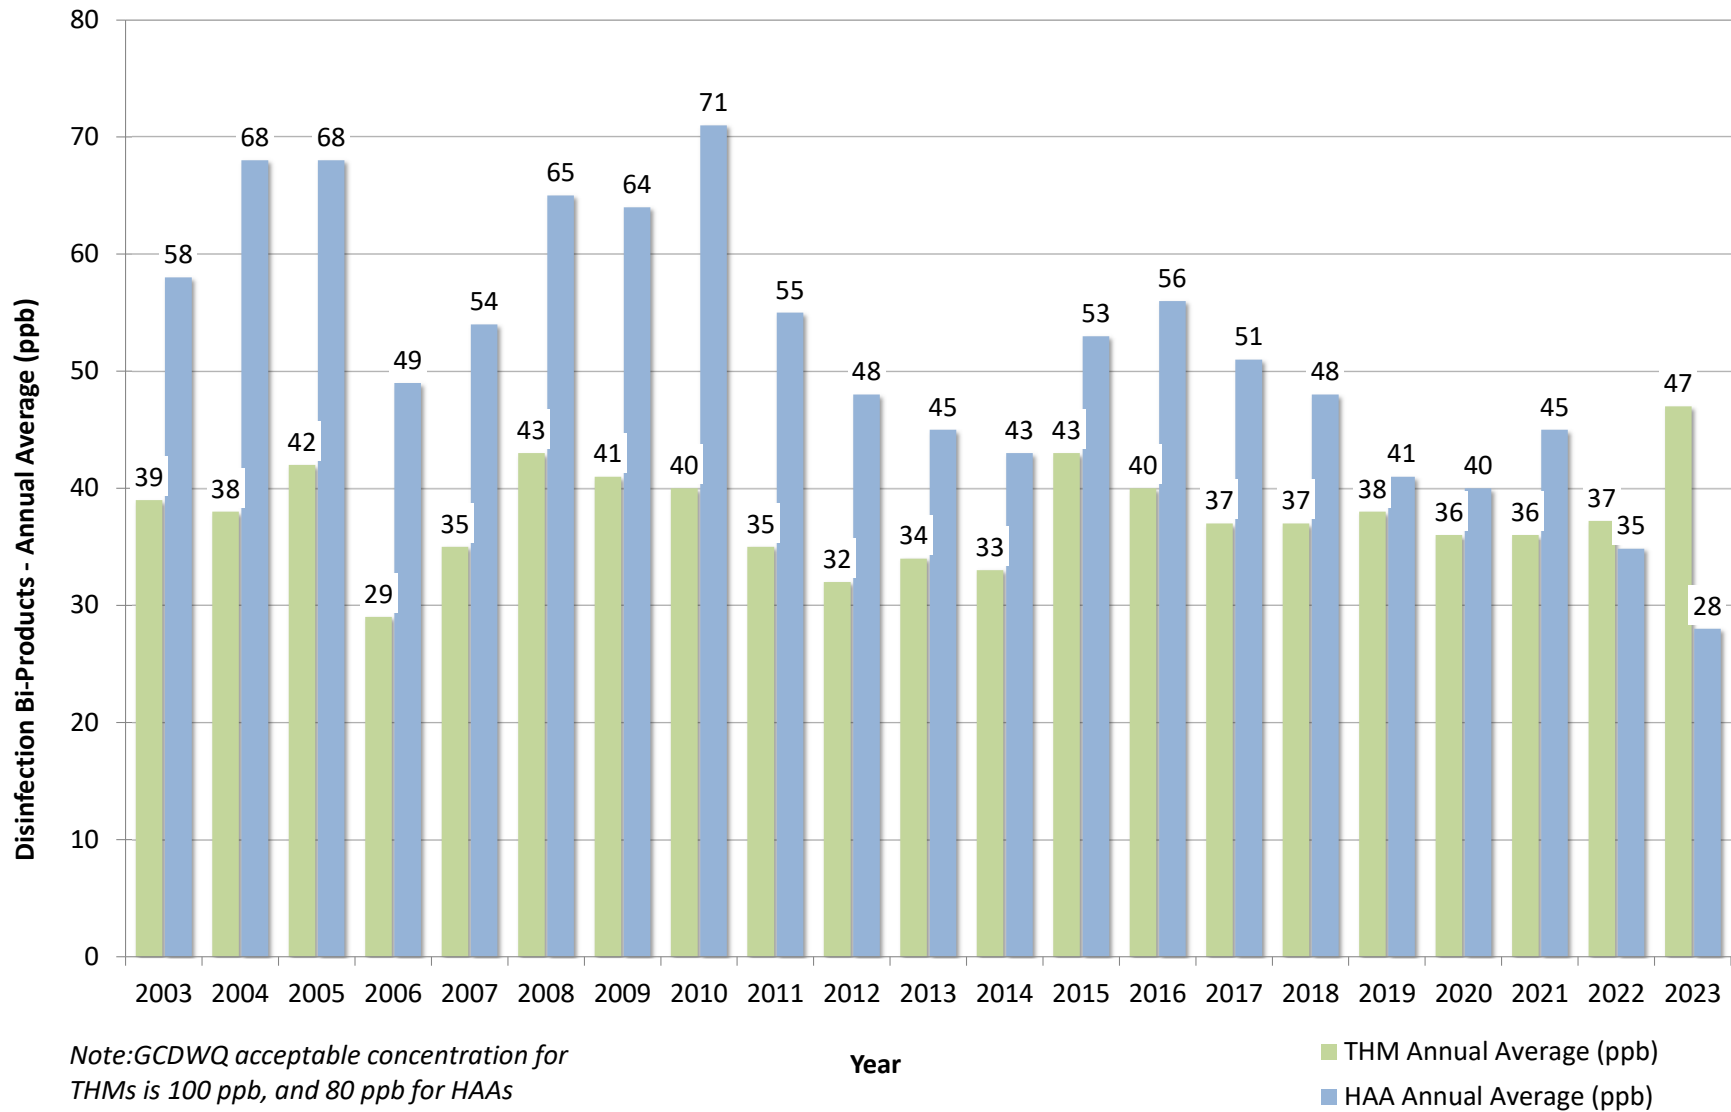

## 2023 Semi-annual Metals Monitoring Results

Sample Station ID	Sample Station Location	Date & Time Sampled	Aluminum Total	Antimony Total	Arsenic Total	Barium Total	Boron Total	Cadmium Total	Calcium Total	Chromium Total	Cobalt Total	Copper Total	Iron Total	Lead Total	Magnesium Total	Manganese Total	Mercury Total	Molybdenum Total	Nickel Total	Potassium Total	Selenium Total	Silver Total	Sodium Total	Zinc Total
			µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L
SUR-922	7768 - 155 St.	15-Feb-23	77	<0.5	<0.5	2.5	<10	<0.2	1050	0.07	<0.5	2	54	<0.5	98	2.4	<0.05	<0.5	<0.5	121	<0.5	<0.5	10800	<3.0
		13-Sep-23	60	<0.5	<0.5	2.5	<10	<0.2	1000	0.05	<0.5	2.6	62	<0.5	82	3.8	<0.05	<0.5	<0.5	138	<0.5	<0.5	10100	<3.0
SUR-928	15349 - 57 Ave.	15-Feb-23	42	<0.5	<0.5	3.5	<10	<0.2	9460	0.1	<0.5	<0.5	6	<0.5	214	2.3	<0.05	<0.5	<0.5	179	<0.5	<0.5	2110	<3.0
		13-Sep-23	61	<0.5	<0.5	2.7	<10	<0.2	2640	0.12	<0.5	2.8	46	<0.5	104	4.2	<0.05	<0.5	<0.5	153	<0.5	<0.5	8540	3.2
SUR-931	124 St. & 24 Ave.	15-Feb-23	80	<0.5	<0.5	2.5	<10	<0.2	1380	0.08	<0.5	0.7	53	<0.5	91	1.8	<0.05	<0.5	<0.5	127	<0.5	<0.5	10900	4.5
		13-Sep-23	64	<0.5	<0.5	2.5	<10	<0.2	1220	0.07	<0.5	1.1	59	<0.5	76	4.0	<0.05	<0.5	<0.5	141	<0.5	<0.5	10300	<3.0
<sup>1</sup> Canadian Guideline Limit (ppb)			200	6	10	2000	5000	7	none	50	none	2000	300	5	none	120	1	none	none	none	50	none	200K	5000

<sup>1</sup>Guidelines for Canadian Drinking water Quality, Health Canada, Sept 2020

Analysis by Metro Vancouver Laboratory



**City of Surrey**  
**2023 Vinyl Chloride Results**


Sample Station ID	Sample Station Location	1st Half of 2023		2nd Half of 2023	
		Date Sampled	Vinyl Chloride µg/L	Date Sampled	Vinyl Chloride µg/L
SUR-901	92 Ave. & 180 St.	20-Jun-23	<1	5-Dec-23	<1
SUR-902	18995 - 87 A Ave.	21-Jun-23	<1	5-Dec-23	<1
SUR-928	15349 - 57 Ave.	22-Jun-23	<1	4-Dec-23	<1
SUR-930	SW Ent. to Pkwy, s. of 3031-139 St.	23-Jun-23	<1	4-Dec-23	<1

Analysis by Metro Vancouver Laboratory


2023 MV Laboratory Report - 901 (17988 93A ST)

Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
05-Jan	0.42	<1	<2	<1	7	0.30
10-Jan	0.41	<1	<2	<1	6	0.22
13-Jan	0.46	<1	<2	<1	7	0.24
19-Jan	0.51	<1	<2	<1	6	0.30
25-Jan	0.57	<1	<2	<1	7	0.22
31-Jan	0.51	<1	<2	<1	6	0.31
08-Feb	0.51	<1	<2	<1	6	0.25
16-Feb	0.47	<1	<2	<1	6	0.26
22-Feb	0.49	<1	NA	<1	5	0.25
25-Feb	0.52	<1	<2	<1	6	0.27
05-Mar	0.35	<1	<2	<1	6.2	0.22
07-Mar	0.44	<1	<2	<1	4.9	0.30
14-Mar	0.46	<1	<2	<1	6	0.23
17-Mar	0.51	<1	<2	<1	6.1	0.34
20-Mar	0.31	<1	<2	<1	6.5	0.33
21-Mar	0.45	<1	<2	<1	6.3	0.25
24-Mar	0.25	<1	<2	<1	6.9	0.24
28-Mar	0.47	<1	<2	<1	6.9	0.31
04-Apr	0.42	<1	<2	<1	7.3	0.27
14-Apr	0.19	<1	<2	<1	7.5	0.61
21-Apr	0.24	<1	<2	<1	7.8	0.37
26-Apr	0.20	<1	<2	<1	8.3	0.28
28-Apr	0.21	<1	<2	<1	8.3	0.33
01-May	0.22	<1	<2	<1	8.8	0.34
04-May	0.17	<1	<2	<1	9.1	0.30
05-May	0.21	<1	<2	<1	9.3	0.33
10-May	0.51	<1	<2	<1	8.9	0.36
12-May	0.29	<1	<2	<1	10	0.28
17-May	0.43	<1	2	<1	10.8	0.28
24-May	0.40	<1	2	<1	12	0.25
01-Jun	0.26	<1	2	<1	12.4	0.29
06-Jun	0.44	<1	<2	<1	12.7	0.38
09-Jun	0.20	<1	<2	<1	9.6	0.21
15-Jun	0.28	<1	<2	<1	13.2	0.23
16-Jun	0.31	<1	<2	<1	13.2	0.21
20-Jun	0.39	<1	2	<1	13.6	0.28
28-Jun	0.48	<1	<2	<1	13.1	0.19
30-Jun	0.30	<1	<2	<1	13.7	0.33
05-Jul	0.35	<1	<2	<1	14	0.23
12-Jul	0.49	<1	4	<1	14.6	0.17
18-Jul	0.27	<1	<2	<1	15.2	0.23
20-Jul	0.34	<1	<2	<1	15.6	0.27
24-Jul	0.39	<1	2	<1	16.1	0.30
27-Jul	0.46	<1	<2	<1	16.1	0.19
03-Aug	0.30	<1	<2	<1	16.2	0.22
04-Aug	0.29	<1	<2	<1	16.4	0.19
11-Aug	0.24	<1	12	<1	17.3	0.34
16-Aug	0.27	<1	2	<1	17	0.24
25-Aug	0.21	<1	4	<1	11.2	0.32
31-Aug	0.12	<1	2	<1	17.3	0.29
06-Sep	0.41	<1	2	<1	17.3	0.30
12-Sep	0.41	<1	<2	<1	17	0.23
16-Sep	0.51	<1	<2	<1	17	0.23
19-Sep	0.50	<1	LA	<1	16.3	0.39
28-Sep	0.45	<1	<2	<1	16	0.28
05-Oct	0.22	<1	2	<1	15.4	0.34
06-Oct	0.25	<1	<2	<1	15.2	0.41
12-Oct	0.34	<1	8	<1	14.8	0.26
13-Oct	0.22	<1	2	<1	15	0.28
19-Oct	0.38	<1	<2	<1	15	0.29

### 901 (17988 93A ST) - 2023 TEST RESULTS


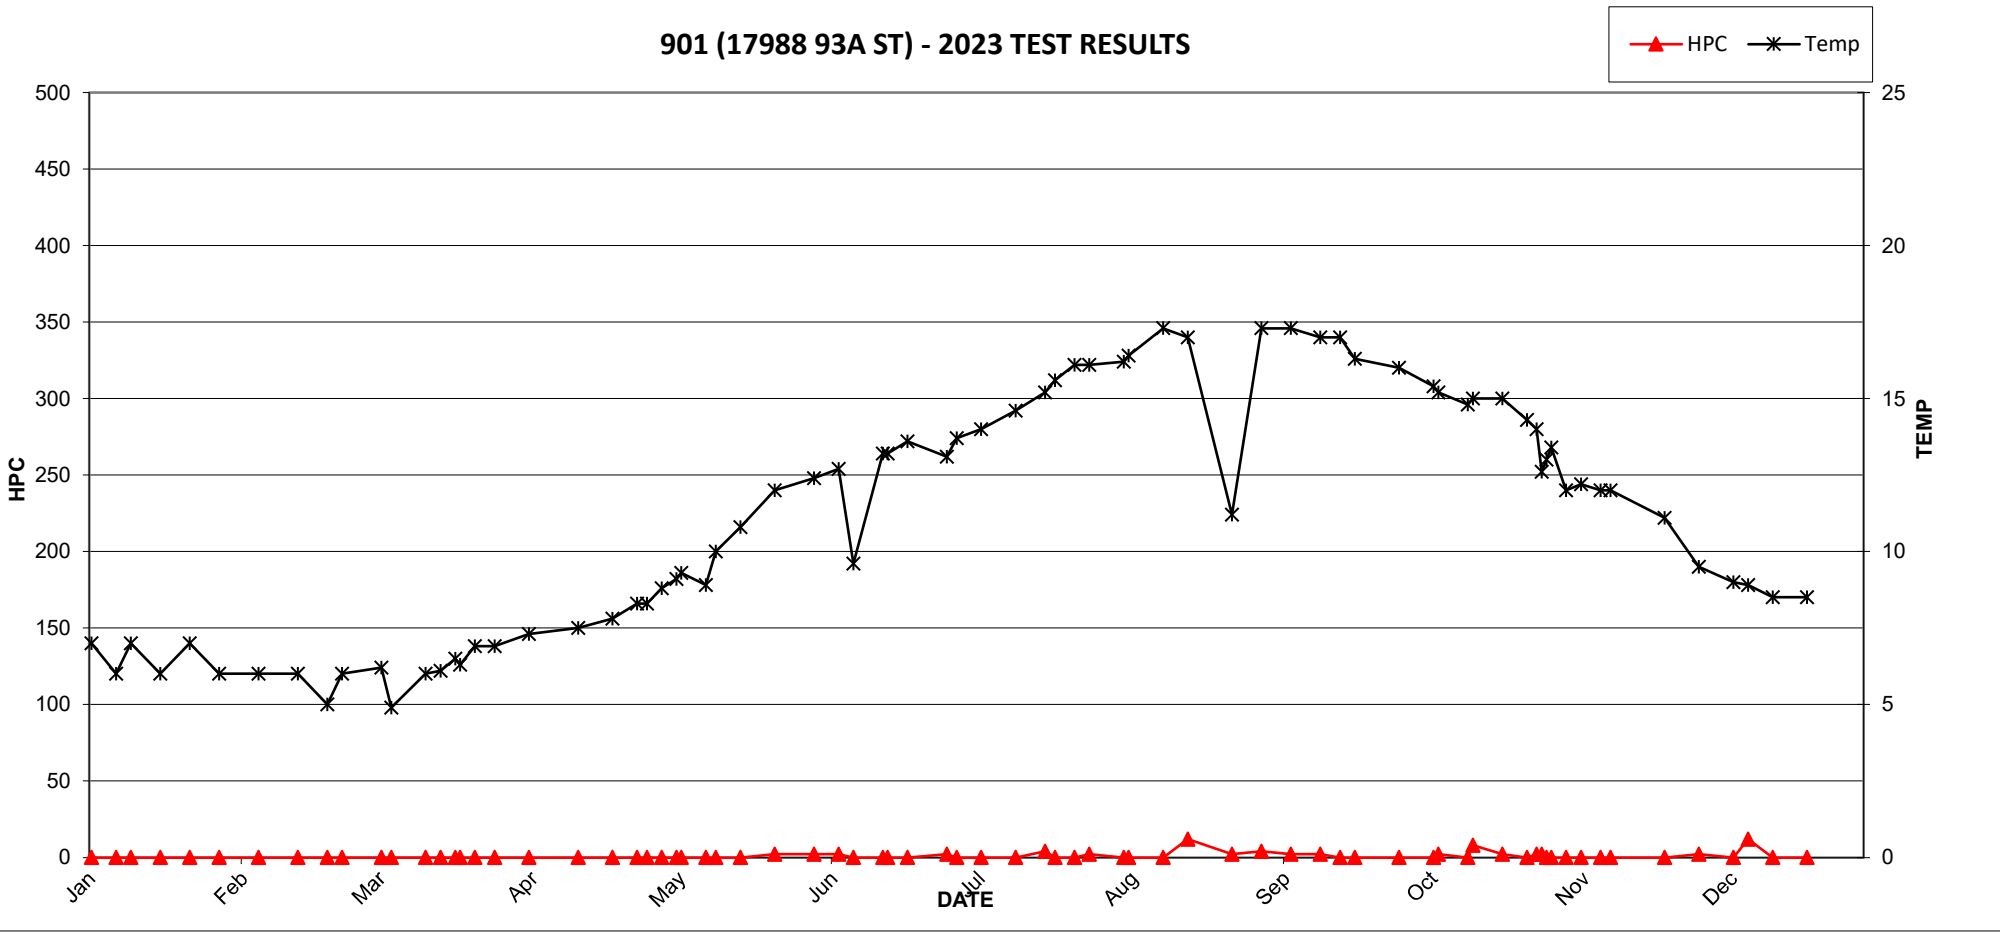


### 901 (17988 93A AVE) - 2023 TEST RESULTS

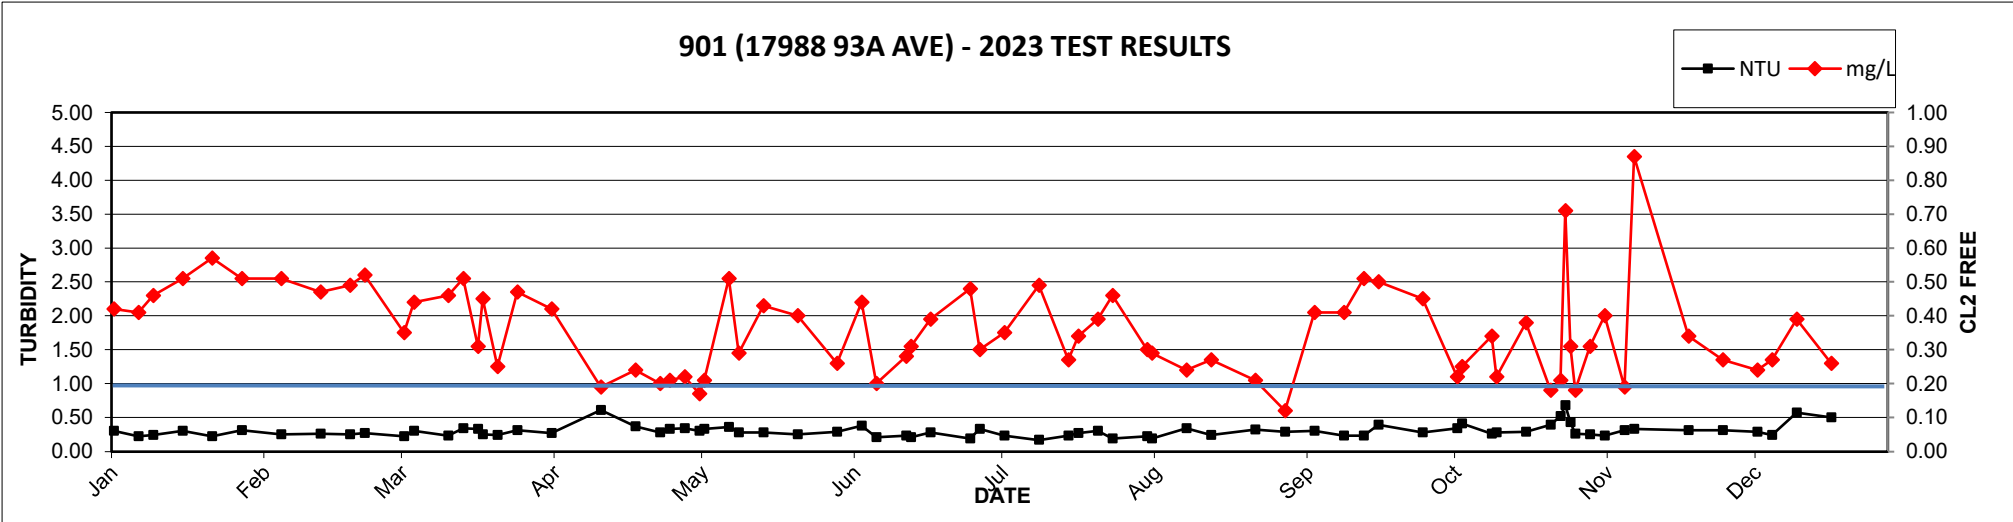



2023 MV Laboratory Report - 902 (18995 87A AVE)

Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
05-Jan	0.29	<1	<2	<1	7	0.29
10-Jan	0.31	<1	<2	<1	6	0.21
19-Jan	0.20	<1	<2	<1	6	0.26
25-Jan	0.16	<1	<2	<1	6	0.27
26-Jan	0.17	<1	<2	<1	6	0.34
31-Jan	0.23	<1	<2	<1	6	0.27
08-Feb	0.23	<1	<2	<1	6	0.26
16-Feb	0.27	<1	<2	<1	6	0.24
22-Feb	0.19	<1	<2	<1	6	0.36
25-Feb	0.15	<1	<2	<1	6	0.29
05-Mar	0.18	<1	<2	<1	5.1	0.23
07-Mar	0.21	<1	<2	<1	4.9	0.25
14-Mar	0.27	<1	<2	<1	5.3	0.23
17-Mar	0.18	<1	<2	<1	6	0.27
21-Mar	0.17	<1	2	<1	5.9	0.28
28-Mar	0.28	<1	<2	<1	6.8	0.34
04-Apr	0.27	<1	<2	<1	7.2	0.36
14-Apr	0.13	<1	6	<1	7.9	0.52
21-Apr	0.11	<1	10	<1	8.2	0.39
26-Apr	0.16	<1	38	<1	8.5	0.29
28-Apr	0.15	<1	14	<1	8.8	0.33
04-May	0.09	<1	<2	<1	10.2	0.60
05-May	0.18	<1	2	<1	10.3	0.35
10-May	0.19	<1	<2	<1	11	0.26
17-May	0.23	<1	<2	<1	12	0.46
24-May	0.15	<1	12	<1	14.3	0.24
01-Jun	0.17	<1	16	<1	14.3	0.34
06-Jun	0.21	<1	14	<1	14.9	0.24
15-Jun	0.20	<1	6	<1	15.3	0.25
20-Jun	0.18	<1	<2	<1	18.2	0.24
28-Jun	0.23	<1	2	<1	16.1	0.26
30-Jun	0.17	<1	16	<1	15.5	0.26
05-Jul	0.11	<1	24	<1	16.5	0.21
12-Jul	0.16	<1	16	<1	17.7	0.19
18-Jul	0.21	<1	6	<1	18.7	0.26
27-Jul	0.15	<1	<2	<1	18.1	0.28
03-Aug	0.12	<1	<2	<1	18	0.33
04-Aug	0.17	<1	<2	<1	18.4	0.21
11-Aug	0.13	<1	20	<1	18.7	0.36
16-Aug	0.12	<1	<2	<1	18.6	0.27
25-Aug	0.03	<1	<2	<1	19	0.34
31-Aug	0.12	<1	26	<1	19	0.25
06-Sep	0.20	<1	10	<1	18.4	0.39
12-Sep	0.19	<1	8	<1	18	0.23
15-Sep	0.22	<1	2	<1	17.7	0.35
19-Sep	0.23	<1	2	<1	16.9	0.23
28-Sep	0.23	<1	12	<1	17	0.27
05-Oct	0.14	<1	6	<1	15.7	0.27
12-Oct	0.25	<1	24	<1	15	0.31
13-Oct	0.14	<1	<2	<1	15	0.24
19-Oct	0.16	<1	2	<1	15.8	0.23
24-Oct	0.08	<1	34	<1	14.5	0.35
01-Nov	0.20	<1	6	<1	12.9	0.30
03-Nov	0.18	<1	<2	<1	12	0.40
10-Nov	0.18	<1	<2	<1	11.7	0.30
17-Nov	0.07	<1	<2	<1	10.5	0.31
21-Nov	0.17	<1	16	<1	9.4	0.37
28-Nov	0.23	<1	6	<1	7.3	0.34
05-Dec	0.17	<1	<2	<1	9.3	0.24
08-Dec	0.15	<1	<2	<1	8.2	0.20

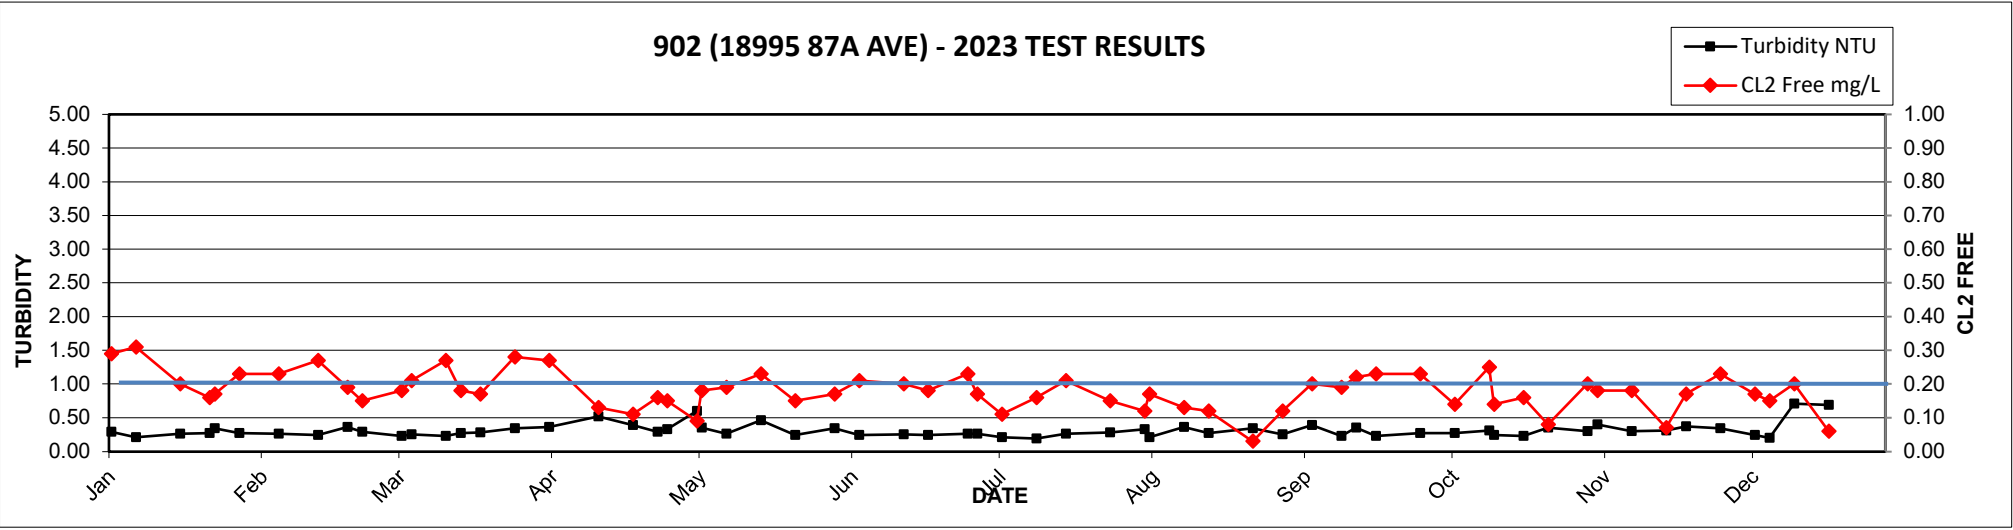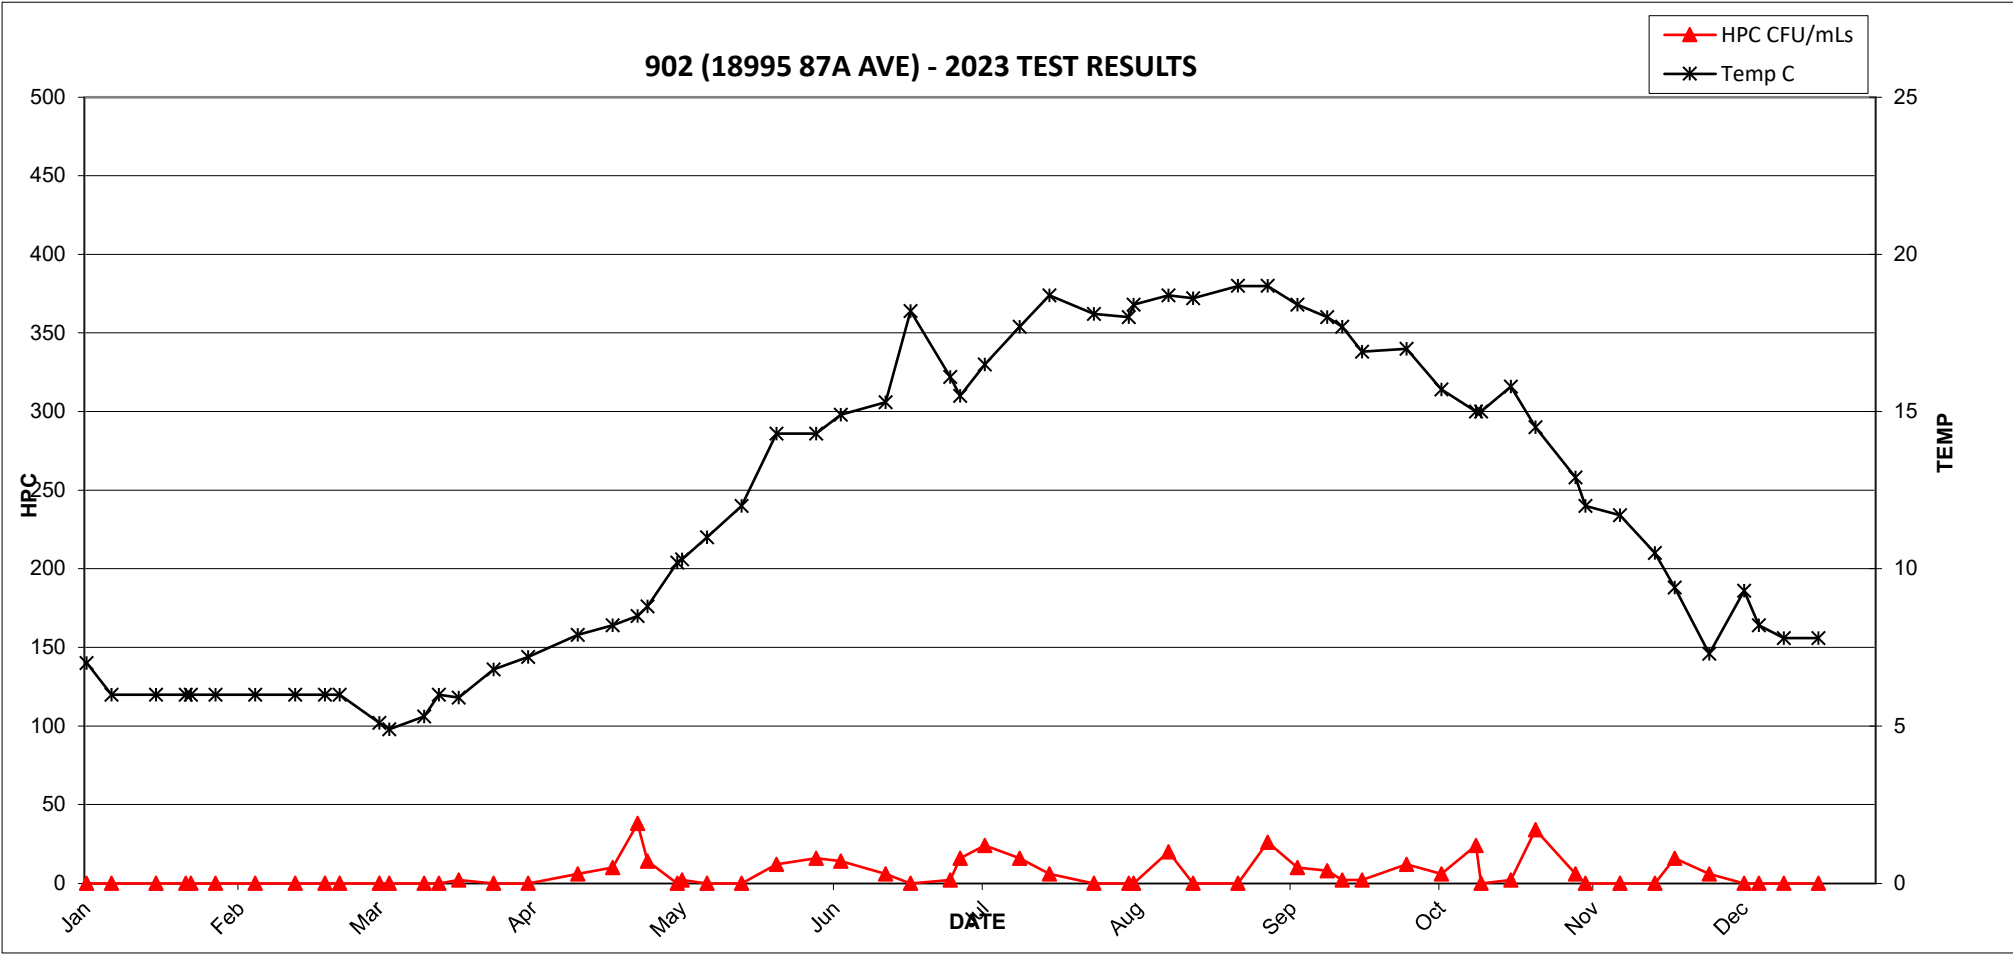

2023 MV Laboratory Report - 903 (19287 98A AVE)

Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
05-Jan	0.33	<1	<2	<1	7	0.37
10-Jan	0.37	<1	12	<1	6	0.29
19-Jan	0.19	<1	<2	<1	7	0.71
25-Jan	0.10	<1	4	<1	7	0.24
03-Feb	0.11	<1	<2	<1	6	0.30
09-Feb	0.24	<1	<2	<1	6	0.24
22-Feb	0.21	<1	<2	<1	7	0.44
25-Feb	0.46	<1	<2	<1	6	0.28
05-Mar	0.33	<1	<2	<1	5.8	0.25
07-Mar	0.39	<1	<2	<1	5.7	0.22
14-Mar	0.39	<1	<2	<1	6.9	0.28
17-Mar	0.43	<1	<2	<1	6.8	0.62
21-Mar	0.50	<1	2	<1	7	0.28
28-Mar	0.31	<1	<2	<1	8	0.26
04-Apr	0.23	<1	<2	<1	8.7	0.30
14-Apr	0.13	<1	32	<1	8.7	0.67
21-Apr	0.15	<1	<2	<1	8.7	0.48
28-Apr	0.08	<1	<2	<1	9.4	0.37
25-May	0.23	<1	2	<1	13.9	0.32
08-Jun	0.33	<1	<2	<1	14.7	0.25
10-Jun	0.29	<1	4	<1	15.7	0.19
15-Jun	0.25	<1	4	<1	14.6	0.25
29-Jun	0.21	<1	<2	<1	15.7	0.20
05-Jul	0.33	<1	<2	<1	15.3	0.32
12-Jul	0.41	<1	2	<1	18.2	0.23
18-Jul	0.16	<1	4	<1	18.1	0.46
27-Jul	0.31	<1	14	<1	19.5	0.26
03-Aug	0.22	<1	10	<1	18.3	0.23
11-Aug	0.24	<1	46	<1	19.2	0.33
16-Aug	0.09	<1	26	<1	19.2	0.23
25-Aug	0.15	<1	26	<1	19.9	0.37
31-Aug	0.11	<1	320	<1	20.6	0.28
06-Sep	0.23	<1	140	<1	19.3	0.31
15-Sep	0.24	<1	44	<1	18.8	0.33
16-Sep	0.22	<1	190	<1	18.5	0.21
19-Sep	0.33	<1	62	<1	19	0.36
28-Sep	0.25	<1	1000	<1	19	0.30
05-Oct	0.14	<1	920	<1	18.5	0.25
06-Oct	0.07	<1	420	<1	17.6	0.39
12-Oct	0.37	<1	1400	<1	13.9	0.30
13-Oct	0.10	<1	460	<1	17.4	0.25
19-Oct	0.17	<1	2000	<1	17	0.25
24-Oct	0.11	<1	1900	<1	16.5	0.37
03-Nov	0.12	<1	120	<1	14.2	0.26
10-Nov	0.17	<1	6	<1	12.3	0.36
17-Nov	0.12	<1	650	<1	12.6	0.37
21-Nov	0.11	<1	160	<1	12.3	0.32
02-Dec	0.09	<1	340	<1	10.4	0.23
05-Dec	0.19	<1	860	<1	10.3	0.27
08-Dec	0.10	<1	100	<1	10.5	0.30
13-Dec	0.10	<1	150	<1	9.9	0.33
20-Dec	0.08	<1	NA	<1	10	0.61

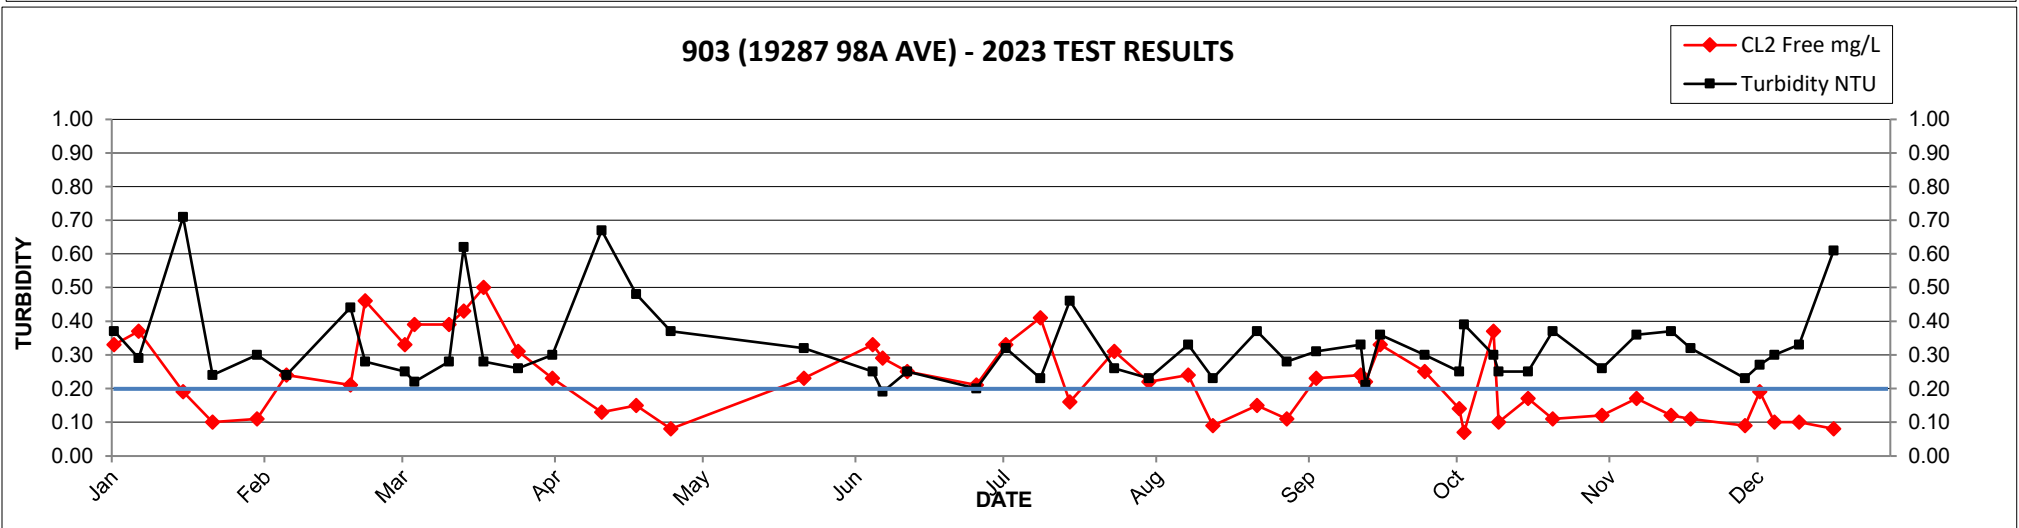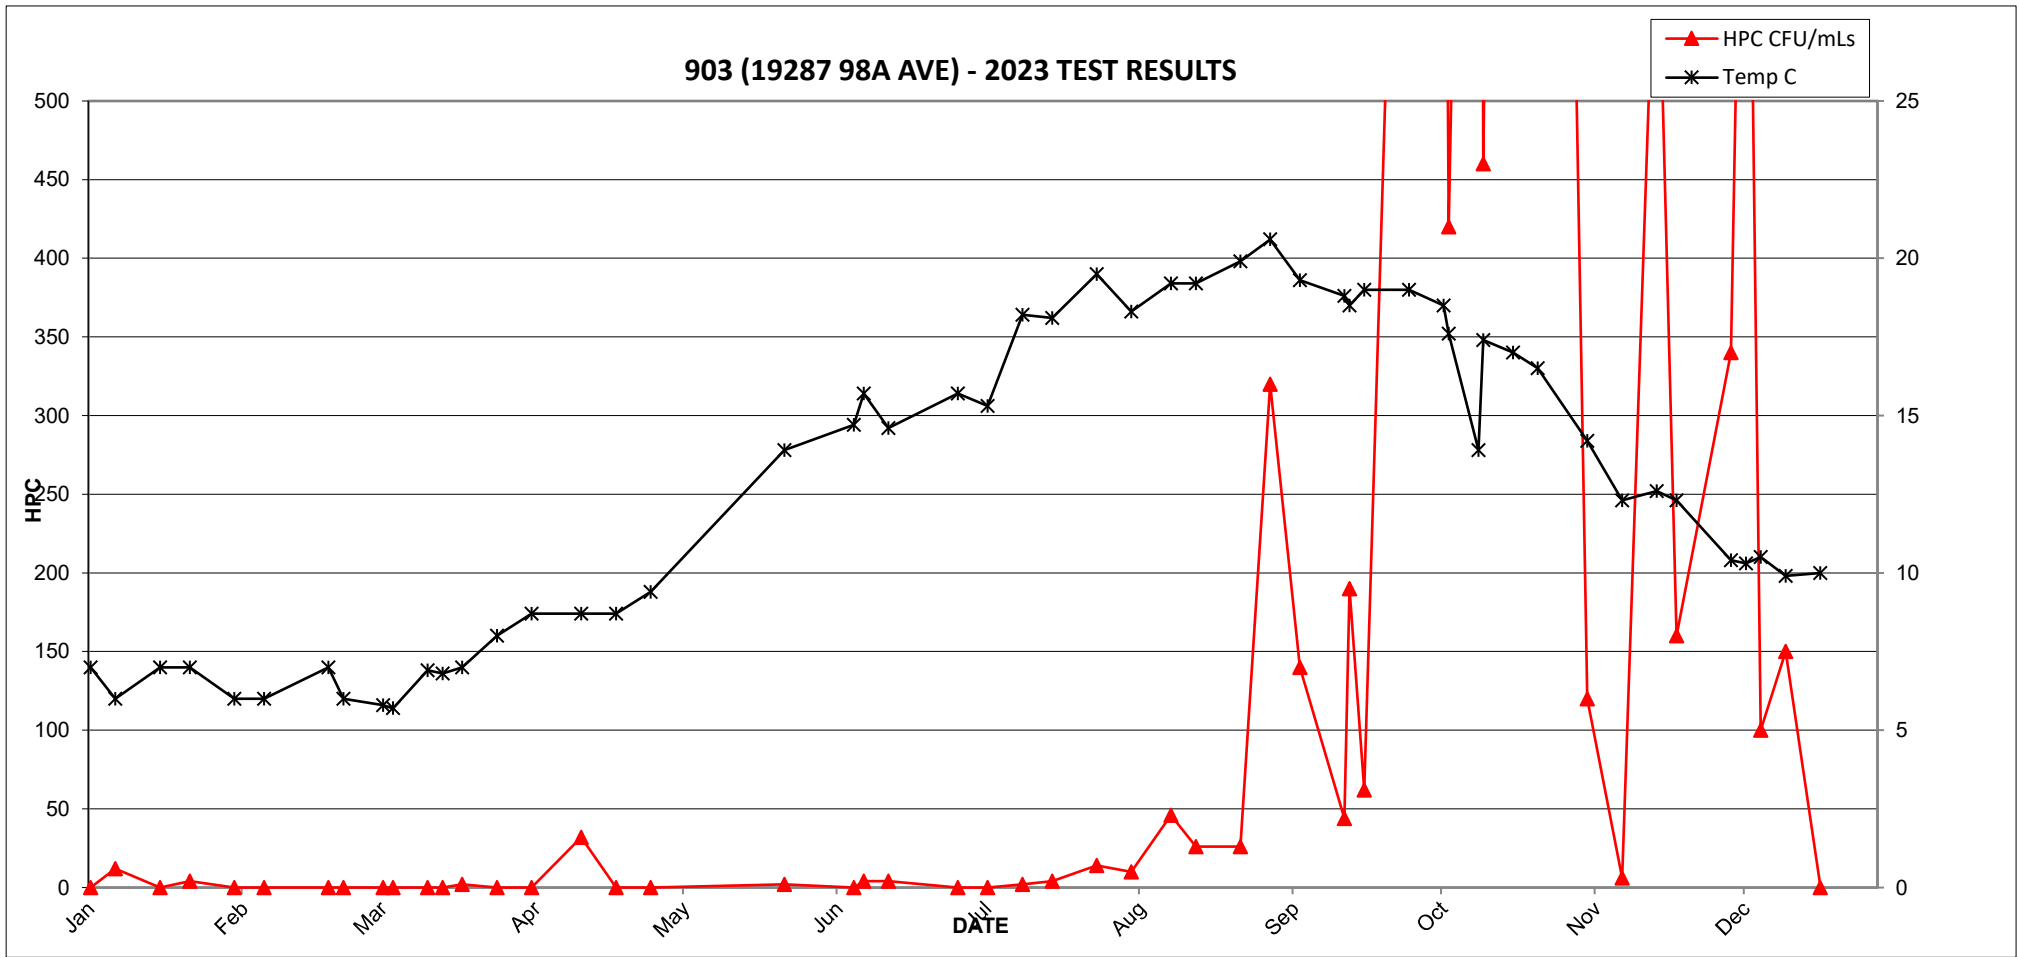


**2023 MV Laboratory Report - 904 (17815 TRIGGS RD)**


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
05-Jan	0.69	<1	<2	<1	6	0.25
10-Jan	0.67	<1	<2	<1	6	0.30
19-Jan	0.69	<1	<2	<1	6	0.27
25-Jan	0.64	<1	<2	<1	6	0.26
03-Feb	0.68	<1	2	<1	6	0.29
09-Feb	0.69	<1	<2	<1	6	0.82
16-Feb	0.69	<1	<2	<1	6	0.27
24-Feb	0.70	<1	<2	<1	3	0.29
25-Feb	0.65	<1	<2	<1	5	0.67
05-Mar	0.52	<1	<2	<1	6.1	0.23
07-Mar	0.61	<1	<2	<1	4.7	0.73
14-Mar	0.71	<1	<2	<1	5.8	0.25
17-Mar	0.82	<1	2	<1	6	0.48
21-Mar	0.67	<1	2	<1	6.3	0.23
28-Mar	0.64	<1	<2	<1	6.8	0.34
04-Apr	0.72	<1	<2	<1	6.3	0.27
14-Apr	0.83	<1	<2	<1	6.9	1.30
21-Apr	0.52	<1	<2	<1	7.2	0.53
28-Apr	0.56	<1	<2	<1	7.6	0.36
04-May	0.65	<1	<2	<1	8	0.46
10-May	0.73	<1	<2	<1	8.7	0.58
17-May	0.65	<1	<2	<1	9.4	0.28
24-May	0.64	<1	8	<1	10.7	0.28
01-Jun	0.65	<1	<2	<1	10.7	0.39
06-Jun	0.54	<1	<2	<1	11.1	0.25
14-Jun	0.73	<1	2	<1	11.6	0.23
15-Jun	0.46	<1	4	<1	11.8	0.29
20-Jun	0.53	<1	<2	<1	12.3	0.38
29-Jun	0.62	<1	<2	<1	13.4	0.20
05-Jul	0.58	<1	<2	<1	13.3	0.72
12-Jul	0.61	<1	2	<1	14.4	0.21
18-Jul	0.53	<1	<2	<1	14.1	0.33
27-Jul	0.57	<1	<2	<1	15.3	0.31
03-Aug	0.52	<1	2	<1	15.8	0.32
11-Aug	0.60	<1	<2	<1	16.7	0.42
16-Aug	0.44	<1	<2	<1	17.1	0.32
25-Aug	0.63	<1	2	<1	17.5	0.44
31-Aug	0.55	<1	<2	<1	16.4	0.24
06-Sep	0.61	<1	<2	<1	17.1	0.26
12-Sep	0.80	<1	4	<1	17.1	0.28
15-Sep	0.53	<1	2	<1	17.2	0.29
19-Sep	0.60	<1	<2	<1	16.9	0.54
28-Sep	0.59	<1	<2	<1	16	0.38
05-Oct	0.38	<1	<2	<1	15.3	0.27
12-Oct	0.67	<1	4	<1	14.7	0.35
13-Oct	0.59	<1	<2	<1	14.6	0.32
19-Oct	0.60	<1	2	<1	14	0.26
26-Oct	0.69	<1	<2	<1	13.2	0.47
03-Nov	0.61	<1	<2	<1	11.8	0.30
10-Nov	0.31	<1	2	<1	11.1	0.34
17-Nov	0.42	<1	2	<1	9.8	0.32
21-Nov	0.60	<1	2	<1	9.4	0.31
02-Dec	0.56	<1	<2	<1	8.3	0.23



### 904 (17815 TRIGGS RD) 2023 TEST RESULTS


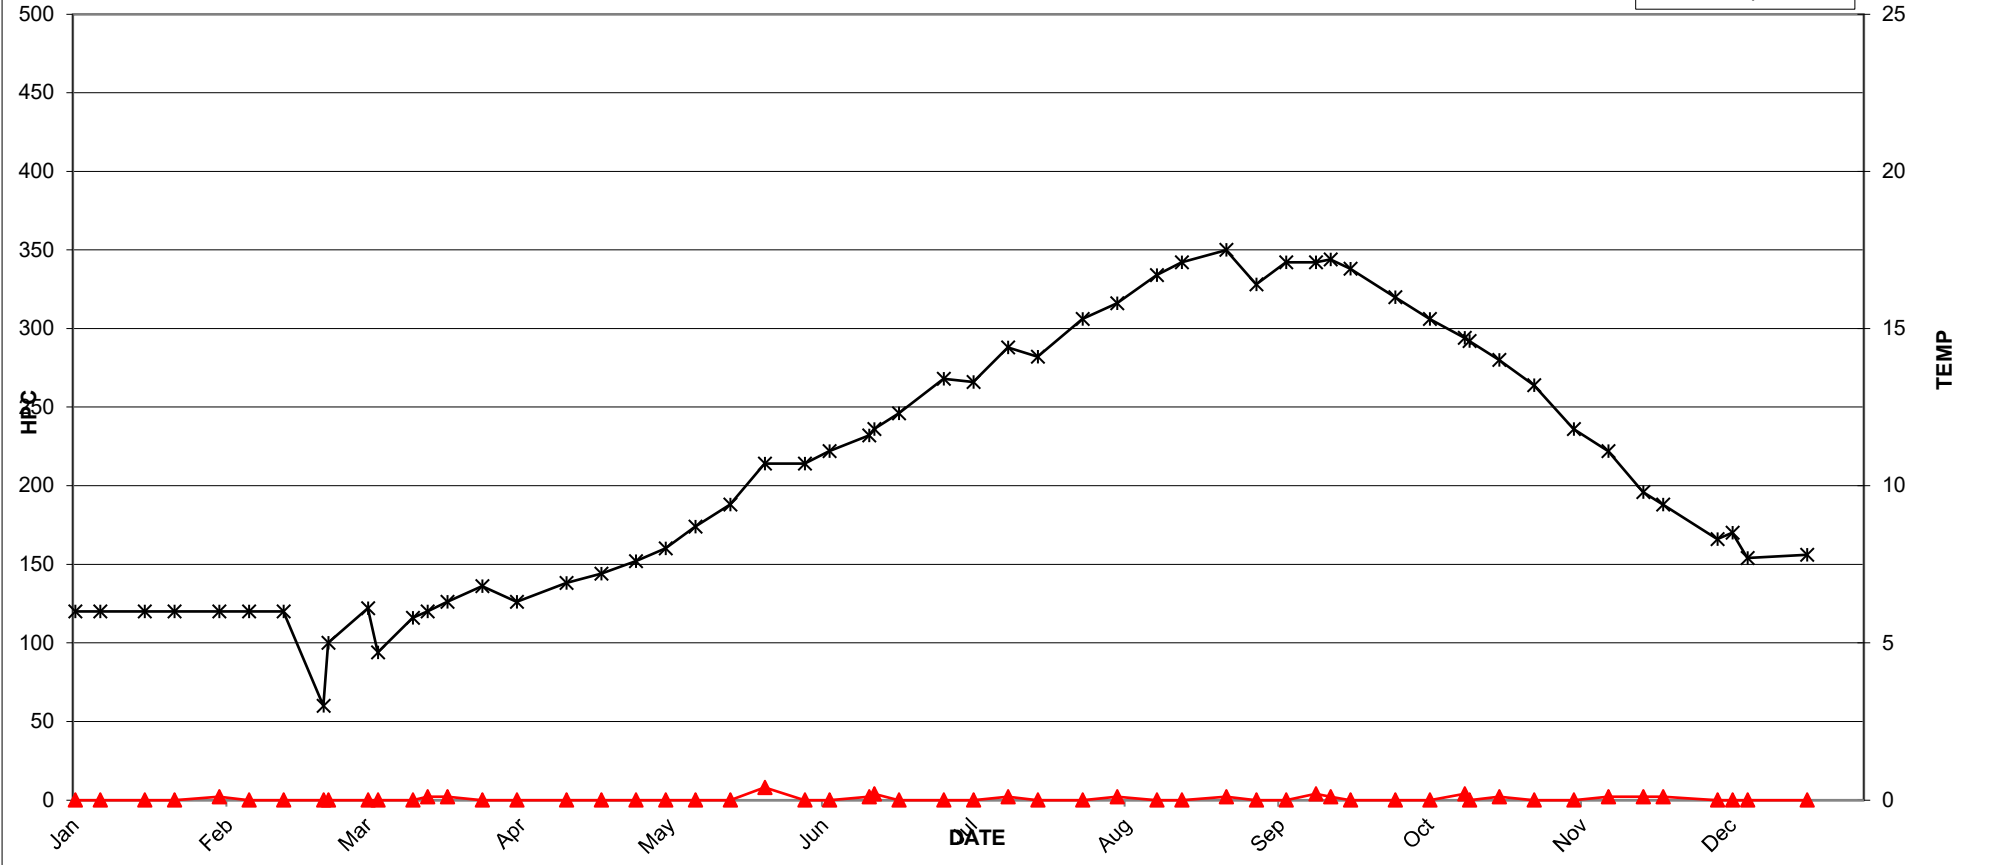


### 904 (17815 TRIGGS RD) - 2023 TEST RESULTS

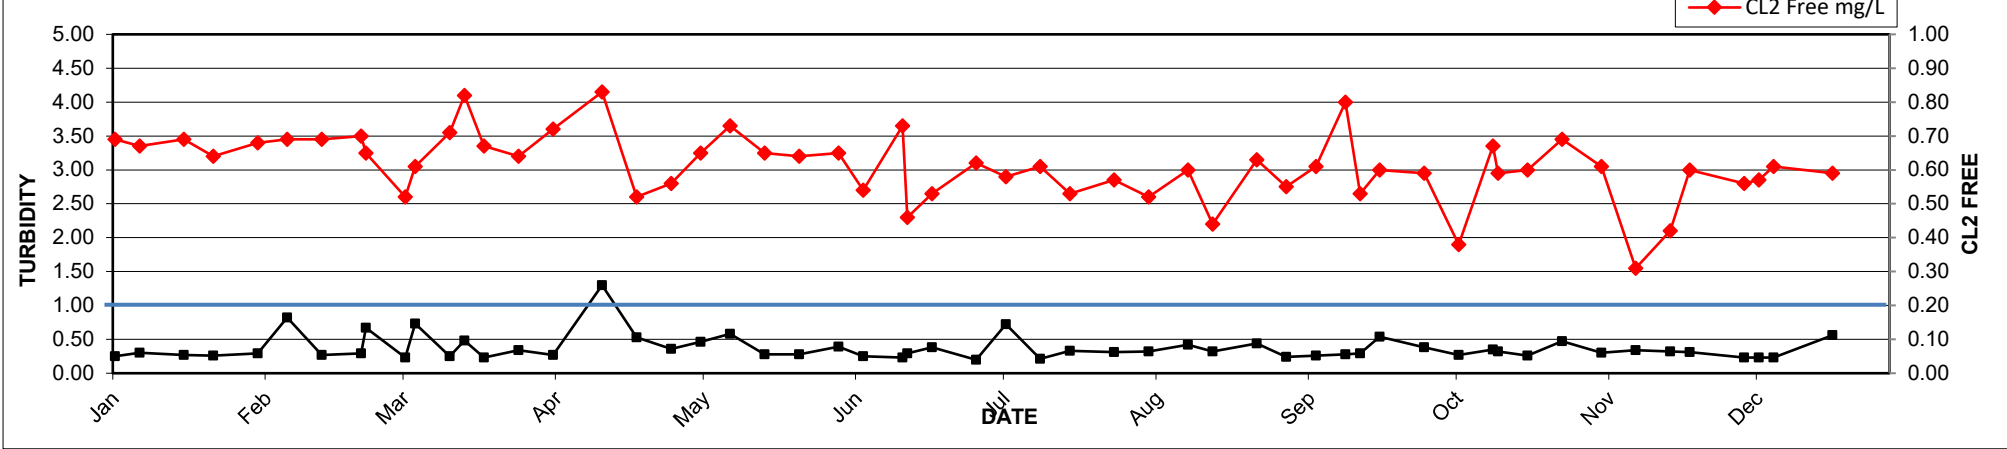



**2023 MV Laboratory Report - 905 (17052 102AVE)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
05-Jan	0.24	<1	<2	<1	7	0.32
10-Jan	0.26	<1	26	<1	6	0.21
13-Jan	0.24	<1	2	<1	8	0.25
19-Jan	0.27	<1	2	<1	6	0.38
25-Jan	0.17	<1	<2	<1	7	0.26
27-Jan	0.27	<1	<2	<1	8	0.41
30-Jan	0.25	<1	<2	<1	7	0.23
01-Feb	0.21	<1	<2	<1	7	0.24
09-Feb	0.23	<1	<2	<1	6	0.31
16-Feb	0.34	<1	<2	<1	6	0.26
23-Feb	0.23	<1	<2	<1	7	0.31
25-Feb	0.19	<1	<2	<1	7	0.29
05-Mar	0.19	<1	<2	<1	6.8	0.21
07-Mar	0.21	<1	<2	<1	5	0.22
14-Mar	0.23	<1	<2	<1	6.4	0.23
17-Mar	0.25	<1	<2	<1	6.9	0.37
20-Mar	0.35	<1	<2	<1	7.4	0.32
21-Mar	0.27	<1	2	<1	6.9	0.25
28-Mar	0.29	<1	<2	<1	7.7	0.32
04-Apr	0.31	<1	<2	<1	7.8	0.26
05-Apr	0.25	<1	<2	<1	8.4	0.32
14-Apr	0.23	<1	<2	<1	8.2	0.57
21-Apr	0.21	<1	<2	<1	8.4	0.42
26-Apr	0.20	<1	<2	<1	8.8	0.28
28-Apr	0.18	<1	<2	<1	8.7	0.38
01-May	0.20	<1	<2	<1	9.2	0.42
04-May	0.19	<1	<2	<1	9.4	0.32
05-May	0.23	<1	<2	<1	9.8	0.33
10-May	0.17	<1	<2	<1	11.9	0.41
12-May	0.20	<1	<2	<1	10.3	0.28
17-May	0.29	<1	2	<1	10.9	0.37
24-May	0.21	<1	4	<1	11.8	0.24
01-Jun	0.24	<1	18	<1	12.8	0.28
06-Jun	0.20	<1	4	<1	16.1	0.26
09-Jun	0.13	<1	<2	<1	13.3	0.22
14-Jun	0.32	<1	10	<1	13.6	0.22
15-Jun	0.24	<1	<2	<1	13.7	0.32
20-Jun	0.21	<1	4	<1	13.9	0.24
23-Jun	0.15	<1	<2	<1	13.6	0.33
29-Jun	0.29	<1	10	<1	16.5	0.23
29-Jun	0.07	<1	<2	<1	14	0.26
05-Jul	0.14	<1	18	<1	14.7	0.20
12-Jul	0.21	<1	8	<1	15.5	0.20
18-Jul	0.17	<1	8	<1	16	0.42
20-Jul	0.23	<1	12	<1	16.2	0.24
27-Jul	0.22	<1	10	<1	17.1	0.19
03-Aug	0.15	<1	20	<1	17.1	0.46
04-Aug	0.14	<1	10	<1	17.2	0.23
11-Aug	0.13	<1	16	<1	18	0.25
16-Aug	0.10	<1	50	<1	18	0.47
25-Aug	0.07	<1	18	<1	18.4	0.27
31-Aug	0.05	<1	20	<1	18.4	0.23
06-Sep	0.19	<1	24	<1	18.1	0.27
12-Sep	0.15	<1	20	<1	18	0.22

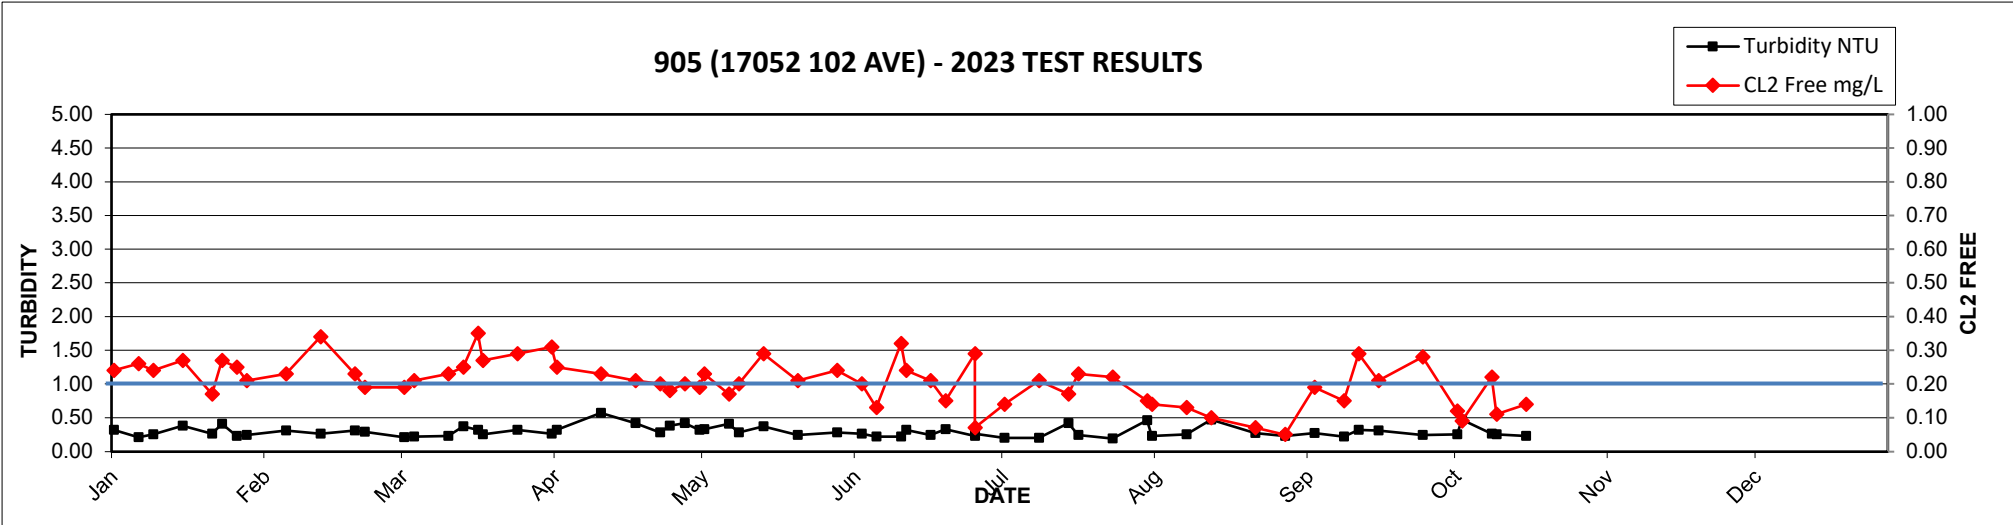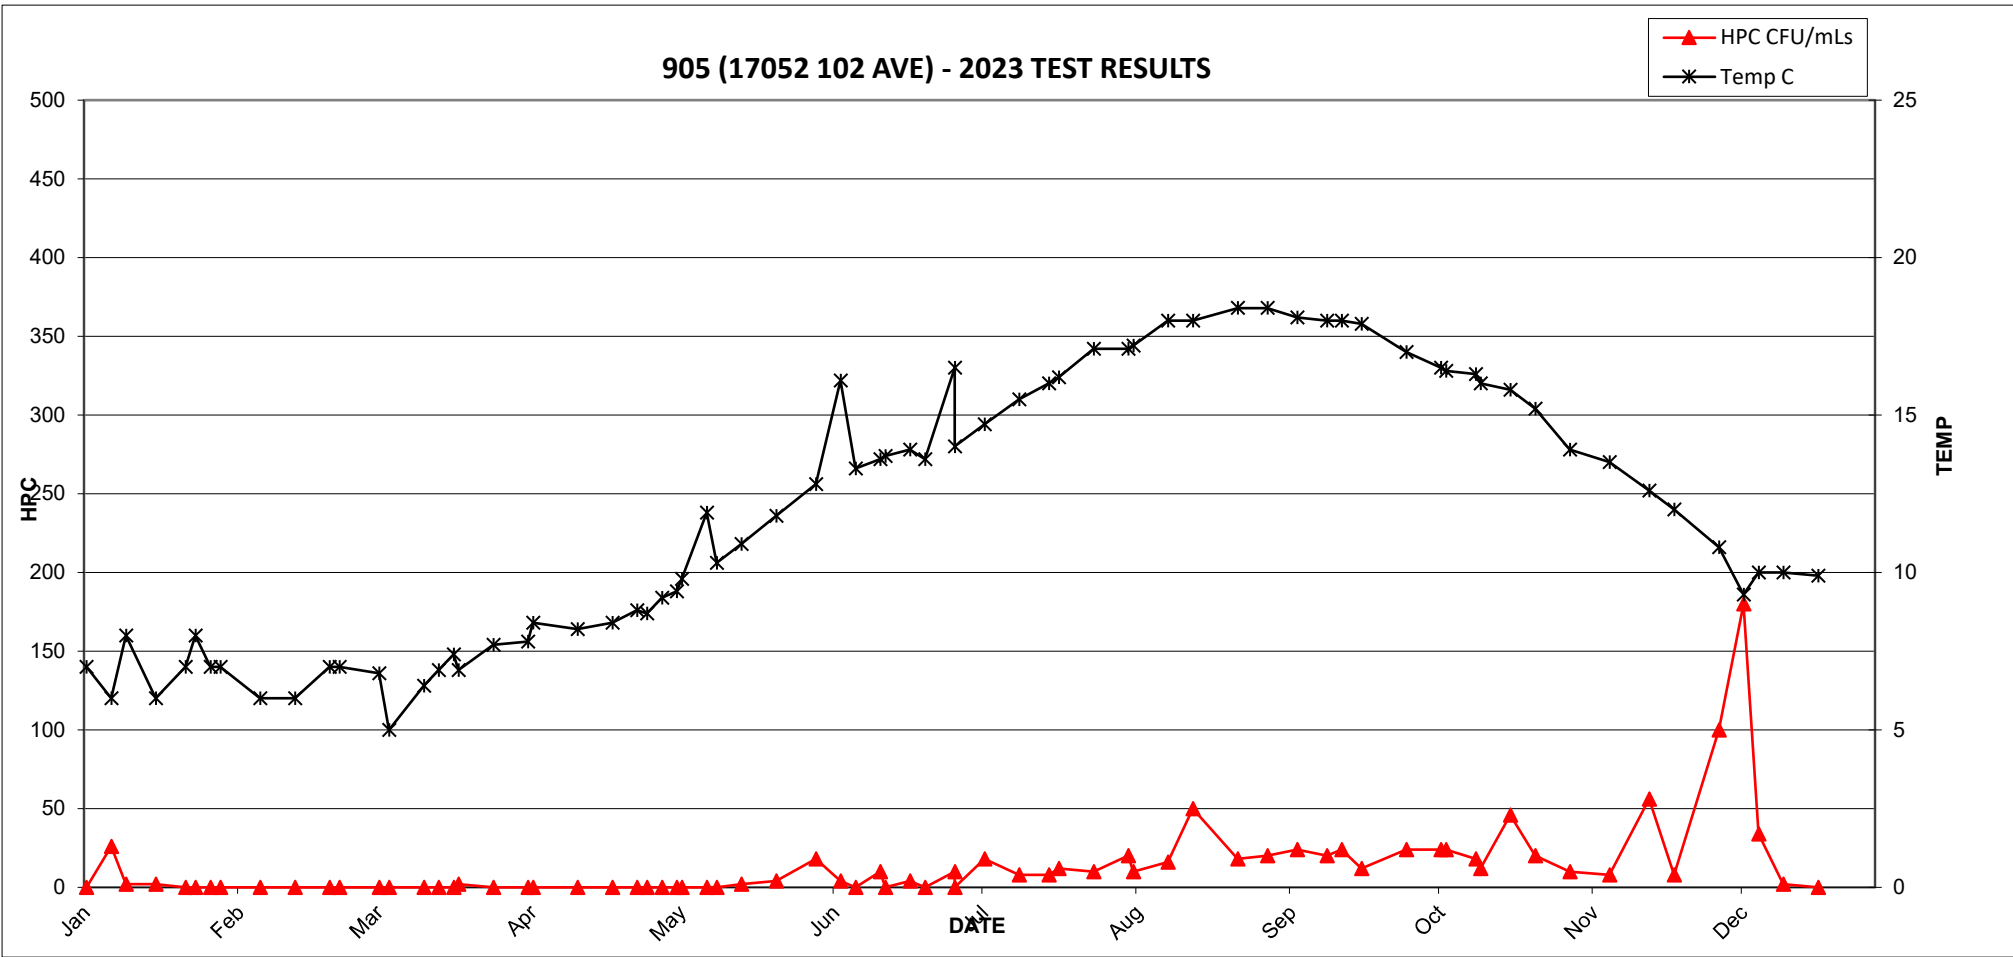

**2023 MV Laboratory Report - 906 (10184 161ST)**


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.33	<1	<2	<1	6	0.37
12-Jan	0.32	<1	<2	<1	7	0.33
13-Jan	0.26	<1	2	<1	7	0.26
18-Jan	0.23	<1	<2	<1	7	0.27
26-Jan	0.22	<1	<2	<1	7	0.41
08-Feb	0.26	<1	<2	<1	6	0.26
15-Feb	0.42	<1	<2	<1	6	0.28
23-Feb	0.32	<1	<2	<1	6	0.32
25-Feb	0.37	<1	2	<1	5	0.29
11-Mar	0.32	<1	<2	<1	5.8	0.26
15-Mar	0.28	<1	<2	<1	6.3	0.31
17-Mar	0.28	<1	<2	<1	6.4	0.45
20-Mar	0.37	<1	<2	<1	7.1	0.28
21-Mar	0.36	<1	<2	<1	7	0.26
27-Mar	0.40	<1	2	<1	7.3	0.35
06-Apr	0.22	<1	<2	<1	7.1	0.35
12-Apr	0.33	<1	2	<1	8	0.50
20-Apr	0.36	<1	8	<1	7.8	0.38
26-Apr	0.29	<1	<2	<1	8.3	0.31
02-May	0.28	<1	<2	<1	9.5	0.32
10-May	0.24	<1	<2	<1	9.9	0.38
12-May	0.14	<1	2	<1	10.2	0.48
16-May	0.27	<1	<2	<1	11	0.41
25-May	0.25	<1	<2	<1	12.7	0.35
31-May	0.24	<1	2	<1	12.4	0.26
08-Jun	0.30	<1	<2	<1	13.1	0.49
09-Jun	0.17	<1	2	<1	13.5	0.23
12-Jun	0.55	<1	26	<1	14.1	0.24
20-Jun	0.21	<1	<2	<1	13.9	0.43
23-Jun	0.26	<1	2	<1	13.4	0.29
28-Jun	0.27	<1	8	<1	14	0.27
29-Jun	0.21	<1	4	<1	13.8	0.23
06-Jul	0.27	<1	<2	<1	13.4	0.29
11-Jul	0.23	<1	4	<1	15.2	0.23
18-Jul	0.22	<1	14	<1	16.5	0.29
24-Jul	0.23	<1	34	<1	17.5	0.45
01-Aug	0.37	<1	26	<1	16	0.31
10-Aug	0.15	<1	54	<1	18	0.21
17-Aug	0.15	<1	62	18.4	8.1	<1
24-Aug	0.17	<1	20	<1	18.6	0.35
30-Aug	0.17	<1	10	<1	18.5	0.23
06-Sep	0.19	<1	42	<1	18.2	0.31
13-Sep	0.44	<1	10	<1	18	0.25
22-Sep	0.16	<1	14	<1	17.6	0.38
27-Sep	0.20	<1	12	<1	17.2	0.27
03-Oct	0.33	<1	36	<1	16	0.28
11-Oct	0.16	<1	14	<1	16	0.28
16-Oct	0.41	<1	34	<1	14.9	0.27
17-Oct	0.13	<1	<2	<1	15.3	0.22
19-Oct	0.08	<1	4	<1	15.1	0.32
23-Oct	0.06	<1	6	<1	14.6	0.37
26-Oct	0.12	<1	2	<1	14.1	0.45
08-Nov	0.13	<1	4	<1	12.3	0.43

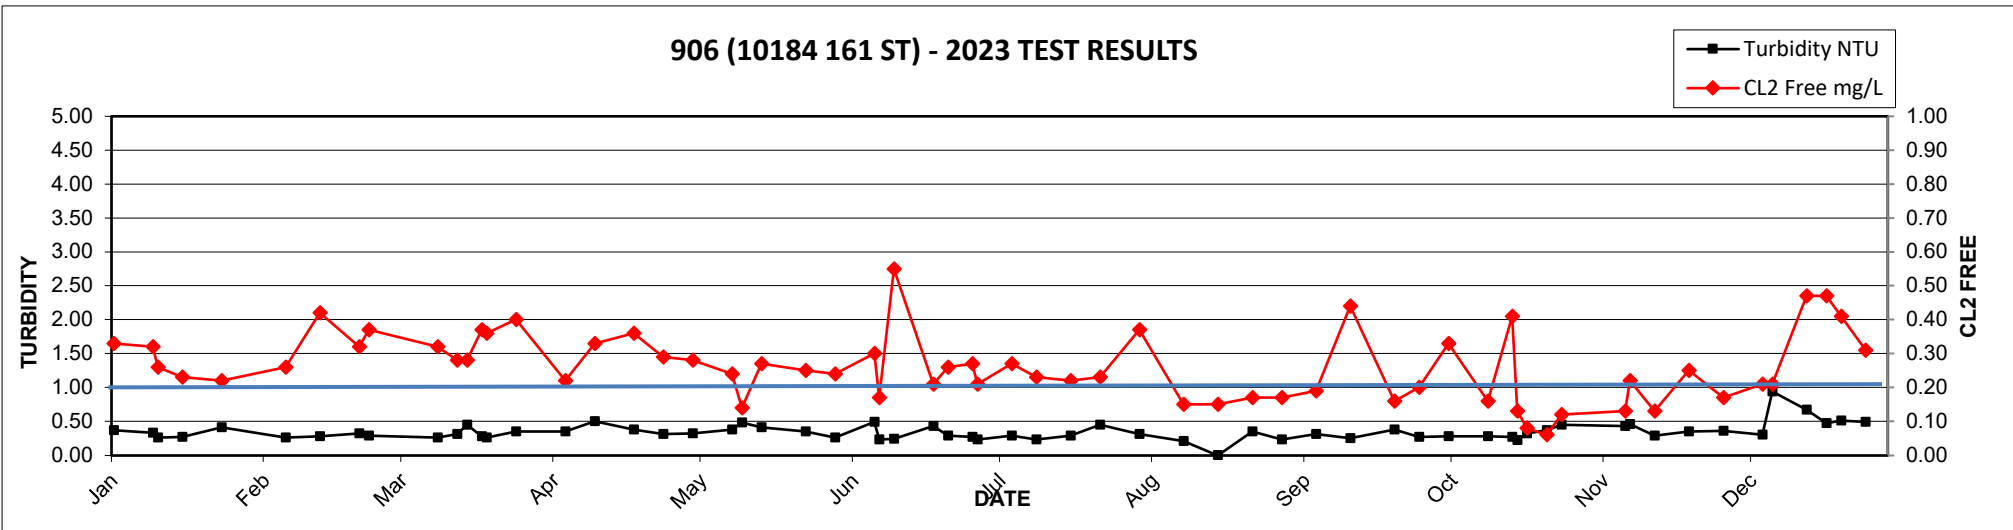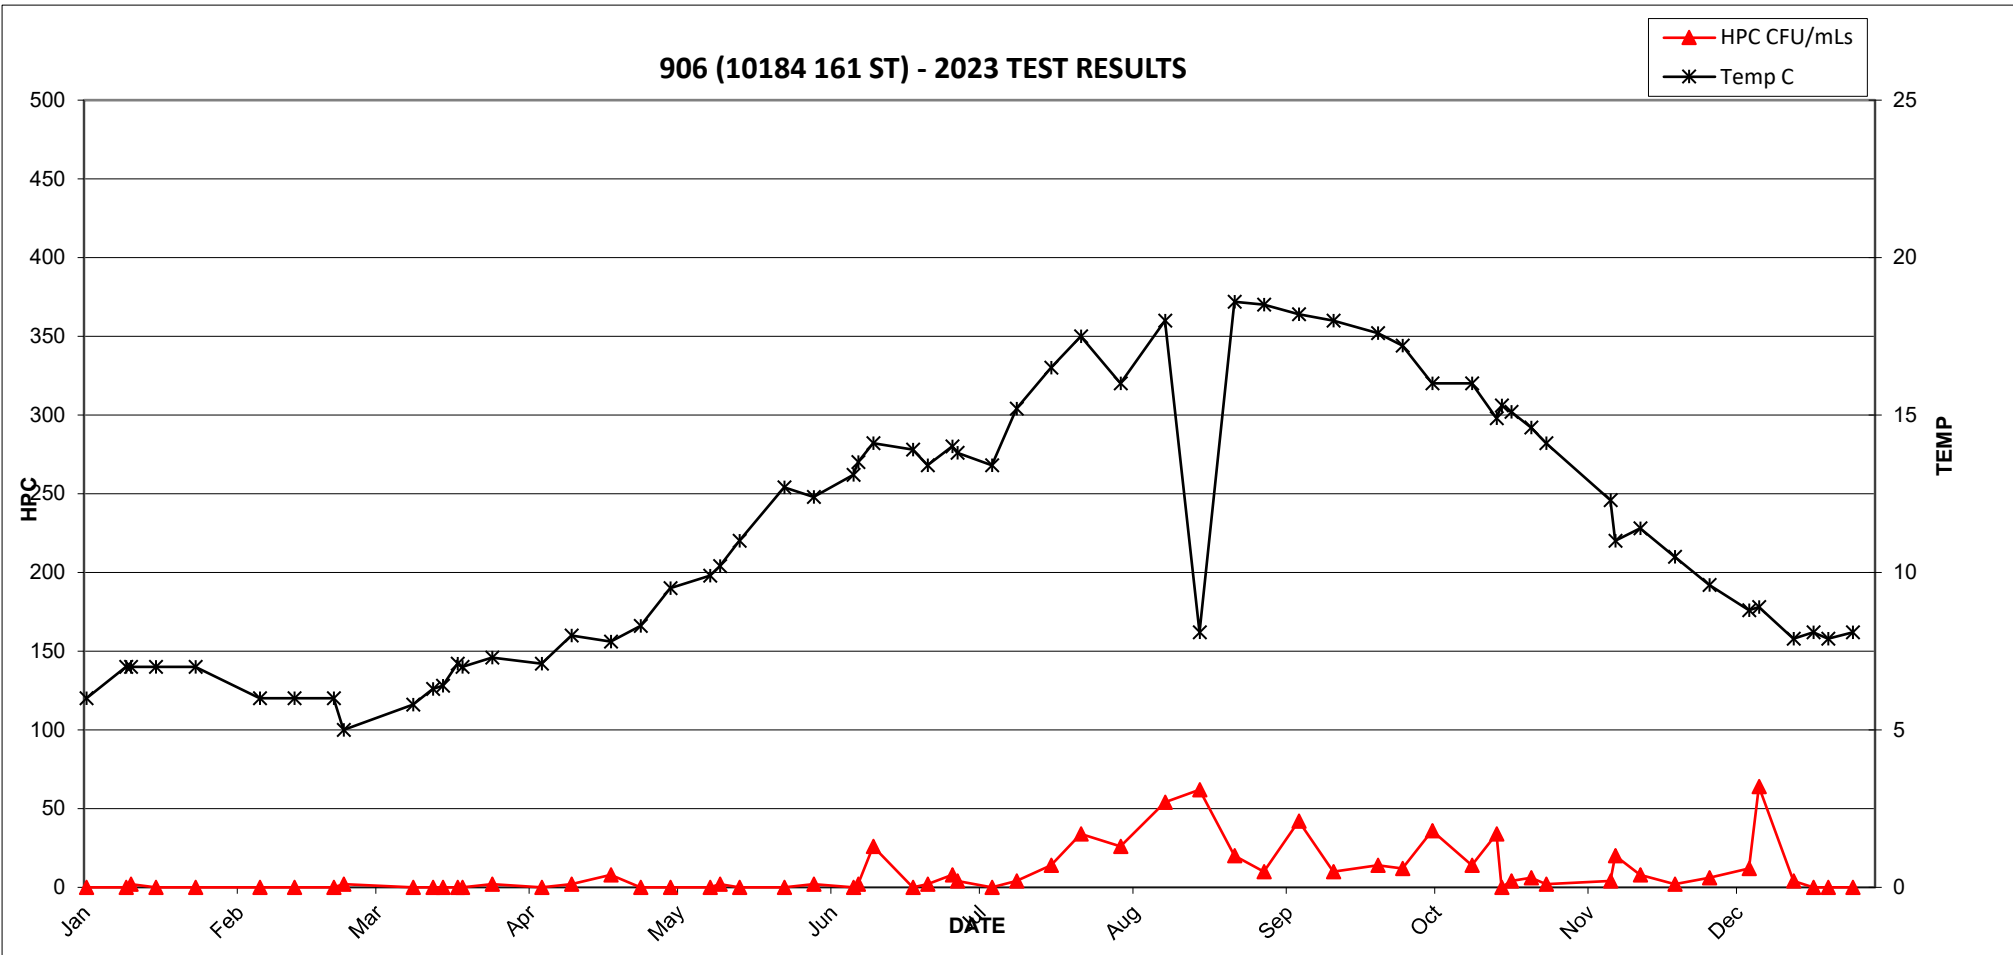


**2023 MV Laboratory Report - 907 (10796 155A ST)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
05-Jan	0.41	<1	<2	<1	6	0.34
10-Jan	0.36	<1	<2	<1	6	0.25
13-Jan	0.40	<1	<2	<1	6	0.25
19-Jan	0.51	<1	<2	<1	5	0.30
25-Jan	0.51	<1	<2	<1	6	0.23
27-Jan	0.38	<1	<2	<1	7	0.31
30-Jan	0.37	<1	2	<1	6	0.28
01-Feb	0.54	<1	<2	<1	5	0.31
09-Feb	0.59	<1	<2	<1	6	0.70
16-Feb	0.37	<1	<2	<1	6	0.29
05-Mar	0.45	<1	<2	<1	5.1	0.22
07-Mar	0.39	<1	<2	<1	5.3	0.25
14-Mar	0.47	<1	4	<1	5.8	0.27
17-Mar	0.48	<1	<2	<1	6	0.40
20-Mar	0.33	<1	<2	<1	6.5	0.29
21-Mar	0.42	<1	<2	<1	6.5	0.27
24-Mar	0.40	<1	<2	<1	7	0.33
28-Mar	0.56	<1	<2	<1	7.3	0.41
04-Apr	0.69	<1	LA	<1	7	0.29
05-Apr	0.27	<1	<2	<1	7.2	0.32
14-Apr	0.41	<1	<2	<1	7.2	0.73
21-Apr	0.35	<1	<2	<1	7.5	0.47
26-Apr	0.62	<1	2	<1	7.9	0.33
28-Apr	0.29	<1	<2	<1	7.8	0.37
01-May	0.49	<1	2	<1	8.2	0.40
02-May	0.37	<1	<2	<1	9.1	0.36
04-May	0.39	<1	<2	<1	8.4	0.45
08-May	0.34	<1	<2	<1	9	0.38
10-May	0.49	<1	<2	<1	8.6	0.33
17-May	0.57	<1	<2	<1	9.8	0.29
24-May	0.51	<1	<2	<1	10.9	0.29
01-Jun	0.51	<1	4	<1	10.9	0.35
06-Jun	0.54	<1	<2	<1	11.7	0.37
09-Jun	0.27	<1	<2	<1	9.8	0.23
14-Jun	0.67	<1	<2	<1	12.3	0.27
15-Jun	0.35	<1	6	<1	12.4	0.31
20-Jun	0.27	<1	<2	<1	12.5	0.30
23-Jun	0.40	<1	LA	<1	12	0.38
29-Jun	0.39	<1	<2	<1	12.5	0.23
29-Jun	0.63	<1	<2	<1	12.5	0.20
05-Jul	0.33	<1	2	<1	13.3	0.32
11-Jul	0.35	<1	<2	<1	14.5	0.34
12-Jul	0.33	<1	6	<1	14.5	0.33
18-Jul	0.21	<1	<2	<1	15	0.41
20-Jul	0.30	<1	<2	<1	15.4	0.37
27-Jul	0.32	<1	<2	<1	16	0.27
01-Aug	0.56	<1	<2	<1	16.2	0.65
03-Aug	0.32	<1	2	<1	16.4	0.36
04-Aug	0.18	<1	<2	<1	16.4	0.21
12-Aug	0.20	<1	6	<1	17.2	0.25
16-Aug	0.18	<1	4	<1	17.5	0.28
25-Aug	0.13	<1	<2	<1	17.8	0.37
31-Aug	0.18	<1	<2	<1	17.8	0.24
06-Sep	0.49	<1	24	<1	17.3	0.31

907 (10796 155A ST) - 2023 TEST RESULTS

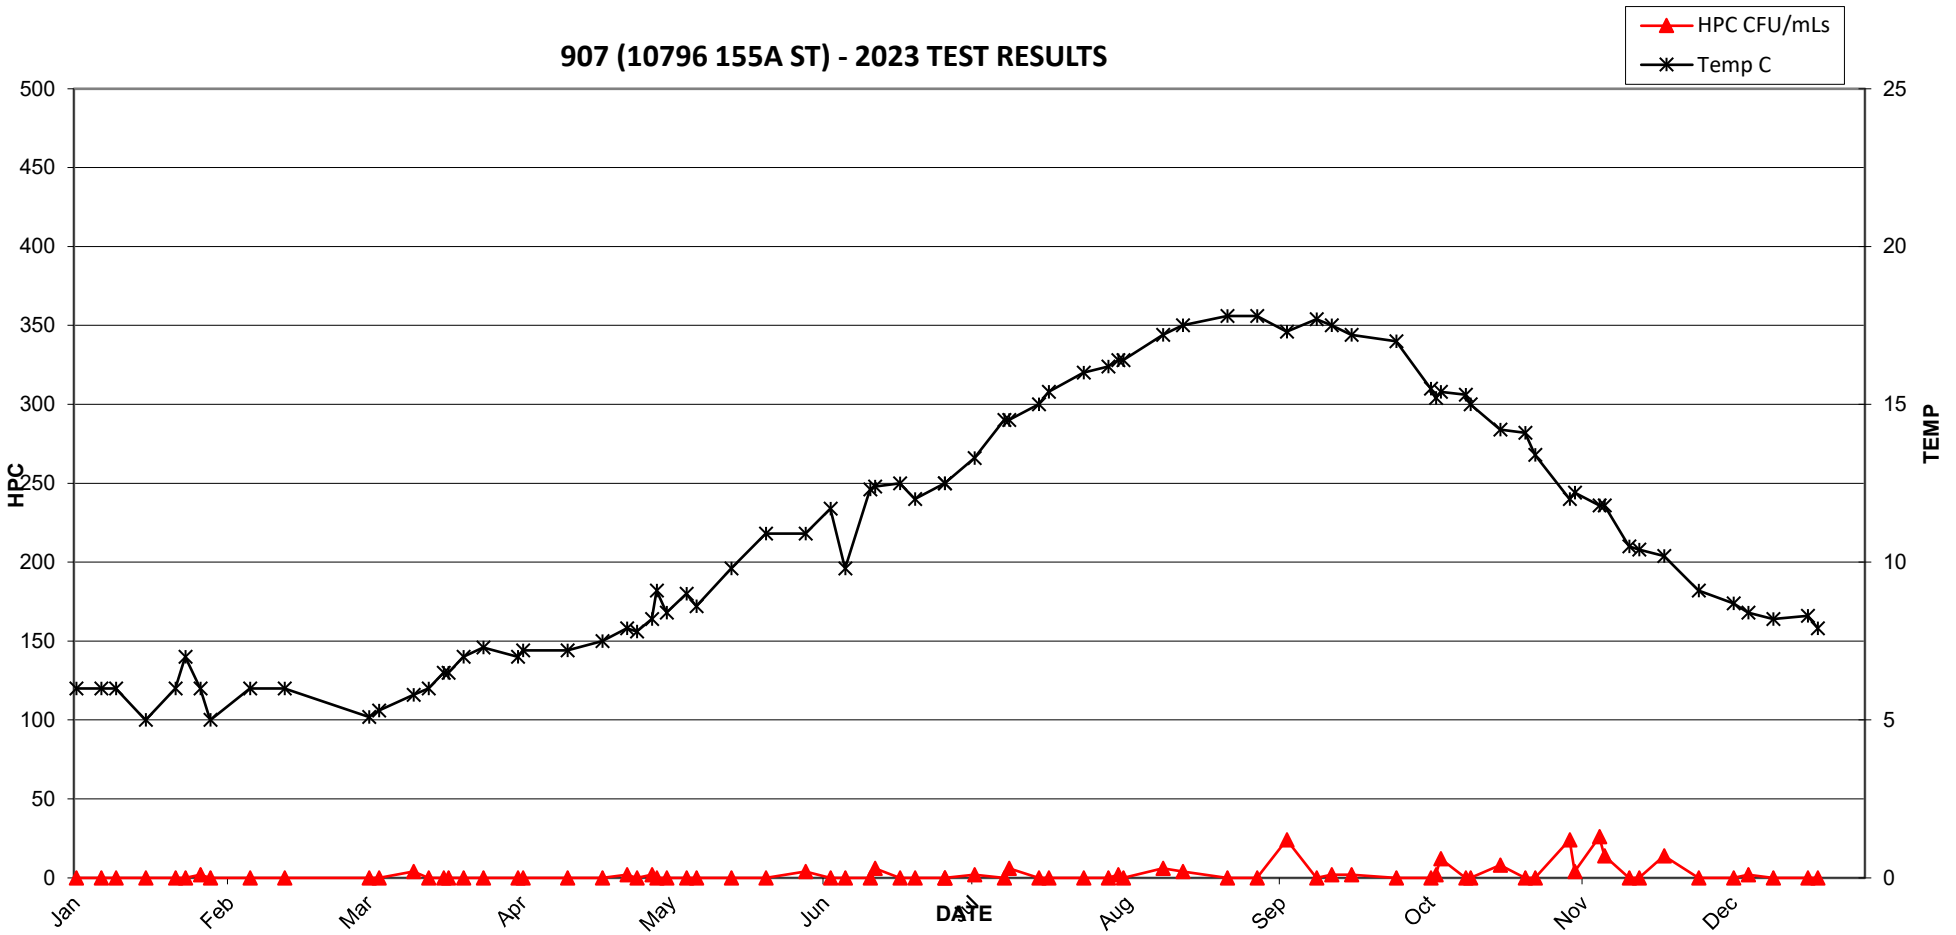



907 (10796 155A ST) - 2023 TEST RESULTS

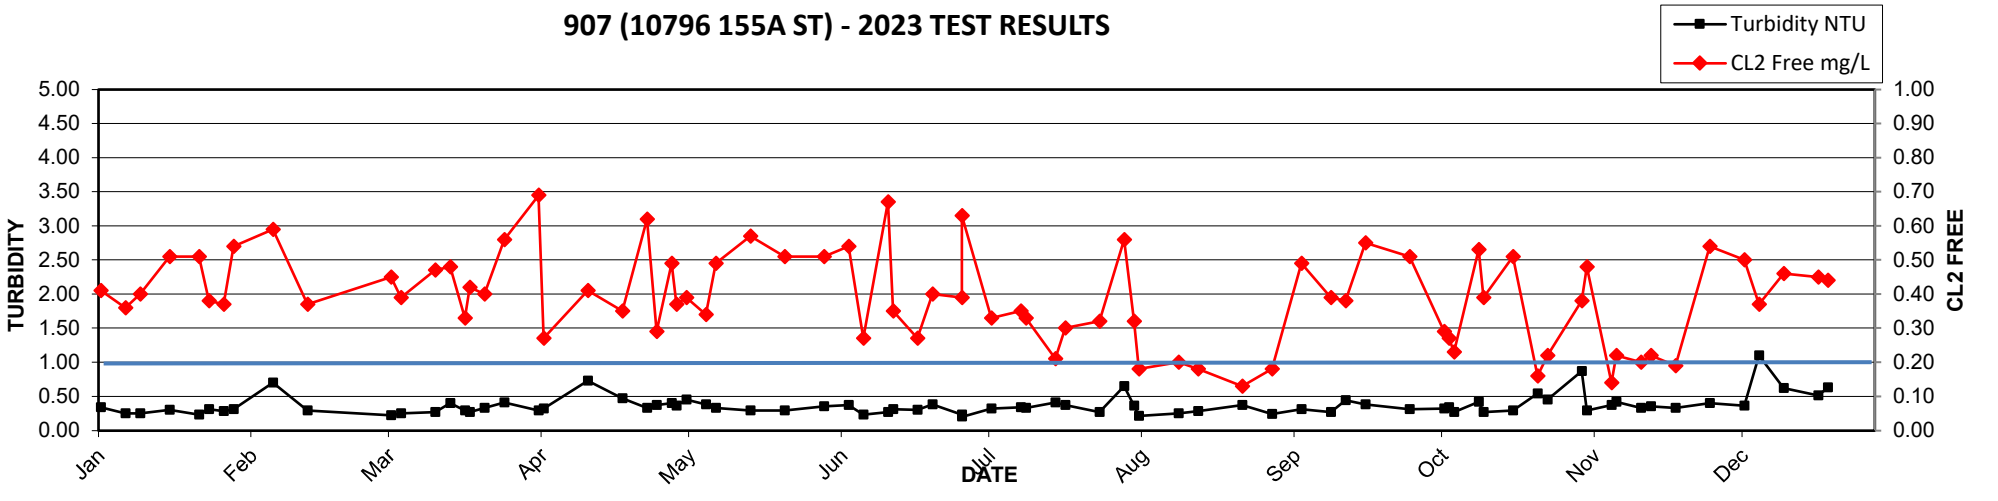

**2023 MV Laboratory Report - 908 (15985 112 AVE)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
05-Jan	0.33	<1	<2	<1	7	0.27
10-Jan	0.27	<1	4	<1	7	0.22
13-Jan	0.17	<1	<2	<1	7	0.24
19-Jan	0.31	<1	<2	<1	6	0.26
25-Jan	0.19	<1	<2	<1	7	0.25
27-Jan	0.26	<1	<2	<1	8	0.37
30-Jan	0.26	<1	<2	<1	7	0.35
01-Feb	0.23	<1	<2	<1	7	0.35
09-Feb	0.26	<1	<2	<1	6	0.42
16-Feb	0.65	<1	<2	<1	6	0.23
25-Feb	0.16	<1	4	<1	6	0.38
05-Mar	0.19	<1	2	<1	5.9	0.25
07-Mar	0.22	<1	<2	<1	5.4	0.73
14-Mar	0.21	<1	2	<1	6.7	0.22
17-Mar	0.22	<1	2	<1	7.3	0.40
20-Mar	0.23	<1	<2	<1	8.7	0.24
21-Mar	0.23	<1	<2	<1	7	0.30
28-Mar	0.28	<1	66	<1	7.6	0.34
04-Apr	0.37	<1	2	<1	7.8	0.36
14-Apr	0.20	<1	2	<1	8.4	0.94
21-Apr	0.08	<1	4	<1	8.7	0.53
26-Apr	0.23	<1	4	<1	9.1	0.43
28-Apr	0.12	<1	<2	<1	9.3	0.33
01-May	0.16	<1	2	<1	10.2	0.39
02-May	0.17	<1	<2	<1	11	0.31
04-May	0.11	<1	26	<1	10.9	0.41
08-May	0.19	<1	2	<1	11.9	0.32
10-May	0.14	<1	2	<1	11.8	0.32
12-May	0.24	<1	14	<1	12.2	0.40
17-May	0.31	<1	<2	<1	13.2	0.28
24-May	0.19	<1	2	<1	14.5	0.29
01-Jun	0.20	<1	<2	<1	14.2	0.36
06-Jun	0.23	<1	4	<1	15.9	0.46
14-Jun	0.18	<1	2	<1	15	0.22
15-Jun	0.08	<1	<2	<1	15.3	0.32
20-Jun	0.19	<1	2	<1	16.1	0.32
29-Jun	0.16	<1	6	<1	15.6	0.21
29-Jun	0.26	<1	<2	<1	15.8	0.21
05-Jul	0.16	<1	<2	<1	16	0.30
11-Jul	0.18	<1	20	<1	17.3	0.26
12-Jul	0.23	<1	14	<1	17.3	0.26
18-Jul	0.18	<1	10	<1	18.3	0.28
25-Jul	0.14	<1	8	<1	20	0.22
27-Jul	0.18	<1	2	<1	19	0.22
03-Aug	0.18	<1	6	<1	18.8	0.37
04-Aug	0.12	<1	2	<1	19.1	0.22
12-Aug	0.22	<1	10	<1	19.6	0.20
16-Aug	0.05	<1	<2	<1	19.7	0.25
25-Aug	0.11	<1	4	<1	20	0.26
31-Aug	0.11	<1	10	<1	19.9	0.23
06-Sep	0.11	<1	2	<1	19.7	0.23
12-Sep	0.19	<1	18	<1	18.4	0.21
15-Sep	0.19	<1	10	<1	18.2	0.27
19-Sep	0.19	<1	16	<1	19.2	0.25




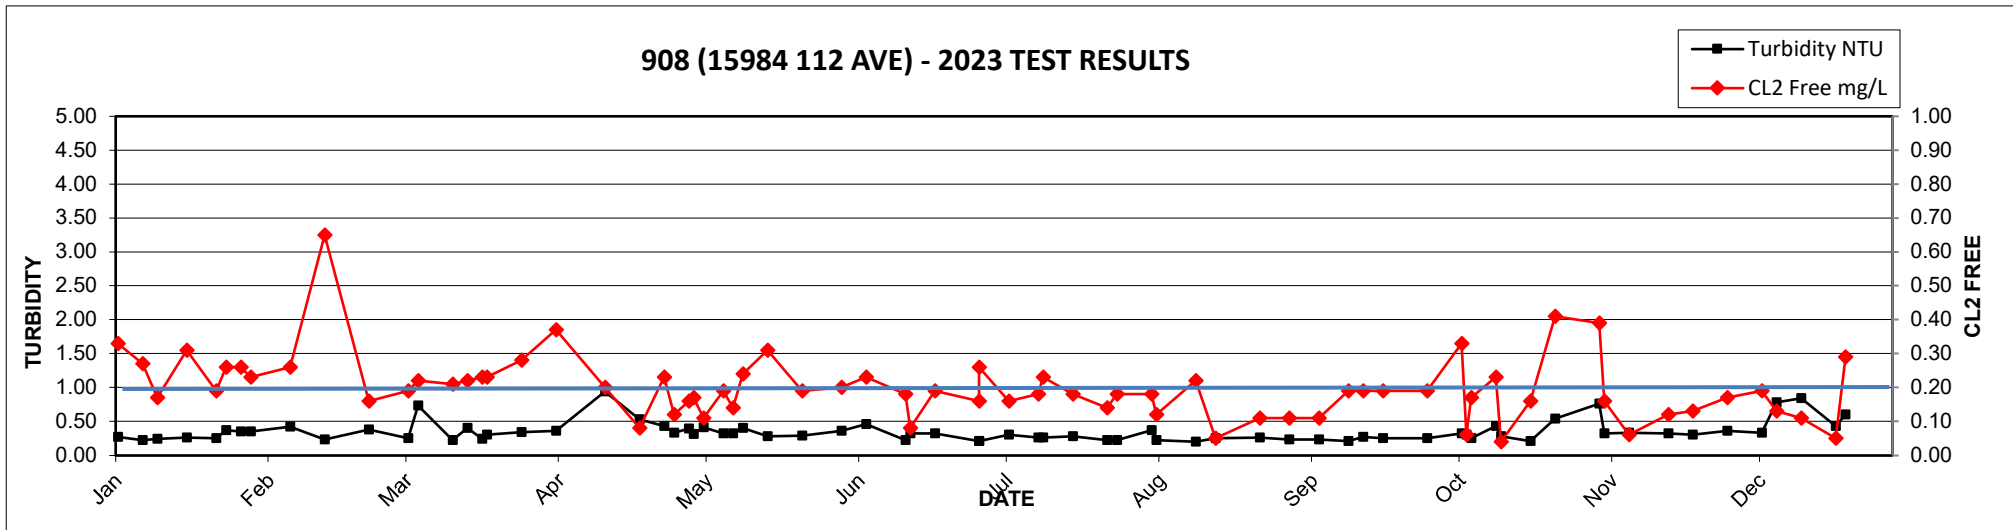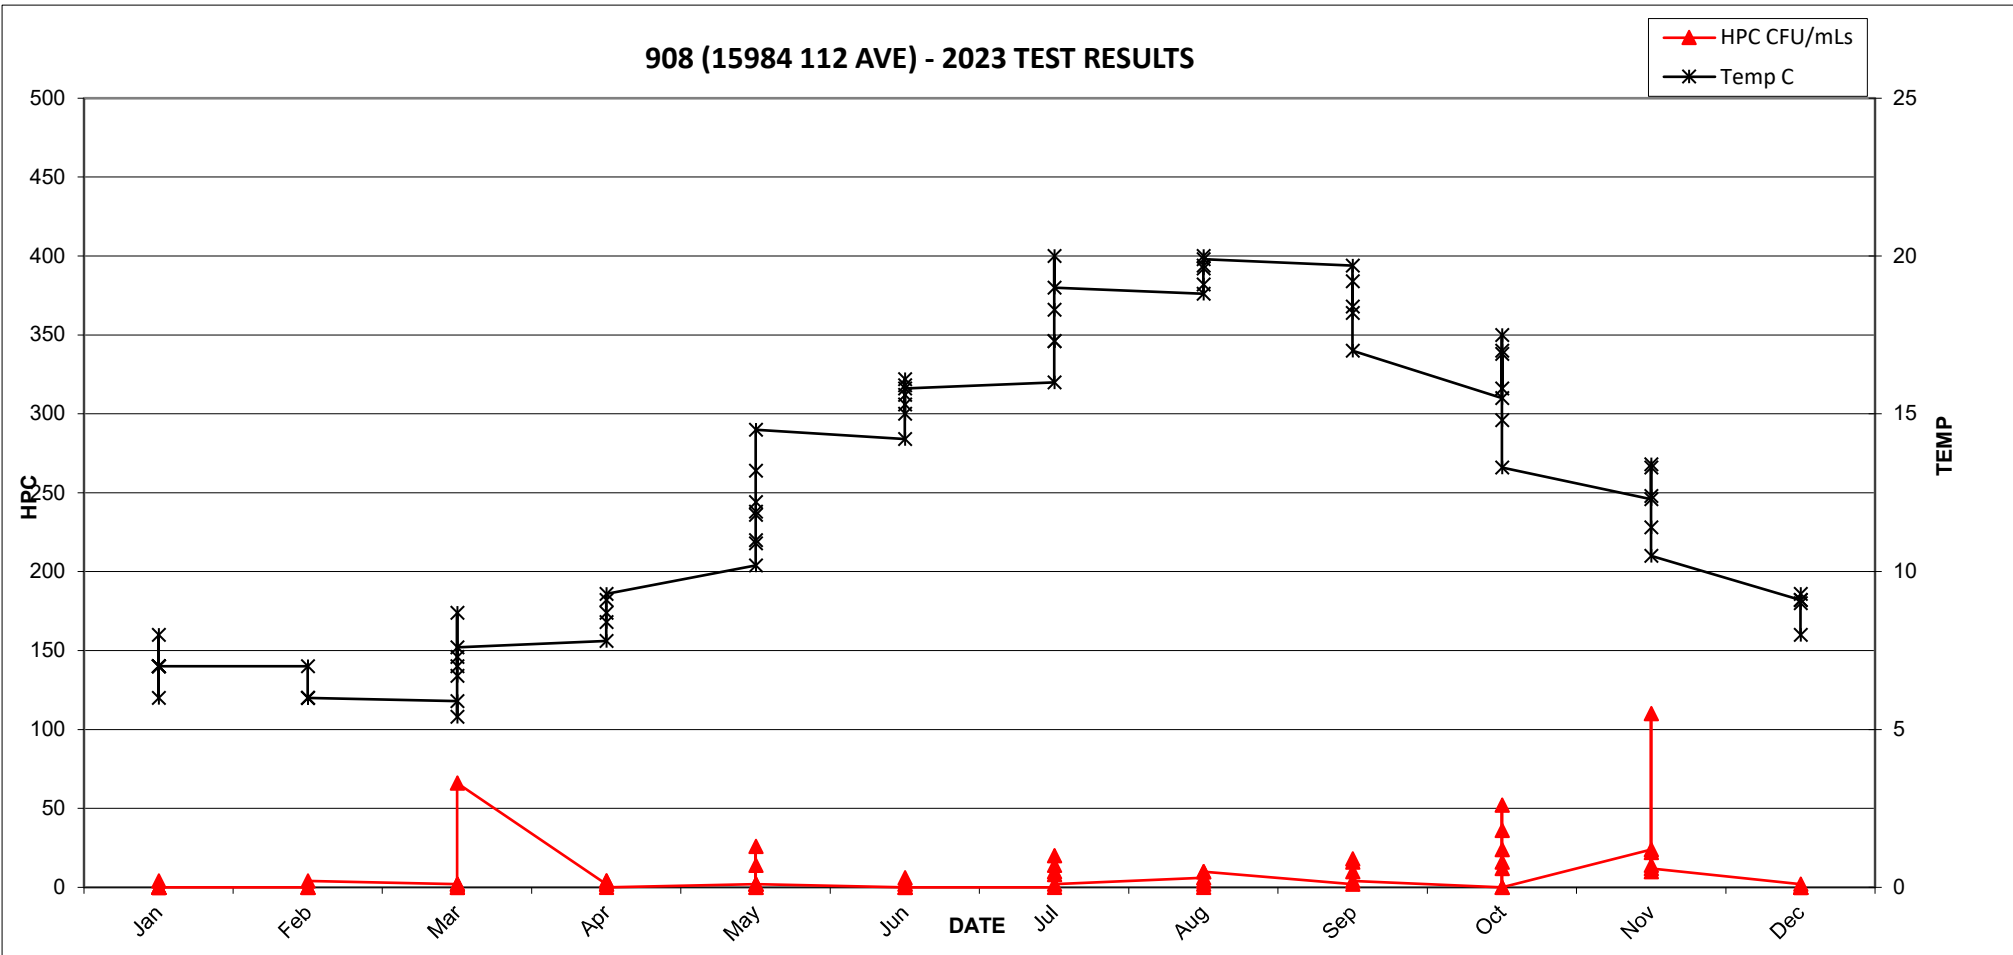


**2023 MV Laboratory Report - 909 (14674 ST ANDREWS DR)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.76	<1	<2	<1	6	0.38
12-Jan	0.53	<1	<2	<1	6	0.33
18-Jan	0.54	<1	<2	<1	6	0.25
26-Jan	0.93	<1	<2	<1	6	0.24
03-Feb	0.95	<1	<2	<1	5	0.90
08-Feb	0.95	<1	<2	<1	6	0.55
15-Feb	0.71	<1	<2	<1	5	0.30
23-Feb	0.81	<1	<2	<1	5	0.33
25-Feb	0.89	<1	<2	<1	5	0.32
15-Mar	0.88	<1	<2	<1	5.5	0.24
20-Mar	0.76	<1	<2	<1	6.3	0.25
27-Mar	0.86	<1	<2	<1	6.1	1.50
06-Apr	1.08	<1	<2	<1	6.5	0.74
12-Apr	0.87	<1	<2	<1	7.1	0.55
20-Apr	1.05	<1	<2	<1	7.3	0.50
27-Apr	0.52	<1	<2	<1	7.6	0.32
02-May	0.33	<1	<2	<1	7.7	0.27
04-May	0.46	<1	<2	<1	9.9	0.36
10-May	0.70	<1	<2	<1	10.1	0.47
16-May	0.61	<1	<2	<1	11.4	0.65
17-May	0.28	<1	<2	<1	11.9	0.33
25-May	0.58	<1	<2	<1	12.8	0.26
31-May	0.64	<1	2	<1	7.3	0.30
07-Jun	0.41	<1	<2	<1	13.4	0.20
08-Jun	0.47	<1	2	<1	13.8	0.35
09-Jun	0.61	<1	<2	<1	13.4	0.20
12-Jun	0.42	<1	<2	<1	14	0.23
20-Jun	0.49	<1	<2	<1	13.9	0.27
28-Jun	0.41	<1	2	<1	14	0.22
29-Jun	0.52	<1	<2	<1	14	0.26
06-Jul	0.41	<1	<2	<1	15.2	0.23
12-Jul	0.37	<1	10	<1	14.1	0.18
19-Jul	0.41	<1	<2	<1	16.5	0.20
25-Jul	0.73	<1	<2	<1	14.9	0.20
27-Jul	0.51	<1	<2	<1	15.9	0.22
01-Aug	0.44	<1	LA	<1	14.9	0.28
03-Aug	0.51	<1	2	<1	17.2	0.25
10-Aug	0.66	<1	<2	<1	17.2	0.21
17-Aug	0.43	<1	<2	18.1	8.4	<1
24-Aug	0.57	<1	<2	<1	17.7	0.31
30-Aug	0.49	<1	4	<1	18	0.24
06-Sep	0.66	<1	12	<1	16	0.30
13-Sep	0.75	<1	<2	<1	17.9	0.27
21-Sep	0.29	<1	<2	<1	16	0.30
28-Sep	0.66	<1	8	<1	15	0.30
03-Oct	0.61	<1	6	<1	15	0.27
10-Oct	0.58	<1	12	<1	14.3	0.30
17-Oct	0.53	<1	18	<1	14.5	0.27
20-Oct	0.87	<1	12	<1	13.2	0.36
23-Oct	1.05	<1	20	<1	12.7	0.48

909 (14674 ST ANDREWS DR) - 2023 TEST RESULTS

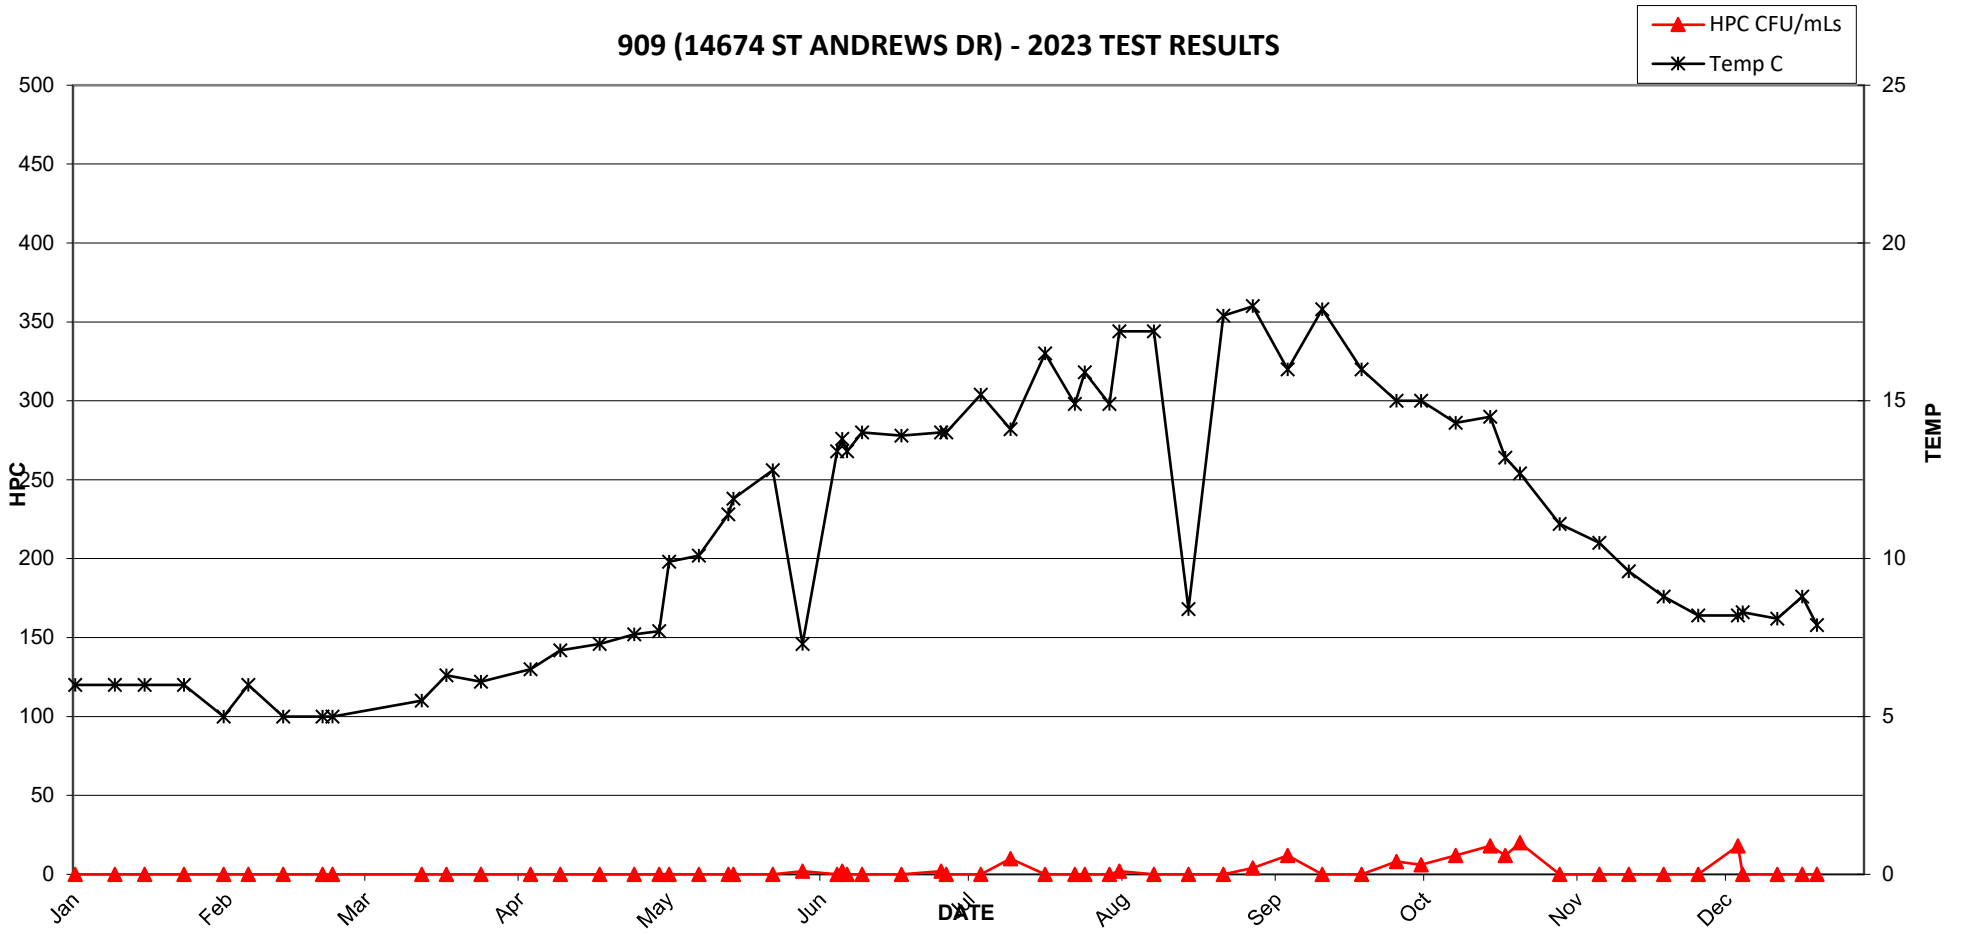


909 (14674 ST ANDREWS DR) - 2023 TEST RESULTS

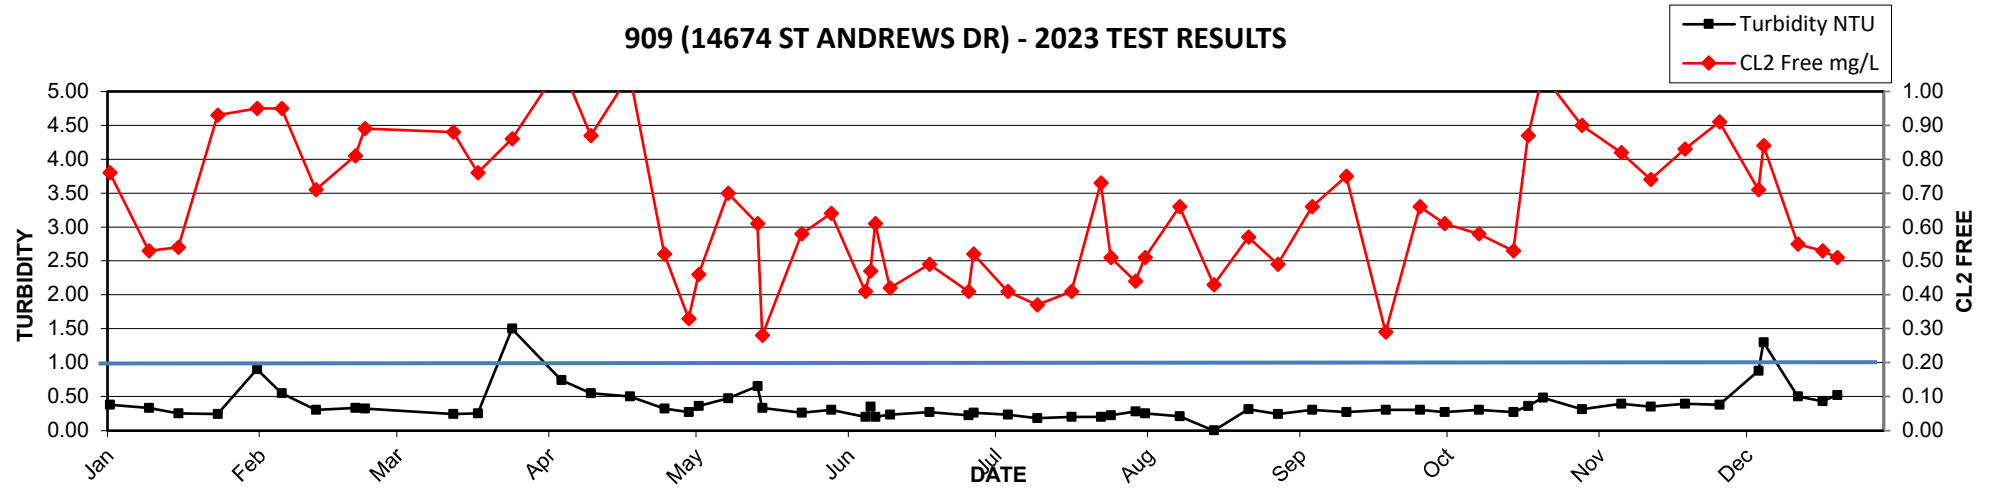


**2023 MV Laboratory Report - 910 (14396 115 AVE)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.32	<1	<2	<1	6	0.32
12-Jan	0.46	<1	2	<1	7	0.21
18-Jan	0.24	<1	2	<1	7	0.19
26-Jan	0.30	<1	2	<1	7	0.24
03-Feb	0.32	<1	<2	<1	7	0.26
08-Feb	0.19	<1	<2	<1	6	0.24
15-Feb	0.46	<1	<2	<1	7	0.23
23-Feb	0.37	<1	<2	<1	6	0.23
25-Feb	0.40	<1	<2	<1	6	0.24
11-Mar	0.37	<1	<2	<1	5.8	0.14
15-Mar	0.34	<1	<2	<1	5.9	0.18
20-Mar	0.44	<1	<2	<1	6.6	0.21
27-Mar	0.53	<1	<2	<1	7.2	0.17
06-Apr	0.54	<1	6	<1	6.9	0.22
12-Apr	0.23	<1	2	<1	8	0.19
20-Apr	0.52	<1	<2	<1	7.7	0.44
27-Apr	0.34	<1	6	<1	8	0.20
02-May	0.22	<1	<2	<1	10	0.24
04-May	0.43	<1	<2	<1	10.3	0.18
10-May	0.25	<1	<2	<1	11	0.30
16-May	0.16	<1	<2	<1	12.8	0.31
17-May	0.20	<1	2	<1	13.4	0.28
25-May	0.34	<1	<2	<1	14	0.14
31-May	0.27	<1	<2	<1	14.3	0.16
07-Jun	0.16	<1	<2	<1	14.7	0.33
08-Jun	0.20	<1	<2	<1	14.8	0.36
09-Jun	0.23	<1	<2	<1	16	0.19
12-Jun	0.33	<1	<2	<1	16	0.13
20-Jun	0.10	<1	2	<1	15.1	0.35
28-Jun	0.17	<1	10	<1	16	0.20
29-Jun	0.13	<1	<2	<1	15.6	0.21
06-Jul	0.20	<1	2	<1	16.8	0.51
12-Jul	0.18	<1	12	<1	13.8	0.22
19-Jul	0.17	<1	14	<1	18.1	0.22
25-Jul	0.17	<1	4	<1	18.8	0.22
27-Jul	0.19	<1	<2	<1	18.8	0.24
01-Aug	0.22	<1	20	<1	18.2	0.46
03-Aug	0.16	<1	20	<1	17.9	0.36
10-Aug	0.05	<1	18	<1	19.1	0.21
17-Aug	0.26	<1	20	19.4	8.6	<1
24-Aug	0.12	<1	24	<1	19.1	0.38
30-Aug	0.06	<1	28	<1	19.1	0.18
06-Sep	0.17	<1	24	<1	18.3	0.21
13-Sep	0.15	<1	12	<1	18.7	0.20
21-Sep	0.19	<1	44	<1	18	0.24
28-Sep	0.19	<1	14	<1	17	0.28
03-Oct	0.16	<1	60	<1	17	0.24
10-Oct	0.27	<1	24	<1	14.9	0.23
17-Oct	0.09	<1	80	<1	15.5	0.22
20-Oct	0.11	<1	30	<1	15.1	0.13

### 910 (14396 115 AVE)- 2023 TEST RESULTS

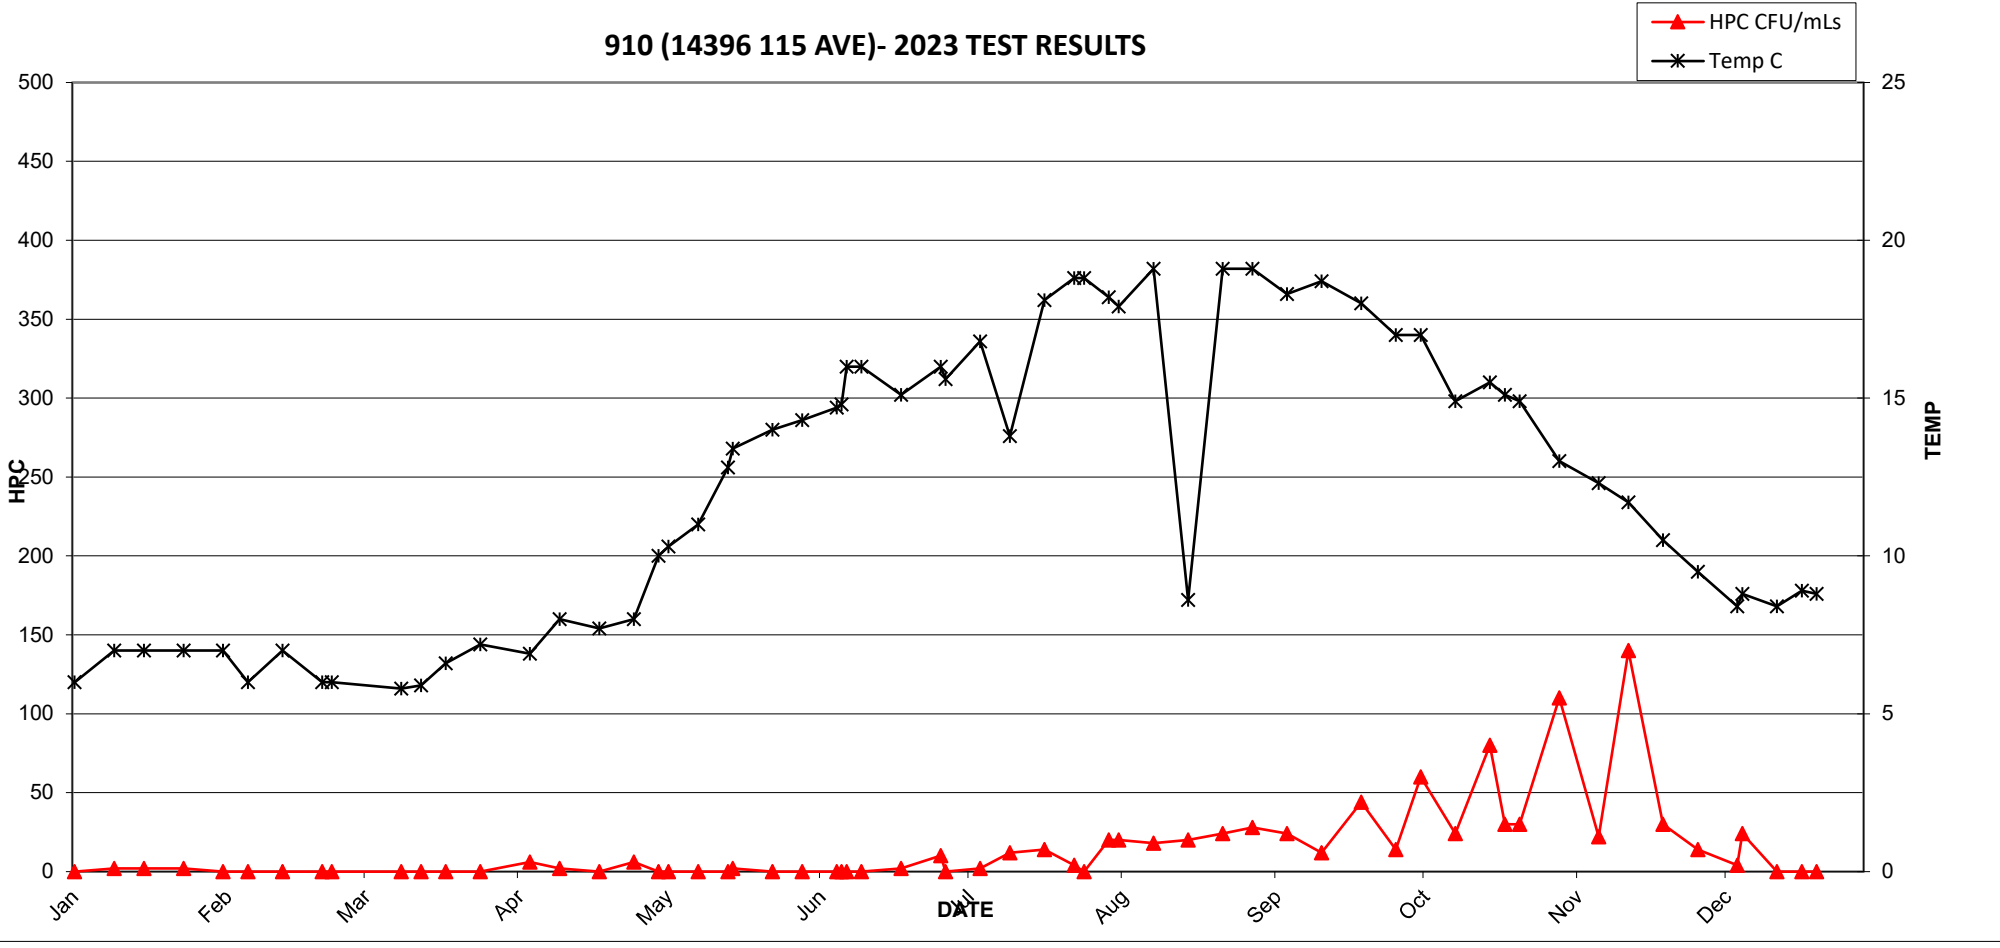


### 910 (14396 115 AVE)- 2023 TEST RESULTS

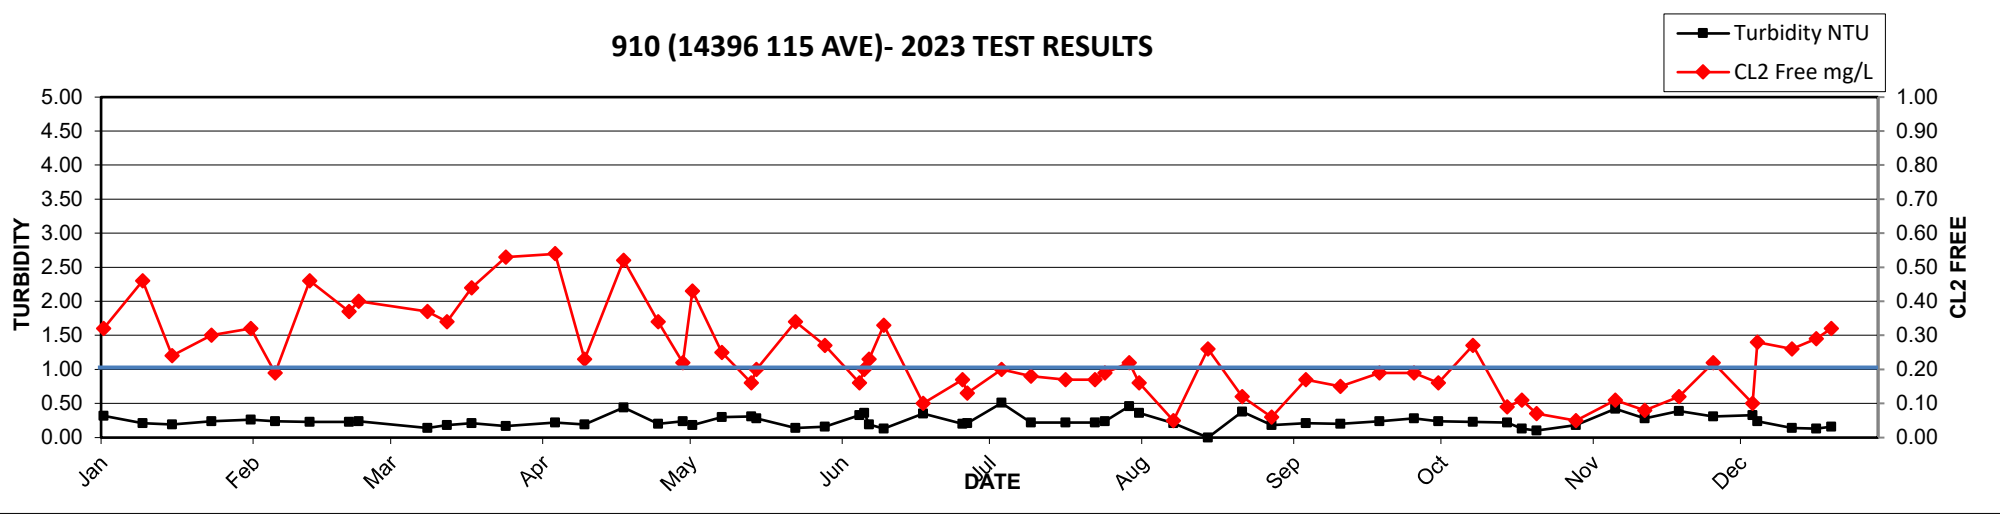


**2023 MV Laboratory Report - 911 (12893 - 114A AVE)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
08-Jan	0.86	<1	<2	<1	7	0.20
12-Jan	0.27	<1	<2	<1	8	0.23
19-Jan	0.17	<1	<2	<1	7	0.25
27-Jan	0.24	<1	<2	<1	8	0.25
30-Jan	0.33	<1	<2	<1	6	0.32
09-Feb	0.88	<1	<2	<1	6	0.83
05-Mar	0.71	<1	<2	<1	5.3	0.23
11-Mar	1.20	<1	<2	<1	5.4	0.20
17-Mar	0.85	<1	<2	<1	5.3	0.45
18-Mar	0.92	<1	<2	<1	7.2	0.29
21-Mar	0.64	<1	<2	<1	6.7	0.24
31-Mar	0.52	<1	<2	<1	7.3	0.29
01-Apr	0.79	<1	<2	<1	7.4	0.20
05-Apr	0.43	<1	<2	<1	7.9	0.23
12-Apr	0.30	<1	<2	<1	8	0.35
18-Apr	0.34	<1	2	<1	8.1	0.36
25-Apr	0.34	<1	2	<1	8.4	0.27
03-May	0.42	<1	<2	<1	9.6	0.40
10-May	0.34	<1	<2	<1	10.5	0.33
12-May	0.37	<1	<2	<1	11	0.27
18-May	0.31	<1	<2	<1	11.2	0.34
24-May	0.30	<1	<2	<1	13	0.24
03-Jun	0.24	<1	<2	<1	14.2	0.22
06-Jun	0.16	<1	4	<1	14	0.23
08-Jun	0.17	<1	<2	<1	14.3	0.22
09-Jun	0.19	<1	<2	<1	14.1	0.17
14-Jun	0.27	<1	2	<1	15	0.22
16-Jun	0.09	<1	4	<1	14.6	0.21
21-Jun	0.18	<1	2	<1	15.5	0.20
22-Jun	0.22	<1	<2	<1	15.6	0.20
28-Jun	0.11	<1	2	<1	15	0.18
04-Jul	0.35	<1	<2	<1	15.2	0.22
11-Jul	0.22	<1	<2	<1	16.2	0.17
18-Jul	0.19	<1	<2	<1	16.6	0.34
24-Jul	0.24	<1	68	<1	18	0.52
26-Jul	0.28	<1	94	<1	18.8	0.30
28-Jul	0.57	<1	22	<1	17.3	0.21
31-Jul	0.09	<1	230	<1	18.6	0.21
09-Aug	0.06	<1	6	<1	18.4	0.24
16-Aug	0.13	<1	4	<1	18.4	0.24
26-Aug	0.17	<1	14	<1	18.4	0.23
28-Aug	0.25	<1	2	<1	19	0.20
09-Sep	0.12	<1	4	<1	18.4	0.23
11-Sep	0.14	<1	100	<1	19.8	0.18
18-Sep	0.08	<1	58	<1	18.4	0.29
21-Sep	0.11	<1	34	<1	18.9	0.22
25-Sep	0.03	<1	120	<1	18.7	0.36
28-Sep	0.03	<1	840	<1	19	0.25
05-Oct	0.09	<1	130	<1	17.7	0.22
10-Oct	0.17	<1	<2	<1	17.3	0.24
18-Oct	0.11	<1	26	<1	16.5	0.24
23-Oct	0.12	<1	<2	<1	16.2	0.35
02-Nov	0.05	<1	330	<1	14.5	0.27
06-Nov	0.04	<1	620	<1	13.5	0.28
23-Nov	0.06	<1	2600	<1	11.3	0.22
27-Nov	0.05	<1	150	<1	11.3	0.27

### 911 (12893 114A AVE) - 2023 TEST RESULTS

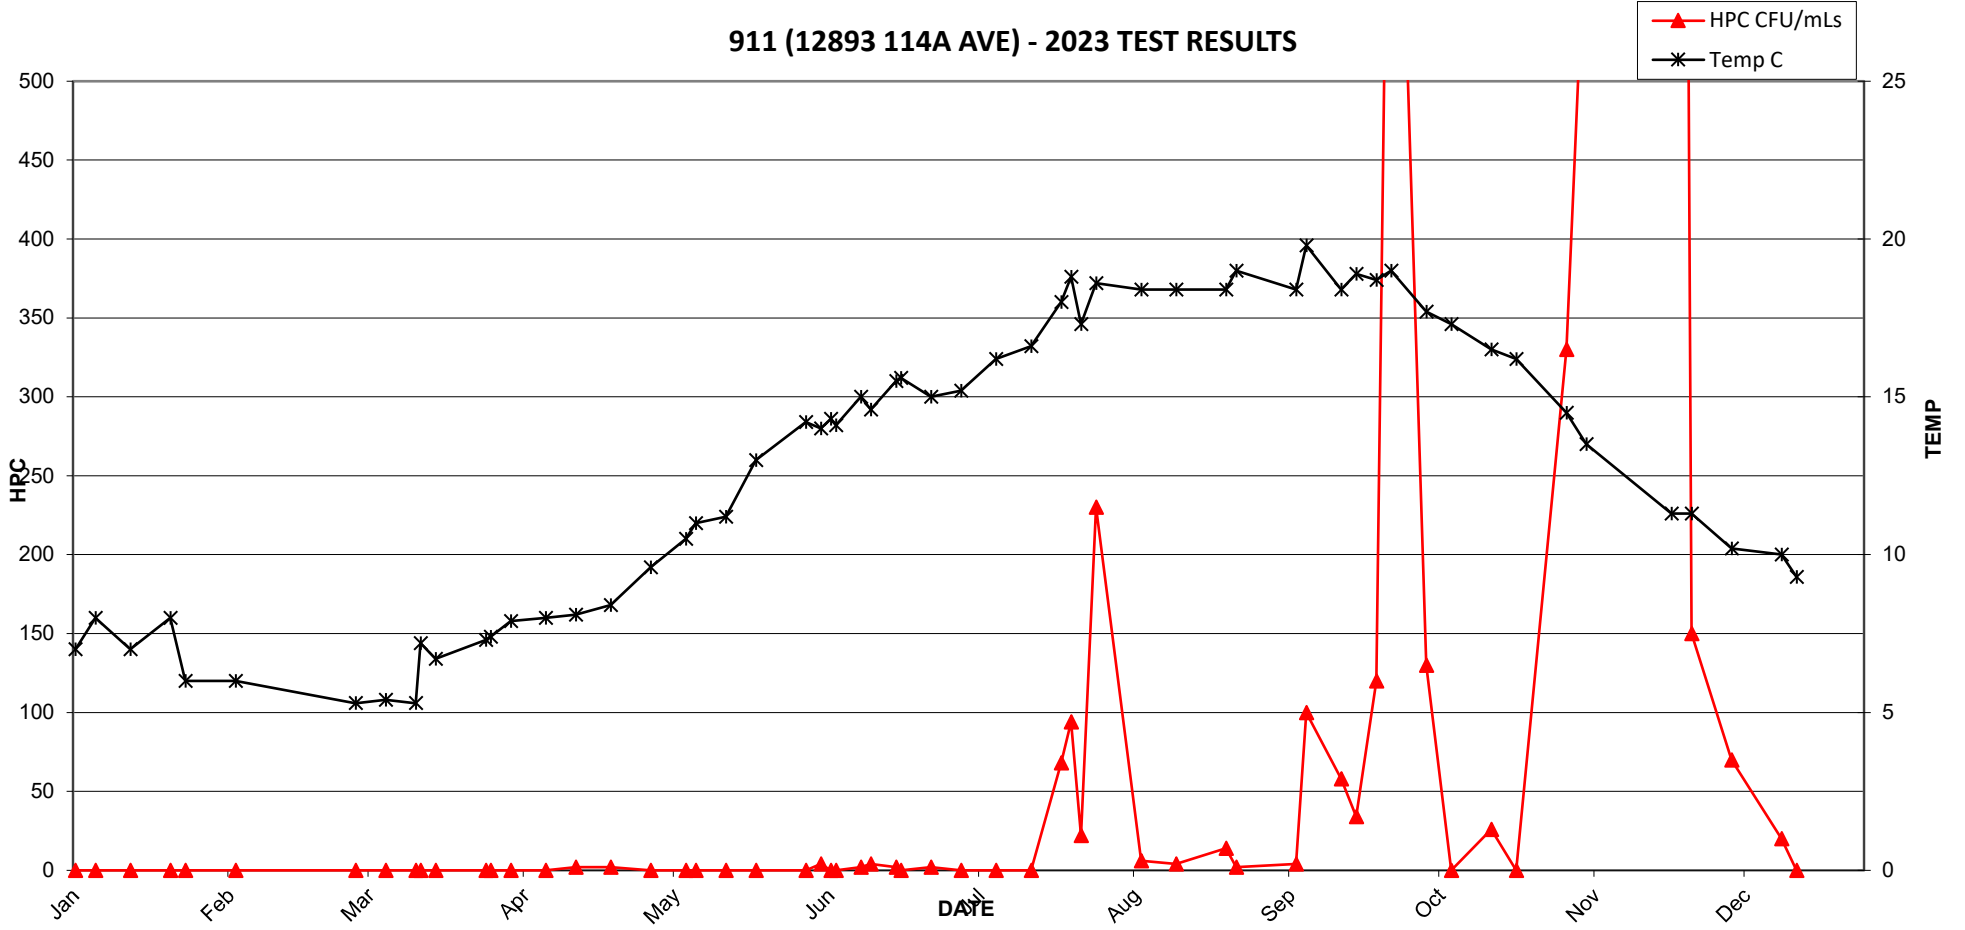

### 911 (12893 114A AVE) - 2023 TEST RESULTS

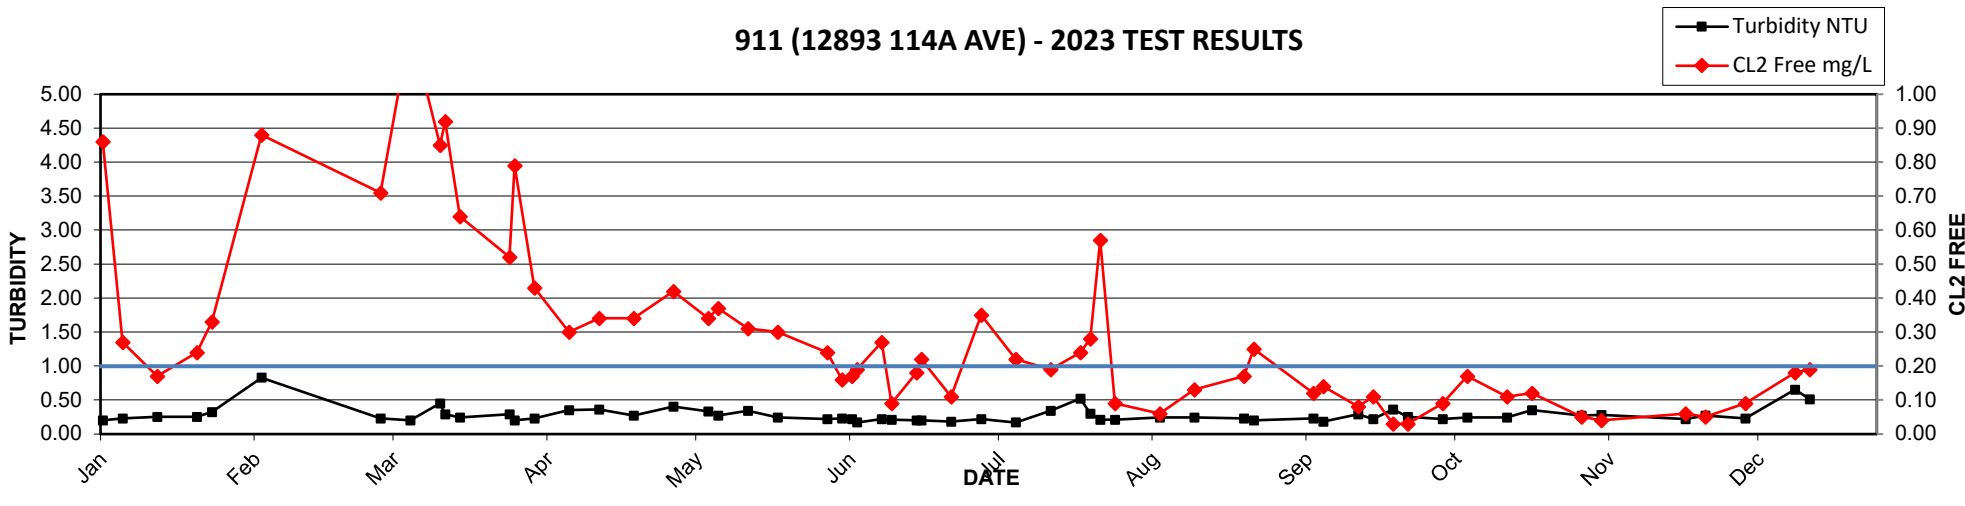


## 2023 MV Laboratory Report - 912 (10619 TIMBERLAND RD)


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
08-Jan	0.45	<1	<2	<1	7	0.21
12-Jan	0.44	<1	<2	<1	8	0.16
19-Jan	0.41	<1	<2	<1	7	3.80
27-Jan	0.33	<1	<2	<1	7	0.19
09-Feb	0.63	<1	<2	<1	6	0.19
05-Mar	0.57	<1	<2	<1	5.8	0.19
11-Mar	0.61	<1	<2	<1	5	0.21
17-Mar	0.27	<1	<2	<1	6.1	0.28
18-Mar	0.40	<1	<2	<1	7	0.35
21-Mar	0.48	<1	2	<1	6.6	0.20
31-Mar	0.26	<1	<2	<1	7.6	0.35
01-Apr	0.53	<1	<2	<1	7.5	0.35
05-Apr	0.56	<1	<2	<1	7.6	0.38
12-Apr	0.69	<1	<2	<1	7.9	0.63
18-Apr	0.55	<1	<2	<1	8	0.56
25-Apr	0.52	<1	<2	<1	8.4	0.40
03-May	0.62	<1	<2	<1	9.8	0.41
10-May	0.58	<1	<2	<1	10.5	0.35
12-May	0.56	<1	<2	<1	11	0.38
17-May	0.37	<1	<2	<1	12.2	0.31
06-Jun	0.44	<1	<2	<1	14.4	0.34
08-Jun	0.15	<1	2	<1	14.3	0.36
14-Jun	0.39	<1	<2	<1	14.5	0.27
16-Jun	0.21	<1	<2	<1	15	0.26
21-Jun	0.23	<1	<2	<1	14.9	0.26
22-Jun	0.29	<1	<2	<1	15	0.24
28-Jun	0.37	<1	<2	<1	15.3	0.22
04-Jul	0.33	<1	100	<1	16	8.80
05-Jul	0.32	<1	<2	<1	16	0.32
11-Jul	0.37	<1	10	<1	16.8	0.24
18-Jul	0.28	<1	12	<1	17	0.39
28-Jul	0.17	<1	32	<1	18.3	0.24
31-Jul	0.25	<1	24	<1	18.4	0.21
09-Aug	0.22	<1	16	<1	18.4	0.53
16-Aug	0.13	<1	2	<1	18.4	0.26
26-Aug	0.28	<1	8	<1	19.1	0.25
28-Aug	0.30	<1	<2	<1	19.1	0.33
09-Sep	0.11	<1	32	<1	19	0.36
11-Sep	0.31	<1	4	<1	18.7	0.23
18-Sep	0.18	<1	18	<1	18.6	0.30
21-Sep	0.17	<1	22	<1	18.5	0.26
25-Sep	0.26	<1	4	<1	18	0.38
28-Sep	0.29	<1	<2	<1	18	0.26
05-Oct	0.22	<1	6	<1	16.9	0.24
10-Oct	0.08	<1	<2	<1	16.3	0.31
18-Oct	0.17	<1	2	<1	15.7	0.23
23-Oct	0.28	<1	2	<1	14.9	0.43
02-Nov	0.28	<1	8	<1	12.9	0.31
06-Nov	0.27	<1	<2	<1	12.5	0.31
23-Nov	0.32	<1	<2	<1	10.4	0.26
27-Nov	0.38	<1	<2	<1	9.3	0.32
05-Dec	0.30	<1	<2	<1	8.5	0.36
15-Dec	0.44	<1	2	<1	8	0.48



### 912 (10619 TIMBERLAND RD) - 2023 TEST RESULTS

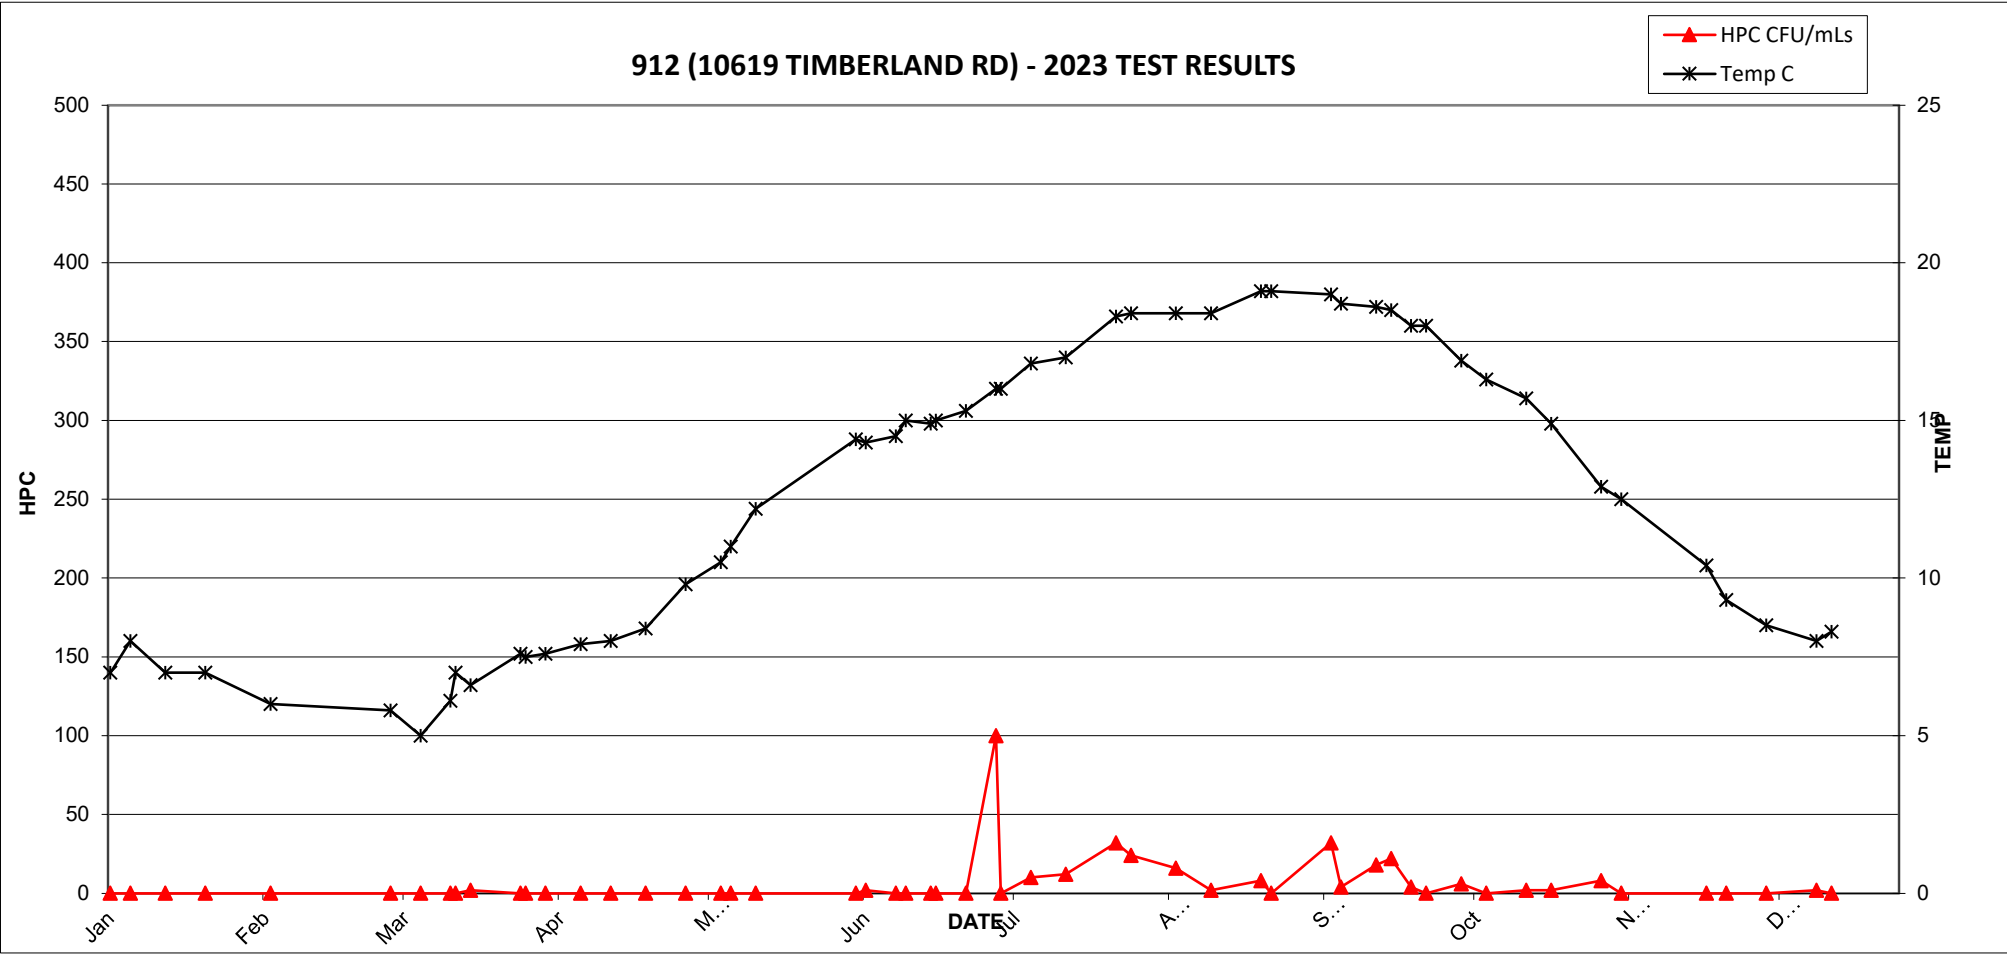


### 912 (10619 TIMBERLAND RD) - 2023 TEST RESULTS

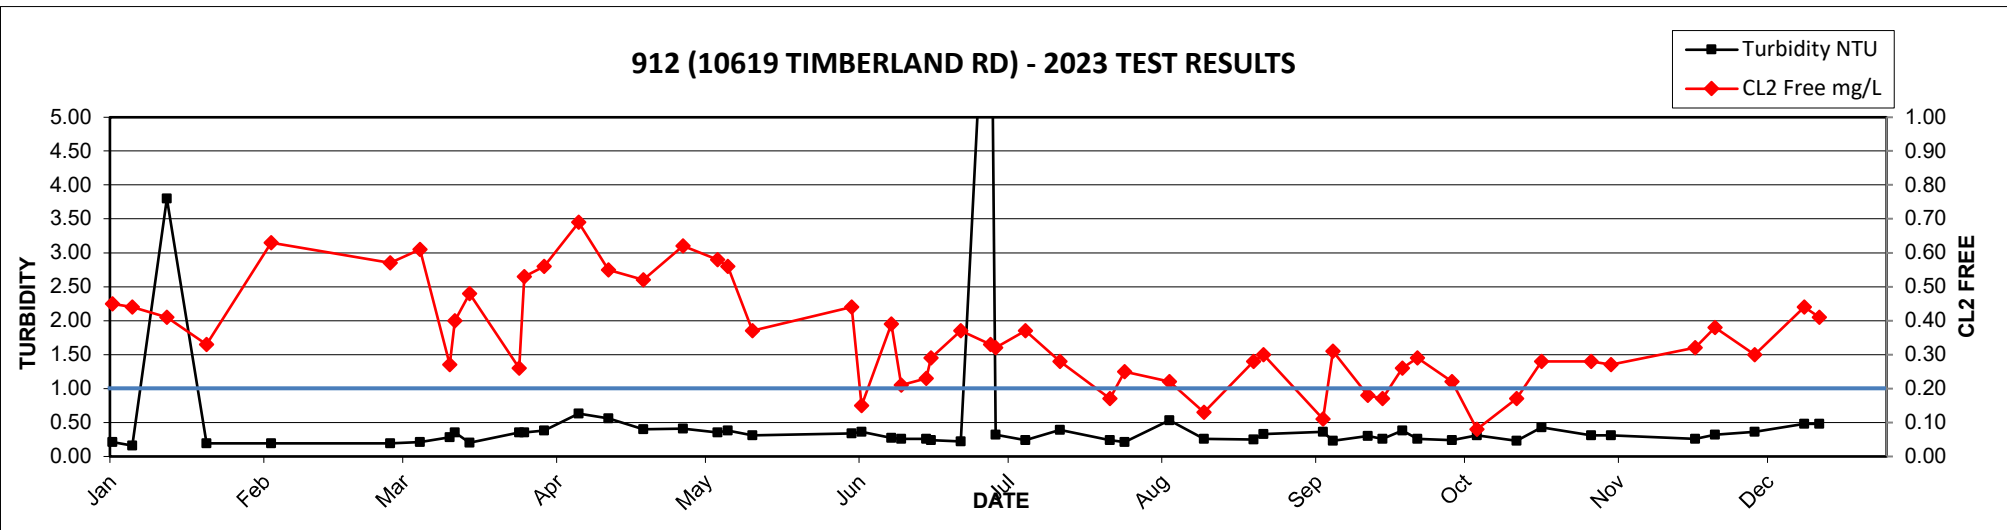


**2023 MV Laboratory Report - 913 (11878 98A AVE)**

<b>Date Collected</b>	<b>CL2Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
08-Jan	1.20	<1	<2	<1	6	0.23
12-Jan	0.34	<1	<2	<1	7	0.24
19-Jan	0.50	<1	<2	<1	7	0.19
27-Jan	0.41	<1	<2	<1	7	0.30
30-Jan	0.40	<1	<2	<1	6	0.32
09-Feb	0.50	<1	12	<1	6	0.16
05-Mar	0.88	<1	<2	<1	5	0.22
11-Mar	0.88	<1	<2	<1	6	0.19
17-Mar	0.62	<1	<2	<1	6	0.22
21-Mar	0.60	<1	<2	<1	6	0.18
31-Mar	0.50	<1	<2	<1	7.5	0.19
01-Apr	0.62	<1	<2	<1	7.3	0.11
05-Apr	0.62	<1	<2	<1	7.3	0.24
12-Apr	0.73	<1	<2	<1	7.5	0.56
18-Apr	0.79	<1	<2	<1	7.8	0.49
25-Apr	0.63	<1	<2	<1	8.1	0.20
03-May	0.70	<1	<2	<1	9.7	0.35
10-May	0.84	<1	<2	<1	9.8	0.51
12-May	0.90	<1	<2	<1	9.7	0.47
17-May	0.65	<1	<2	<1	11.6	0.35
18-May	0.59	<1	<2	<1	10.1	0.36
24-May	0.56	<1	<2	<1	12.4	0.19
03-Jun	0.59	<1	<2	<1	13.5	0.33
06-Jun	0.73	<1	<2	<1	12.9	0.32
08-Jun	0.72	<1	<2	<1	12.8	1.50
14-Jun	0.62	<1	<2	<1	14	0.14
16-Jun	0.59	<1	<2	<1	13.7	0.24
21-Jun	0.60	<1	<2	<1	14.1	0.10
22-Jun	0.50	<1	4	<1	14.4	0.19
28-Jun	0.58	<1	2	<1	14	0.32
04-Jul	0.56	<1	2	<1	15	0.54
11-Jul	0.58	<1	2	<1	15.1	0.27
18-Jul	0.50	<1	4	<1	16.6	0.28
28-Jul	0.48	<1	<2	<1	17.8	0.24
31-Jul	0.48	<1	2	<1	17	0.25
09-Aug	0.40	<1	2	<1	18	0.22
16-Aug	0.41	<1	2	<1	18.2	0.33
26-Aug	0.55	<1	<2	<1	18.3	0.28
28-Aug	0.47	<1	<2	<1	18.7	0.31
09-Sep	0.13	<1	<2	<1	18.3	0.24
11-Sep	0.48	<1	2	<1	18	0.28
18-Sep	0.44	<1	2	<1	19	0.96
21-Sep	0.52	<1	2	<1	17.6	0.29
25-Sep	0.49	<1	<2	<1	17.2	0.35
28-Sep	0.46	<1	<2	<1	17	0.35
05-Oct	0.46	<1	<2	<1	15.6	0.31
10-Oct	0.47	<1	<2	<1	15.7	0.30
18-Oct	0.34	<1	<2	<1	14.5	0.15
23-Oct	0.54	<1	2	<1	13.7	0.23
02-Nov	0.44	<1	<2	<1	11.7	0.18
06-Nov	0.54	<1	<2	<1	11.5	0.65

### 913 (11878 98A AVE) - 2023 TEST RESULTS

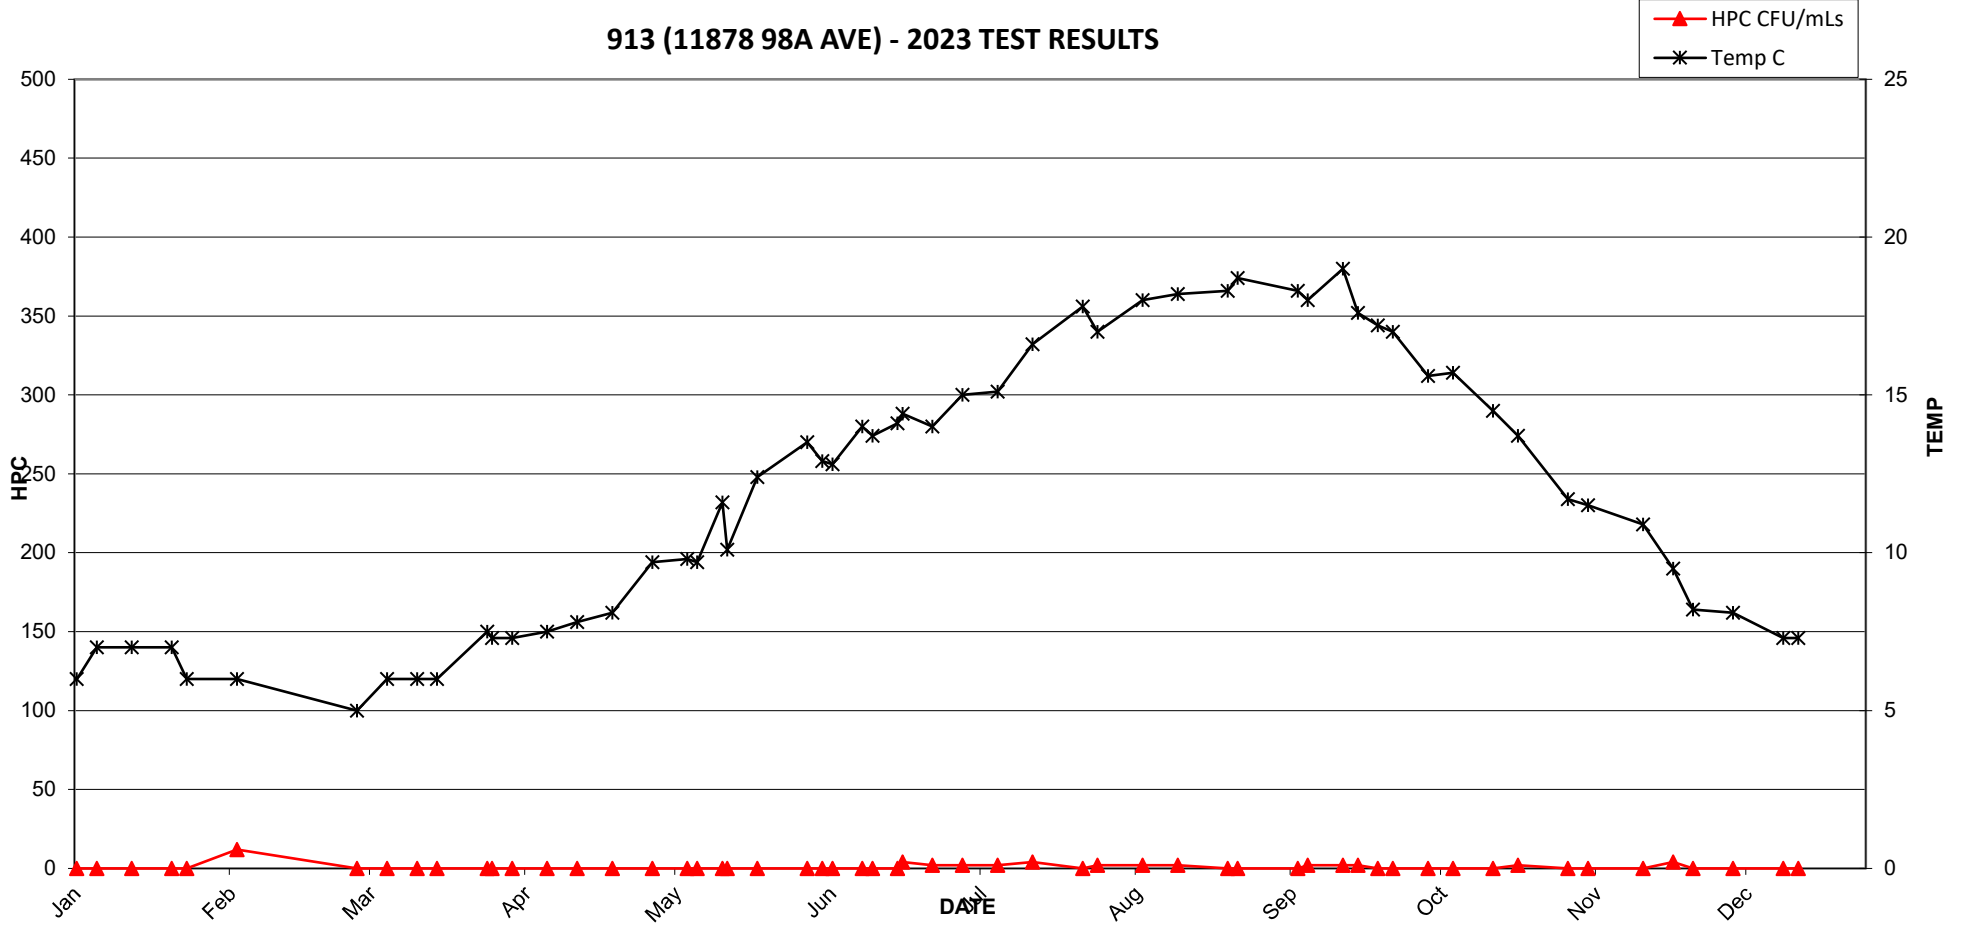


### 913 (11878 98A AVE) - 2023 TEST RESULTS

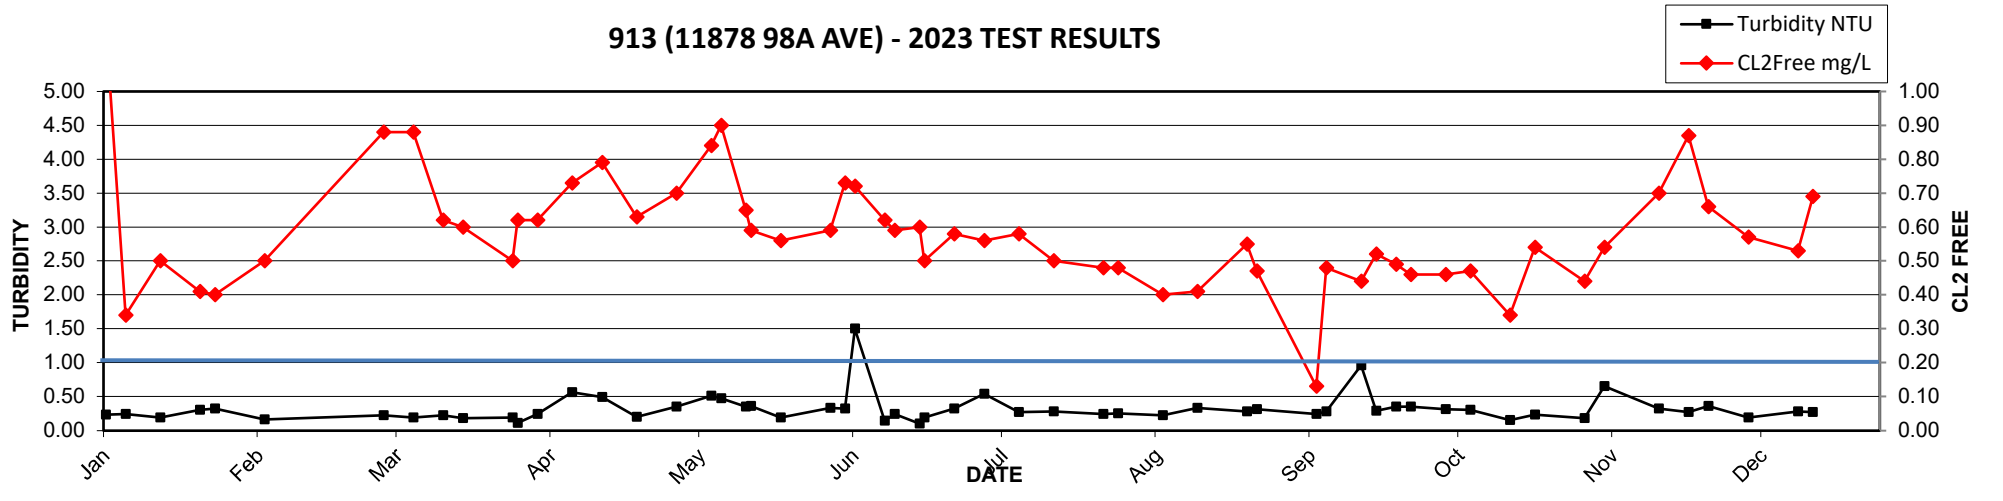


**2023 MV Laboratory Report - 914 (10478 132 ST)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
08-Jan	0.49	<1	<2	<1	7	0.27
24-May	0.46	<1	<2	<1	16	0.17
03-Jun	0.48	<1	<2	<1	16.3	0.21
06-Jun	0.37	<1	2	<1	17.3	0.16
08-Jun	0.46	<1	<2	<1	17.9	0.20
14-Jun	0.44	<1	<2	<1	16.9	0.14
16-Jun	0.42	<1	<2	<1	17	0.17
21-Jun	0.43	<1	4	<1	15.8	0.10
22-Jun	0.42	<1	12	<1	16	0.14
28-Jun	0.29	<1	6	<1	19	0.18
04-Jul	0.32	<1	<2	<1	20.4	0.21
11-Jul	0.26	<1	6	<1	20.4	0.21
18-Jul	0.41	<1	<2	<1	20.6	0.32
24-Jul	0.43	<1	40	<1	21.5	0.22
31-Jul	0.26	<1	16	<1	20.9	0.22
09-Aug	0.25	<1	10	<1	20.7	0.20
16-Aug	0.31	<1	<2	<1	21.5	0.23
26-Aug	0.29	<1	8	<1	20.7	0.21
28-Aug	0.26	<1	6	<1	21.3	0.33
09-Sep	0.29	<1	18	<1	19.1	0.18
11-Sep	0.29	<1	14	<1	20.2	0.20
18-Sep	0.16	<1	12	<1	19.3	0.28
21-Sep	0.16	<1	2	<1	19.2	0.23
25-Sep	0.10	<1	16	<1	18.7	0.37
28-Sep	0.23	<1	<2	<1	18	0.26
05-Oct	0.53	<1	2	<1	17.2	0.25
10-Oct	0.13	<1	<2	<1	17.3	0.23
18-Oct	0.15	<1	<2	<1	16.2	0.17
23-Oct	0.26	<1	<2	<1	15.2	0.17
02-Nov	0.23	<1	18	<1	13	0.19
06-Nov	0.31	<1	2	<1	13.1	0.17
23-Nov	0.28	<1	<2	<1	10.3	0.25
27-Nov	0.36	<1	2	<1	9.6	0.40
05-Dec	0.29	<1	<2	<1	9	0.26
15-Dec	0.38	<1	2	<1	7.5	0.25
18-Dec	0.47	<1	NA	<1	7.8	0.19

914 (10478 132 ST) - 2023 TEST RESULTS

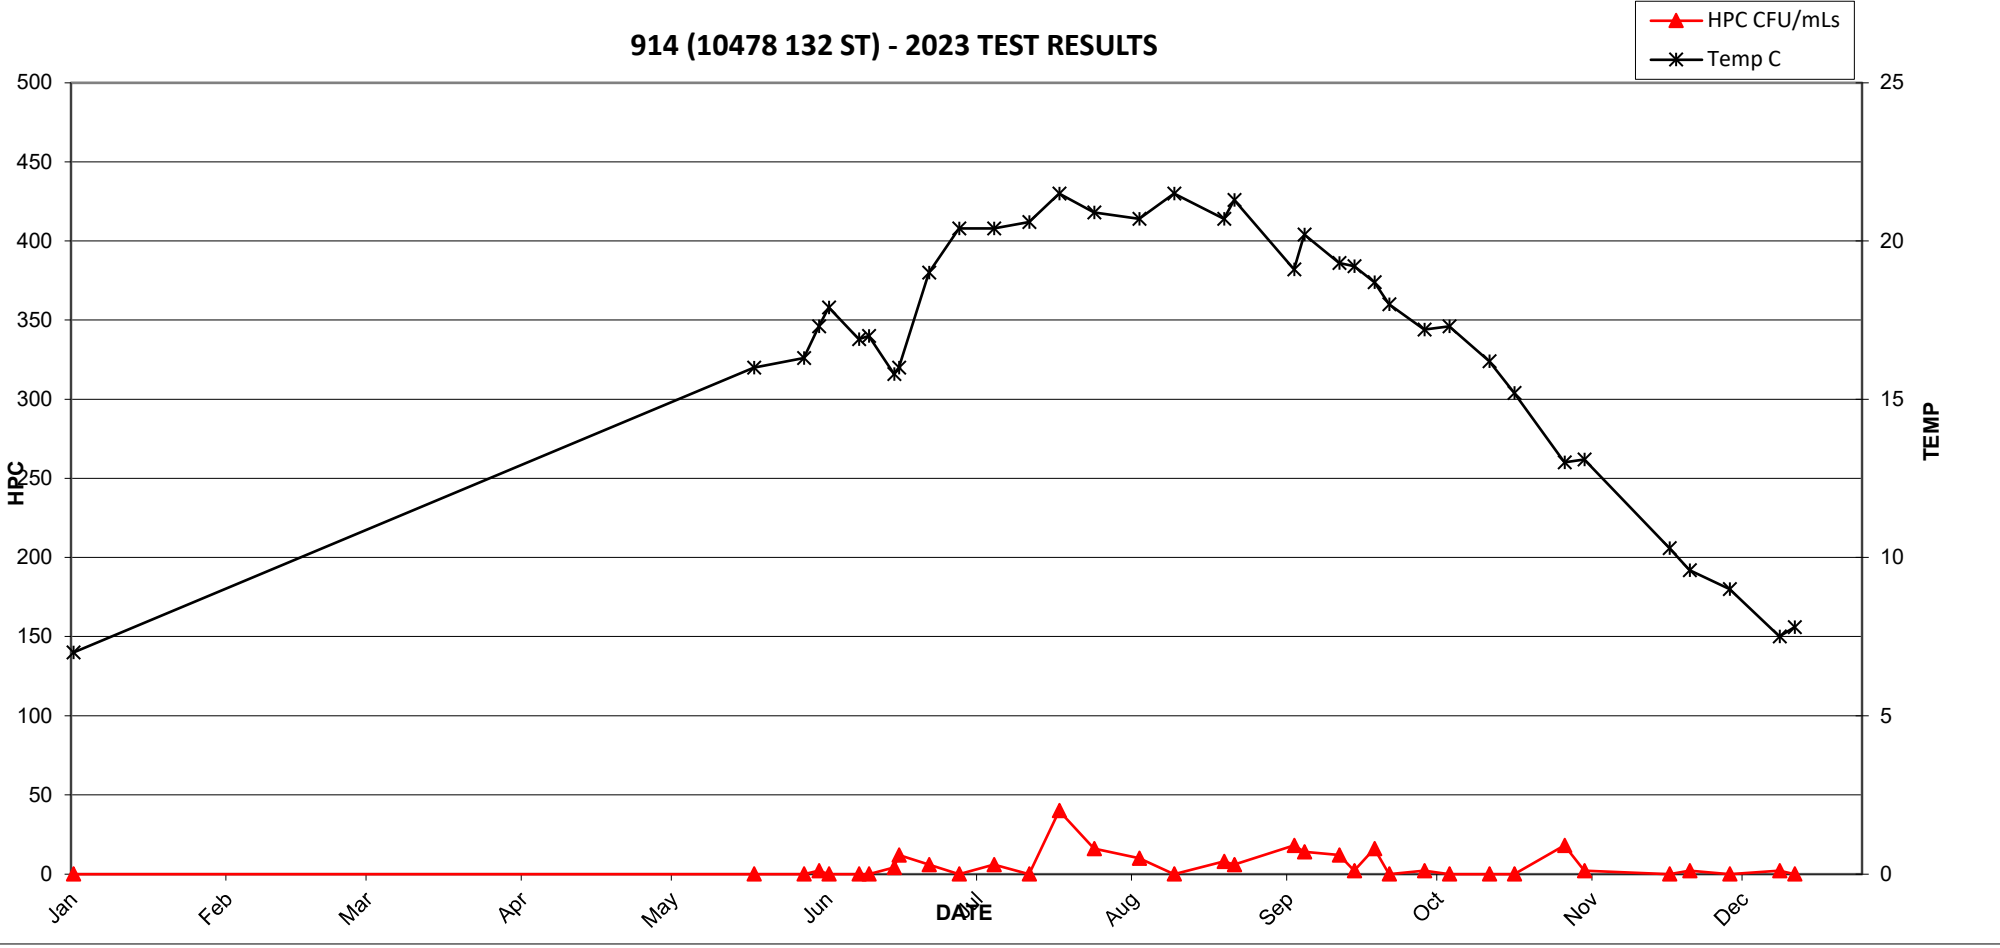


914 (10478 132 ST) - 2023 TEST RESULTS

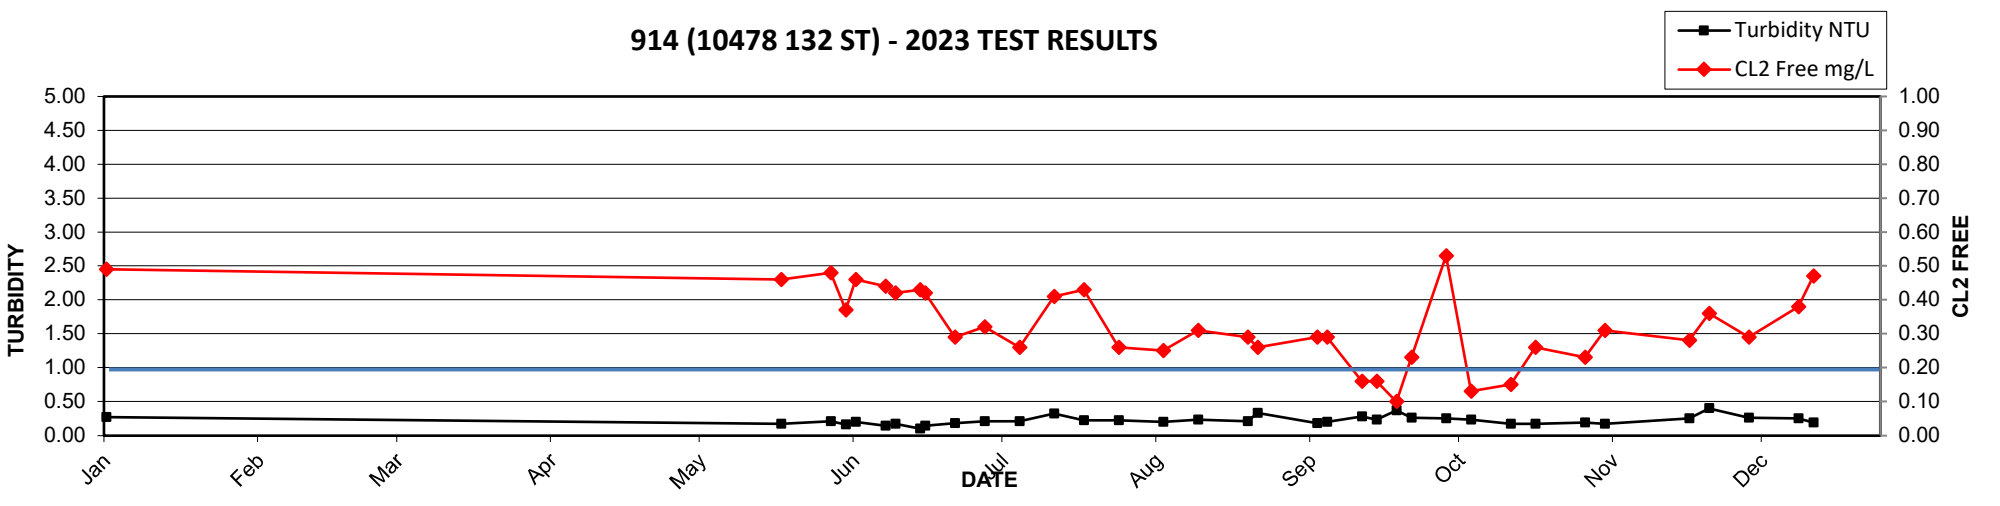


**2023 MV Laboratory Report - 915 (14620 105A AVE)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.63	<1	<2	<1	5	0.43
12-Jan	0.67	<1	<2	<1	5	0.41
18-Jan	1.07	<1	24	<1	5	0.67
26-Jan	1.03	<1	2	<1	5	0.49
03-Feb	0.94	<1	<2	<1	4	0.93
08-Feb	1.15	<1	<2	<1	5	2.00
15-Feb	0.85	<1	<2	<1	5	0.70
23-Feb	0.99	<1	<2	<1	4	1.00
15-Mar	1.11	<1	<2	<1	4.5	1.00
20-Mar	0.99	<1	<2	<1	5.8	0.82
27-Mar	0.99	<1	<2	<1	5	1.10
06-Apr	1.35	<1	<2	<1	5.5	1.10
12-Apr	1.13	<1	4	<1	5.8	1.40
20-Apr	0.90	<1	<2	<1	6.1	3.80
27-Apr	0.93	<1	<2	<1	6.3	1.20
02-May	0.92	<1	8	<1	6.1	1.80
10-May	0.94	<1	6	<1	6.2	0.95
16-May	1.05	<1	<2	<1	6.8	1.60
17-May	0.85	<1	2	<1	7.8	0.50
25-May	1.08	<1	<2	<1	7.1	0.67
31-May	0.86	<1	<2	<1	7.3	0.58
08-Jun	0.78	<1	<2	<1	8.5	0.86
09-Jun	0.88	<1	<2	<1	8.4	0.47
12-Jun	0.82	<1	<2	<1	8.6	0.48
20-Jun	0.96	<1	2	<1	8.9	0.55
28-Jun	1.00	<1	<2	<1	11	3.20
29-Jun	1.09	<1	<2	<1	11.8	0.28
06-Jul	0.92	<1	<2	<1	13.8	2.30
12-Jul	0.98	<1	2	<1	12.4	0.70
19-Jul	0.82	<1	<2	<1	15.3	0.35
25-Jul	1.23	<1	<2	<1	14.5	0.33
01-Aug	0.83	<1	<2	<1	14.8	0.60
10-Aug	0.84	<1	<2	<1	15.7	0.57
17-Aug	0.82	<1	<2	16.7	8.2	<1
24-Aug	0.84	<1	<2	<1	16.4	0.70
30-Aug	0.96	<1	<2	<1	16.9	0.75
06-Sep	1.15	<1	2	<1	17.3	1.00
13-Sep	0.82	<1	<2	<1	16.2	0.59
21-Sep	1.06	<1	<2	<1	15.3	0.44
03-Oct	0.95	<1	<2	<1	14	0.54
10-Oct	1.03	<1	<2	<1	13.6	0.47
17-Oct	0.92	<1	<2	<1	9.8	0.46
20-Oct	0.94	<1	<2	<1	12.2	2.00
23-Oct	1.33	<1	<2	<1	11.7	0.84
31-Oct	1.20	<1	<2	<1	10.5	0.44
08-Nov	0.96	<1	<2	<1	10	0.58
14-Nov	0.97	<1	<2	<1	8.4	0.47
21-Nov	1.03	<1	2	<1	7.9	0.44
28-Nov	1.05	<1	<2	<1	7.3	0.54
06-Dec	1.34	<1	<2	<1	7.1	3.10

### 915 (14620 105A AVE) - 2023 TEST RESULTS

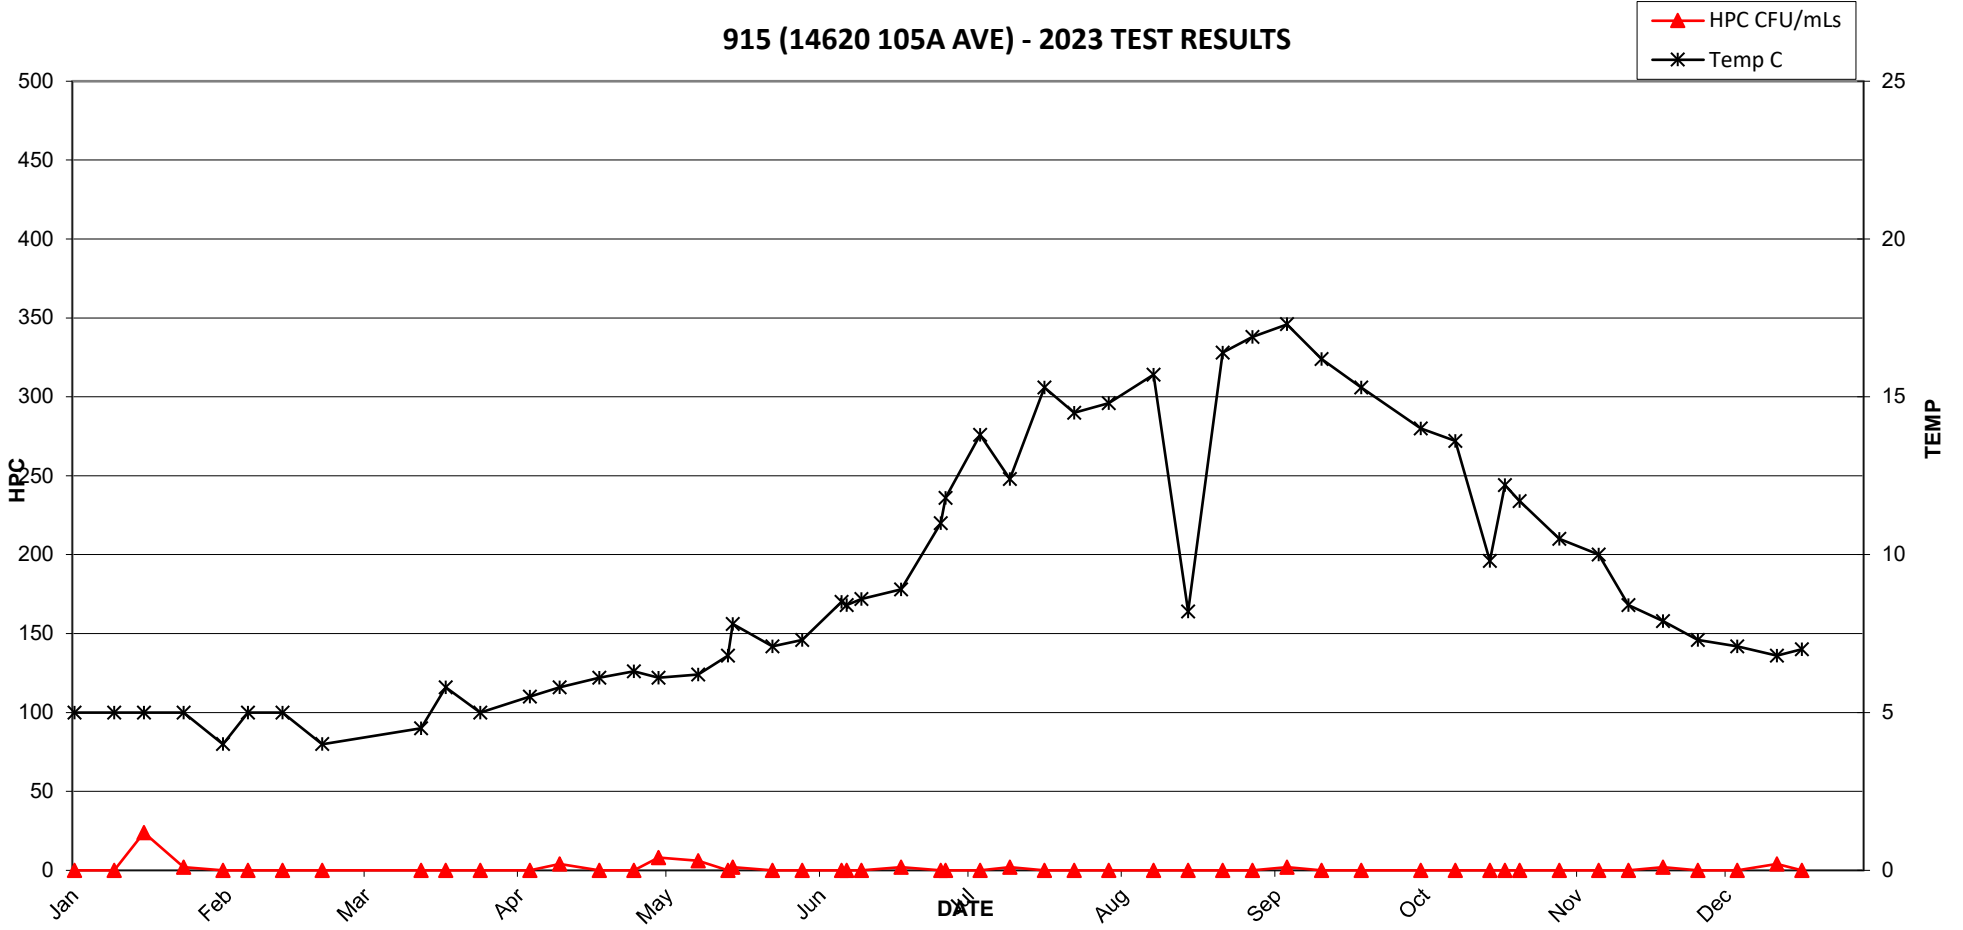

### 915 (14620 105A AVE) - 2023 TEST RESULTS

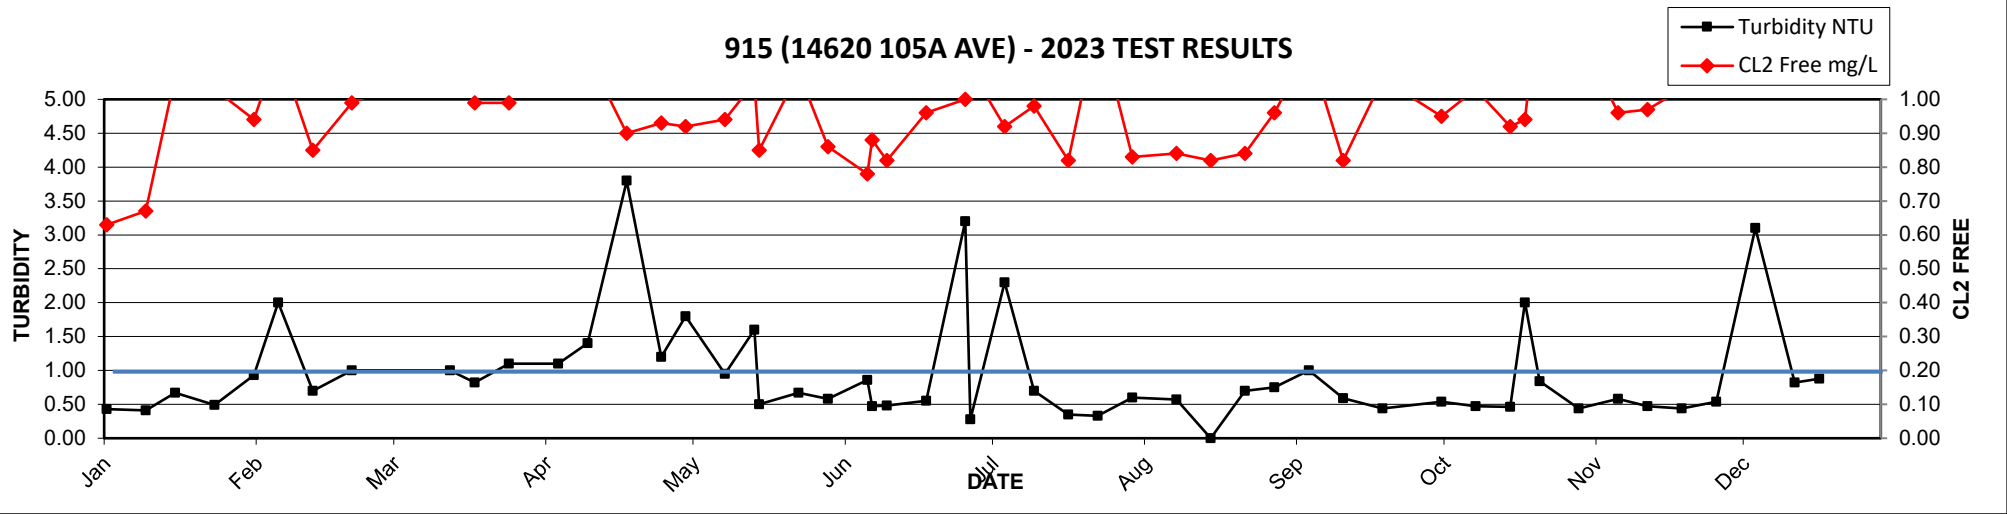


**2023 MV Laboratory Report - 916 (13705 97A AVE)**


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.67	<1	<2	<1	6	0.30
12-Jan	0.59	<1	2	<1	6	0.34
18-Jan	0.57	<1	<2	<1	7	0.24
26-Jan	0.81	<1	<2	<1	6	0.24
08-Feb	0.98	<1	<2	<1	6	0.50
15-Feb	0.59	<1	<2	<1	6	0.26
23-Feb	0.82	<1	2	<1	6	0.24
25-Feb	0.91	<1	<2	<1	6	0.24
11-Mar	0.67	<1	<2	<1	5.9	0.13
15-Mar	0.71	<1	<2	<1	5.5	0.13
20-Mar	0.52	<1	<2	<1	6.6	0.15
27-Mar	0.81	<1	<2	<1	6.7	0.17
06-Apr	0.62	<1	<2	<1	7	0.21
12-Apr	0.61	<1	<2	<1	7.6	0.62
20-Apr	0.71	<1	<2	<1	7.5	0.38
27-Apr	0.69	<1	<2	<1	8	0.18
02-May	0.40	<1	2	<1	8.8	0.23
10-May	0.89	<1	<2	<1	8.8	0.34
17-May	0.67	<1	4	<1	9	0.32
25-May	0.64	<1	4	<1	11.8	0.20
31-May	0.60	<1	<2	<1	12.5	0.15
08-Jun	0.70	<1	34	<1	12.5	0.46
09-Jun	0.58	<1	<2	<1	12.7	0.11
12-Jun	0.66	<1	36	<1	14.4	0.16
20-Jun	0.51	<1	6	<1	13	0.17
28-Jun	0.68	<1	4	<1	13	0.25
07-Jul	0.78	<1	<2	<1	13.1	0.32
12-Jul	0.39	<1	36	<1	14.3	0.22
19-Jul	0.55	<1	4	<1	15	0.20
25-Jul	0.25	<1	8	<1	15.5	0.20
01-Aug	0.81	<1	2	<1	15.5	0.40
10-Aug	0.41	<1	320	<1	18.4	0.19
17-Aug	0.27	<1	130	18.4	8.5	<1
24-Aug	0.38	<1	310	<1	18.5	0.31
30-Aug	0.28	<1	790	<1	18.9	0.24
06-Sep	0.44	<1	210	<1	16.3	0.22
15-Sep	0.69	<1	290	<1	16.3	0.37
21-Sep	0.81	<1	360	<1	16.8	0.23
10-Oct	0.55	<1	240	<1	14.1	0.23
17-Oct	0.1	<1	180	<1	16	0.17
23-Oct	0.20	<1	140	<1	15	0.16
31-Oct	0.18	<1	100	<1	13.2	0.23
08-Nov	0.19	<1	80	<1	12.6	0.29
14-Nov	0.27	<1	40	<1	11.8	0.25
21-Nov	0.28	<1	28	<1	10.7	0.30
28-Nov	0.20	<1	12	<1	9.8	0.31
06-Dec	0.27	<1	42	<1	9	0.34
14-Dec	0.42	<1	4	<1	8.5	0.18
19-Dec	0.61	<1	NA	<1	8.2	0.13



### 916 (13705 97A AVE) - 2023 TEST RESULTS

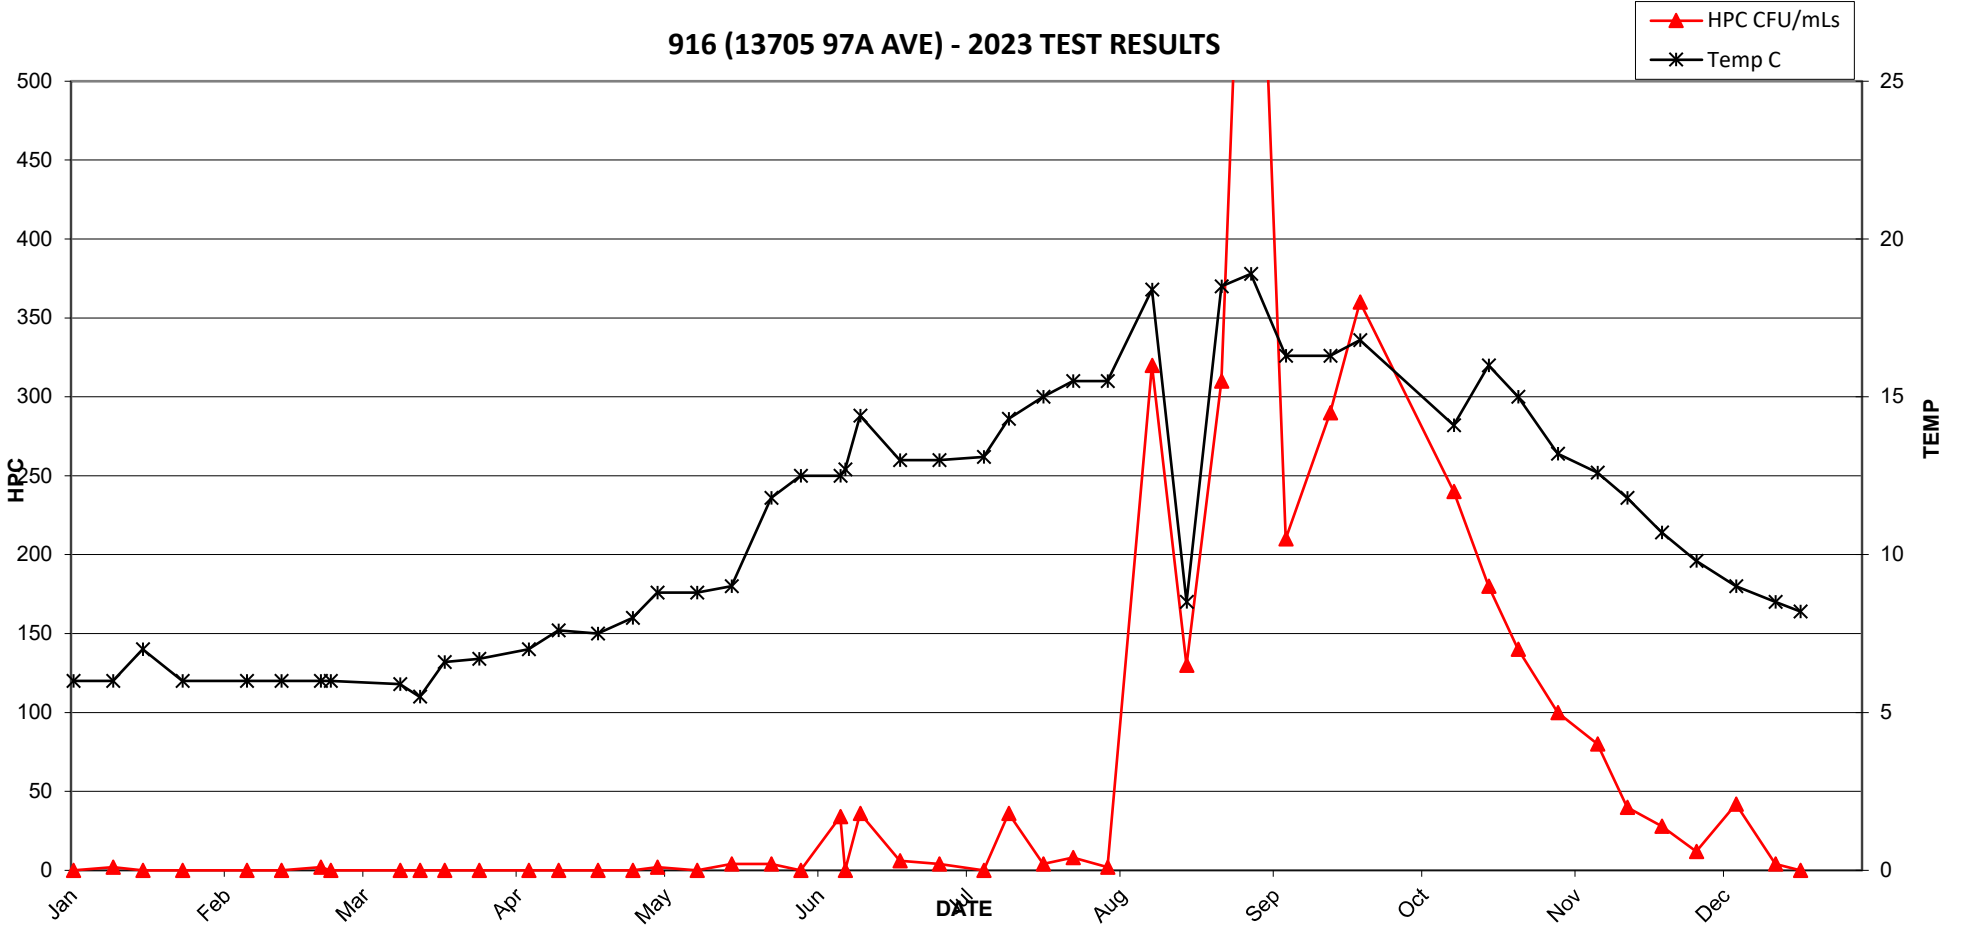


### 916 (13705 97A AVE) - 2023 TEST RESULTS

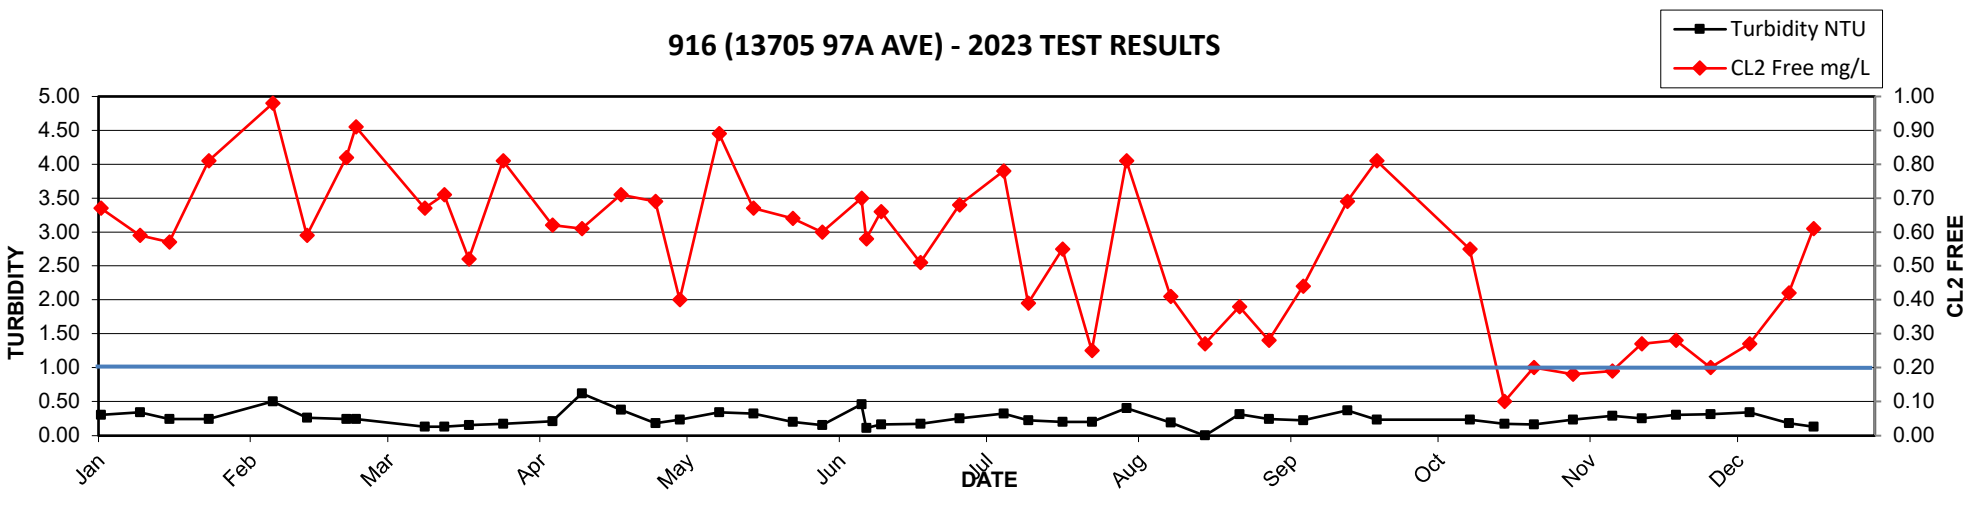


**2023 MV Laboratory Report - 917 (13031 LANARK PL)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.79	<1	<2	<1	6	0.32
12-Jan	1.01	<1	<2	<1	6	0.35
18-Jan	0.57	<1	<2	<1	6	0.16
26-Jan	0.87	<1	<2	<1	6	0.25
03-Feb	0.94	<1	<2	<1	6	0.33
08-Feb	0.65	<1	<2	<1	6	0.20
15-Feb	0.64	<1	<2	<1	6	0.22
23-Feb	0.67	<1	<2	<1	6	0.35
25-Feb	0.93	<1	<2	<1	6	0.33
11-Mar	0.60	<1	<2	<1	5.3	0.15
15-Mar	0.77	<1	20	<1	5.4	0.20
20-Mar	0.55	<1	<2	<1	5.7	0.14
27-Mar	0.77	<1	<2	<1	6.1	0.17
06-Apr	0.71	<1	<2	<1	7	0.14
12-Apr	1.02	<1	<2	<1	7.8	0.55
20-Apr	0.67	<1	<2	<1	7.3	0.22
24-Apr	0.31	<1	<2	<1	7.4	0.22
02-May	0.62	<1	8	<1	8.6	0.24
10-May	0.87	<1	2	<1	8.7	0.39
17-May	0.60	<1	2	<1	10.8	0.23
25-May	0.69	<1	<2	<1	11.4	0.25
31-May	0.60	<1	<2	<1	12.1	0.22
07-Jun	0.56	<1	8	<1	13	0.27
08-Jun	0.68	<1	<2	<1	11.1	0.31
09-Jun	0.56	<1	4	<1	11.8	0.16
12-Jun	0.49	<1	<2	<1	13.3	0.21
20-Jun	0.53	<1	<2	<1	12.5	0.27
28-Jun	0.51	<1	6	<1	13	0.23
29-Jun	0.78	<1	<2	<1	11	0.27
06-Jul	0.74	<1	<2	<1	12.6	0.30
12-Jul	0.74	<1	14	<1	14.7	0.21
19-Jul	0.74	<1	2	<1	15.6	0.24
24-Jul	0.65	<1	<2	<1	16	0.33
25-Jul	0.62	<1	<2	<1	16.6	0.21
26-Jul	0.63	<1	<2	<1	16	0.31
01-Aug	0.76	<1	<2	<1	15.3	0.44
03-Aug	0.72	<1	<2	<1	15.1	0.39
10-Aug	0.26	<1	2	<1	16.6	0.24
17-Aug	0.67	<1	2	16.9	8.2	<1
24-Aug	0.62	<1	<2	<1	16.9	0.28
30-Aug	0.69	<1	<2	<1	16.8	0.27
06-Sep	0.62	<1	<2	<1	16.4	0.42
13-Sep	0.66	<1	<2	<1	16.9	0.29
21-Sep	0.83	<1	2	<1	16.1	0.44
28-Sep	0.75	<1	<2	<1	16	0.41
03-Oct	0.66	<1	<2	<1	15	0.39
10-Oct	0.66	<1	6	<1	14.4	0.55
11-Oct	0.70	<1	<2	<1	14.5	0.44

### 917 (13031 LANARK PL) - 2023 TEST RESULTS


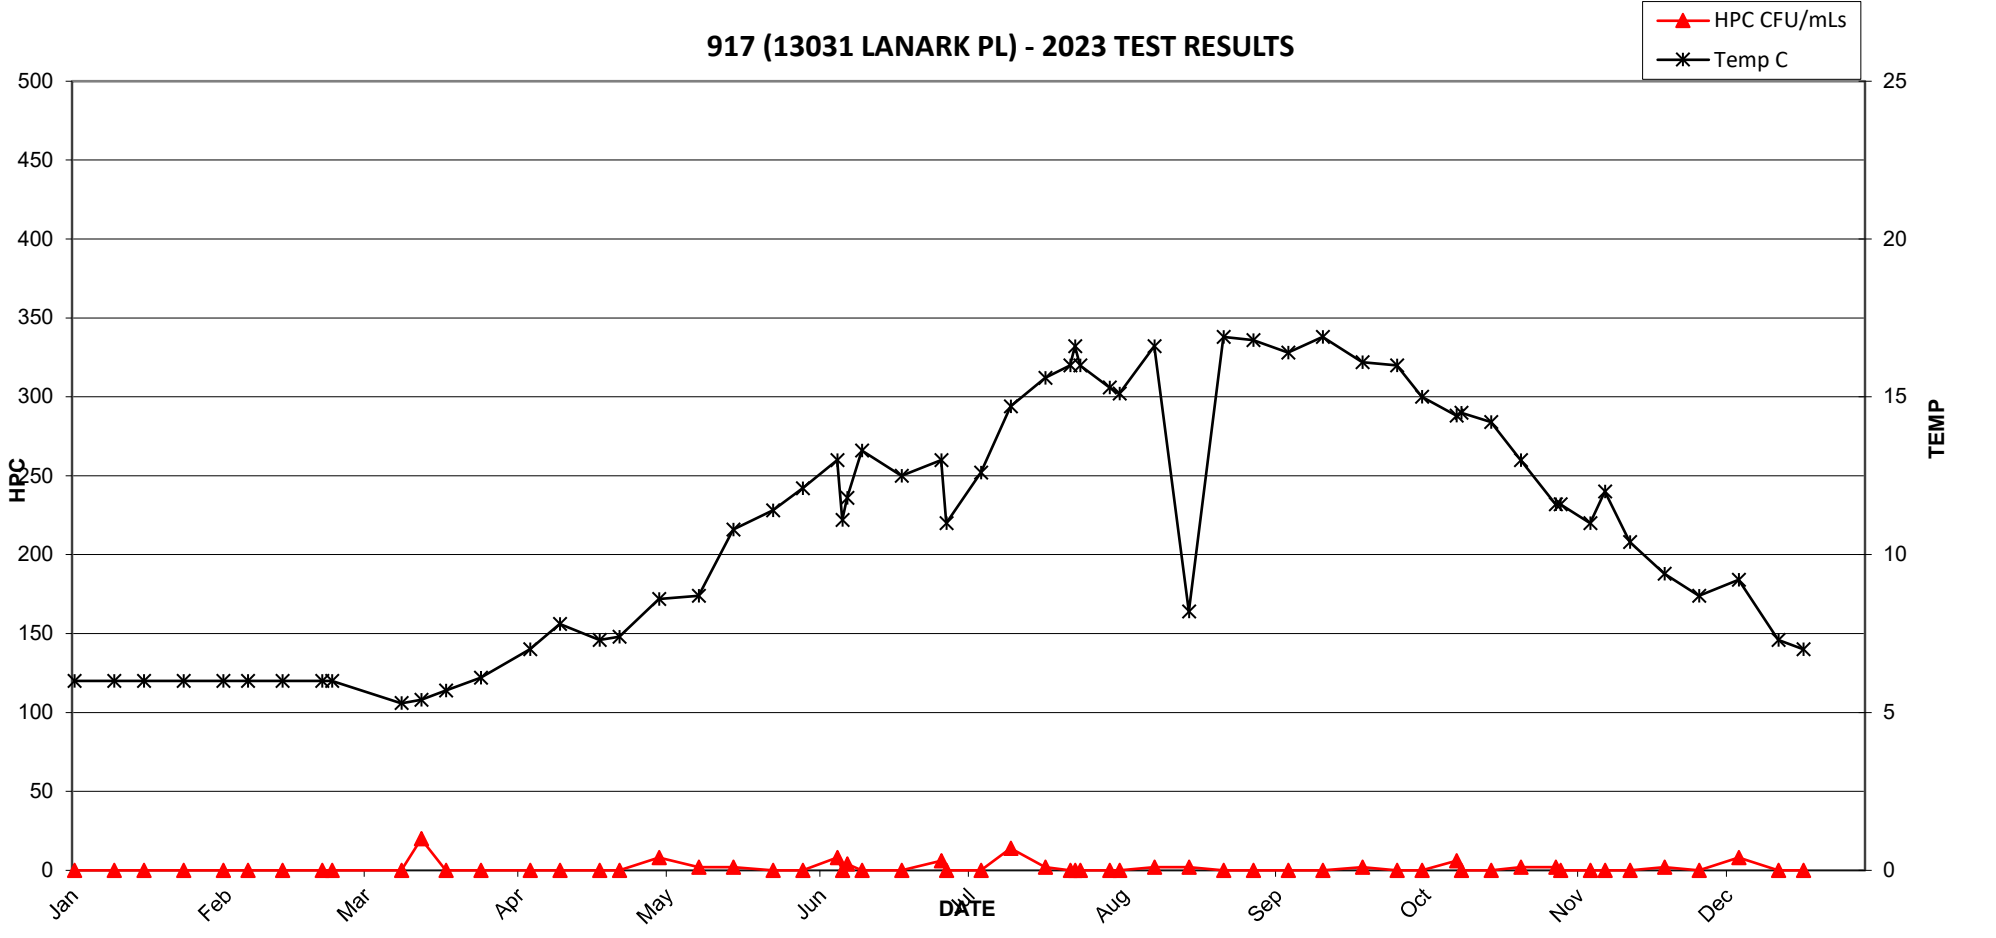


### 917 (13031 LANARK PL) - 2023 TEST RESULTS

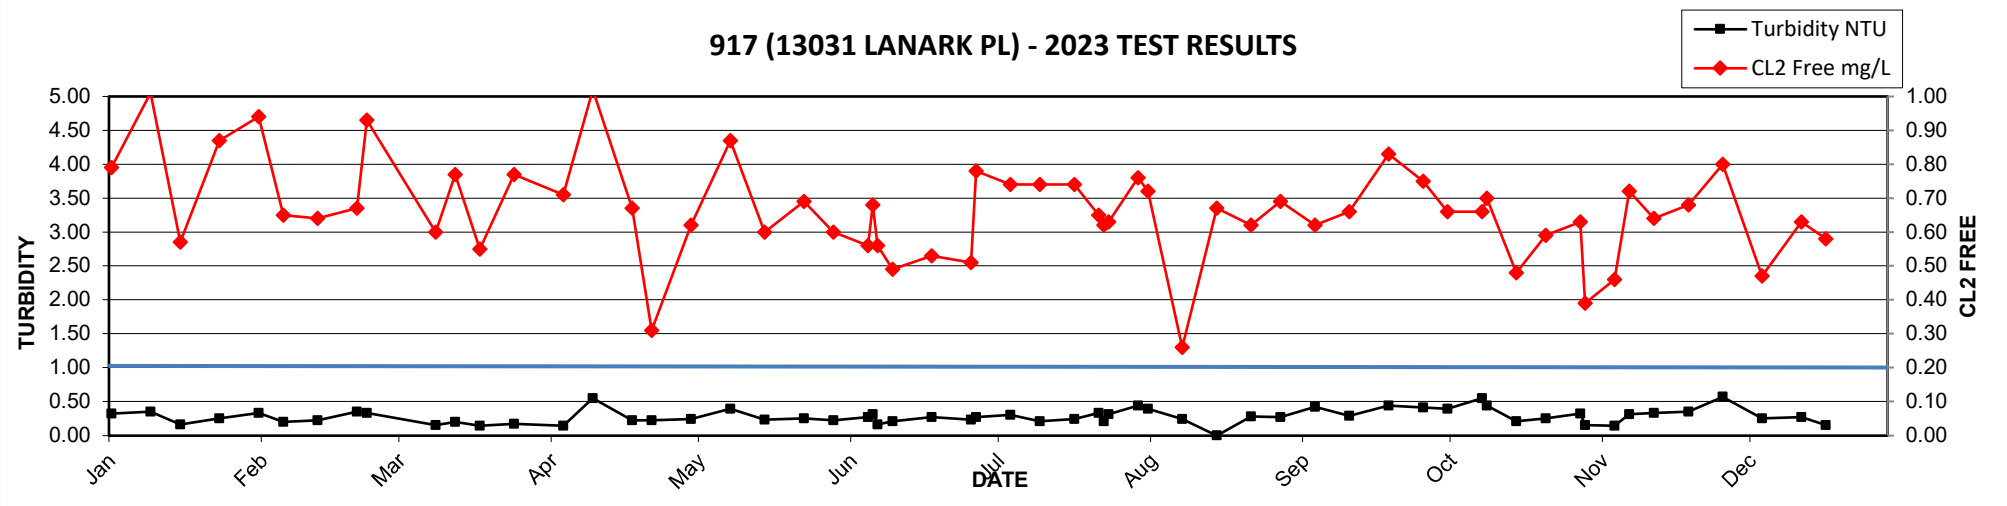



**2023 MV Laboratory Report - 918 (13738 GLEN PL)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.72	<1	<2	<1	5	0.35
12-Jan	0.42	<1	<2	<1	6	0.28
18-Jan	0.85	<1	2	<1	6	0.29
26-Jan	1.05	<1	<2	<1	5	0.27
27-Jan	0.60	<1	<2	<1	6	0.35
03-Feb	0.88	<1	<2	<1	6	0.49
08-Feb	0.73	<1	<2	<1	5	0.27
15-Feb	0.87	<1	<2	<1	5	0.36
23-Feb	0.86	<1	<2	<1	5	0.35
24-Feb	0.81	<1	<2	<1	6	0.36
25-Feb	0.99	<1	<2	<1	5	0.31
11-Mar	0.99	<1	<2	<1	5.2	0.27
15-Mar	1.00	<1	<2	<1	5.1	0.32
20-Mar	0.92	<1	2	<1	6.2	0.28
27-Mar	0.66	<1	<2	<1	6.9	0.13
06-Apr	0.75	<1	<2	<1	6.9	0.47
20-Apr	0.67	<1	<2	<1	6.8	0.62
24-Apr	1.00	<1	<2	<1	7.1	0.29
02-May	0.76	<1	4	<1	7.1	0.33
10-May	0.93	<1	<2	<1	7.8	0.40
17-May	0.59	<1	<2	<1	9	0.30
25-May	0.94	<1	2	<1	9.7	0.33
31-May	0.61	<1	<2	<1	10.7	0.47
07-Jun	0.35	<1	20	<1	11.5	0.34
08-Jun	0.65	<1	4	<1	11.4	0.55
09-Jun	0.79	<1	<2	<1	11	0.24
12-Jun	0.79	<1	<2	<1	10.1	0.26
20-Jun	0.89	<1	<2	<1	11.4	0.35
28-Jun	0.41	<1	46	<1	14	0.24
06-Jul	0.53	<1	24	<1	15.2	0.25
12-Jul	0.55	<1	100	<1	15.7	0.19
19-Jul	0.59	<1	84	<1	16.3	0.20
25-Jul	0.80	<1	24	<1	17.7	0.22
26-Jul	0.62	<1	20	<1	17.5	0.35
01-Aug	0.94	<1	24	<1	15.7	0.44
03-Aug	0.53	<1	8	<1	17	0.30
10-Aug	0.44	<1	8	<1	18.4	0.25
17-Aug	0.58	<1	24	18.7	8.2	<1
24-Aug	0.47	<1	22	<1	18.6	0.29
30-Aug	0.51	<1	4	<1	18.3	0.27
06-Sep	0.91	<1	2	<1	17.3	0.41
13-Sep	0.75	<1	2	<1	18.2	0.29
21-Sep	0.76	<1	2	<1	15.9	0.44
28-Sep	0.65	<1	<2	<1	16	0.33
03-Oct	0.84	<1	<2	<1	15	0.32
10-Oct	0.78	<1	<2	<1	15	0.31
11-Oct	0.81	<1	<2	<1	14.7	0.31
17-Oct	0.70	<1	4	<1	14.4	0.25
23-Oct	0.93	<1	<2	<1	12.7	0.43
06-Nov	0.98	<1	<2	<1	10.7	0.25
14-Nov	0.87	<1	<2	<1	9.1	0.43

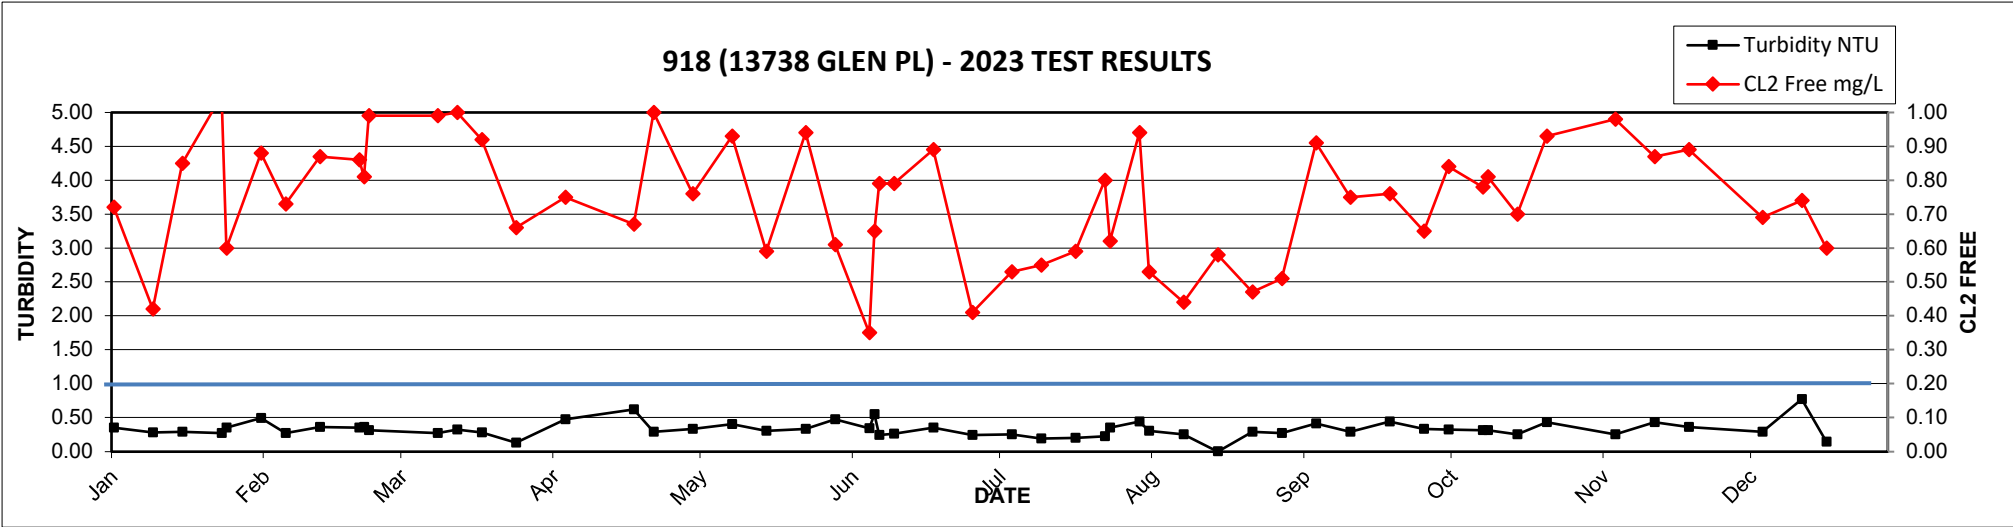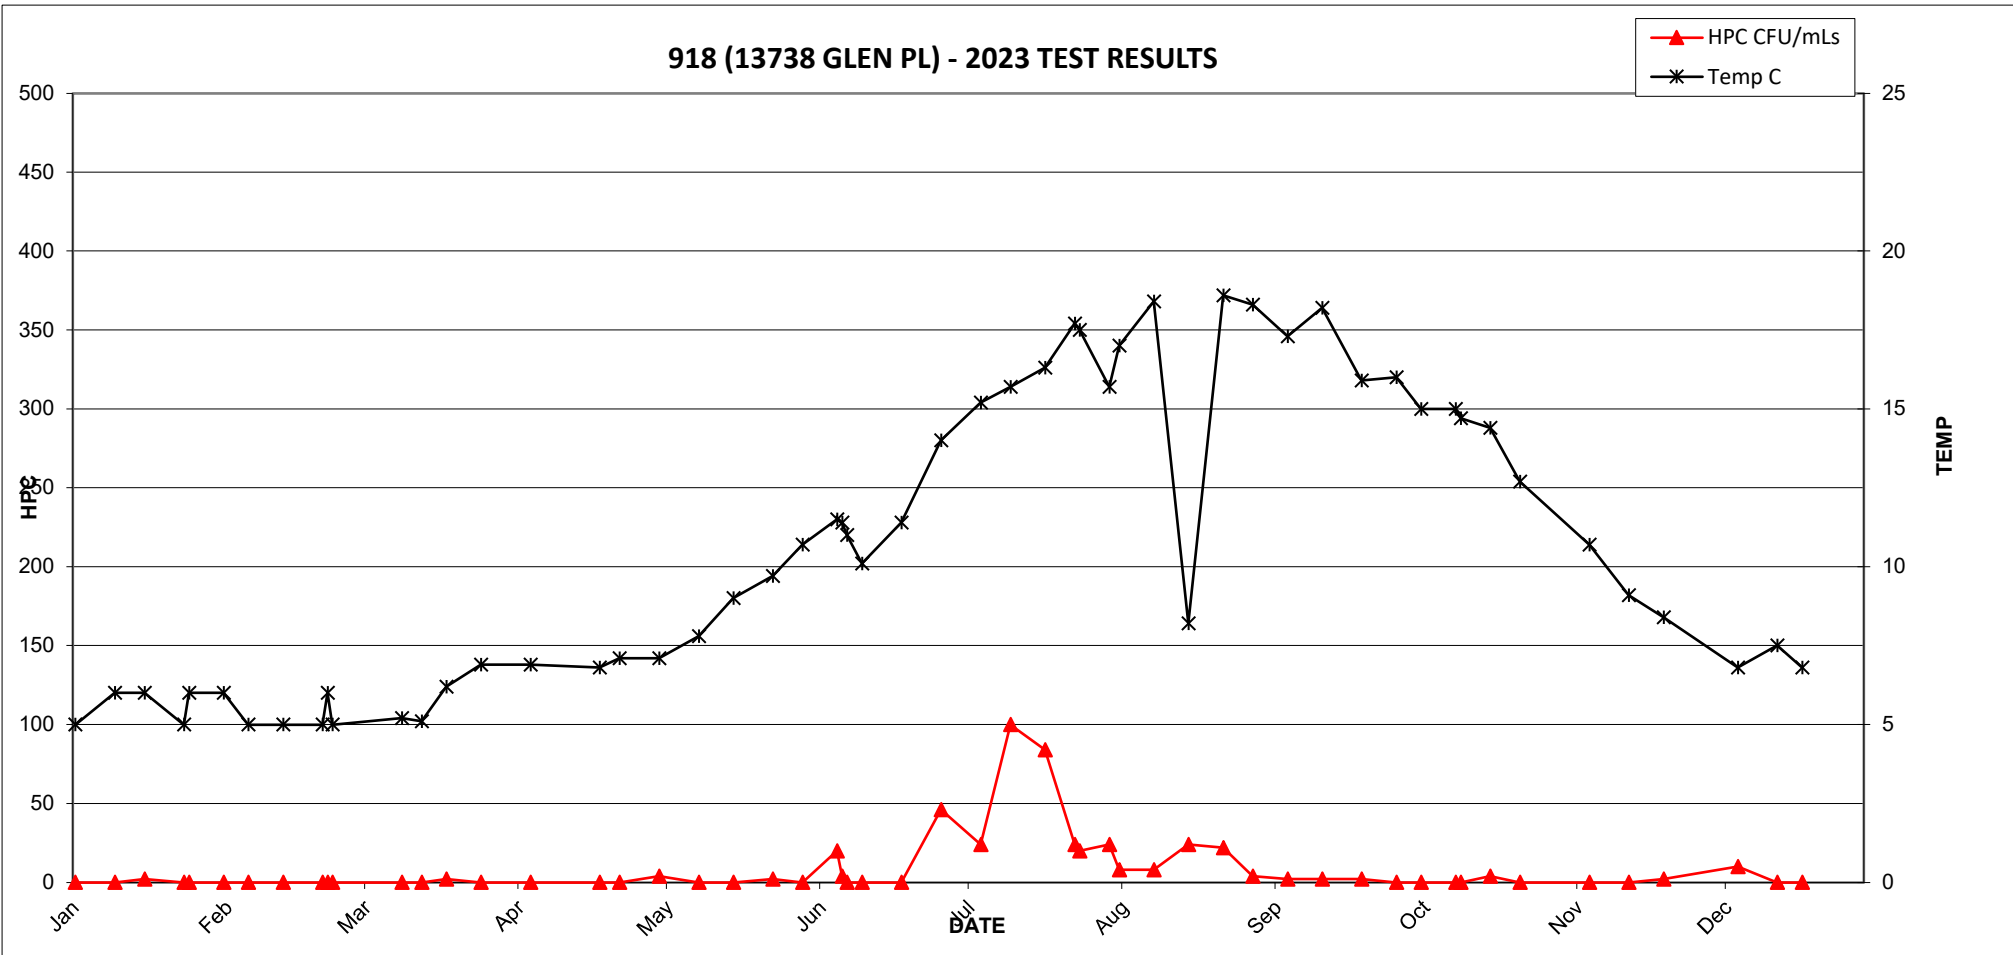

**2023 MV Laboratory Report - 919 (15091 92A AVE)**



<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.39	<1	<2	<1	6	0.34
12-Jan	0.61	<1	2	<1	7	1.00
18-Jan	0.34	<1	<2	<1	7	0.32
26-Jan	0.36	<1	<2	<1	7	0.25
02-Feb	0.46	<1	<2	<1	7	0.38
08-Feb	0.32	<1	<2	<1	6	0.28
15-Feb	0.43	<1	2	<1	6	0.32
23-Feb	0.47	<1	<2	<1	6	0.26
25-Feb	0.45	<1	<2	<1	6	0.27
11-Mar	0.50	<1	<2	<1	5.6	0.26
15-Mar	0.39	<1	<2	<1	7	0.25
20-Mar	0.57	<1	<2	<1	6.8	0.38
27-Mar	0.44	<1	<2	<1	6.9	0.45
06-Apr	0.37	<1	2	<1	7.7	0.72
12-Apr	0.44	<1	<2	<1	8.1	0.58
20-Apr	0.26	<1	<2	<1	7.5	0.55
24-Apr	0.40	<1	<2	<1	8	0.55
26-Apr	0.24	<1	<2	<1	8	0.47
02-May	0.33	<1	<2	<1	8.8	0.61
10-May	0.38	<1	6	<1	9.5	0.34
17-May	0.41	<1	<2	<1	10.5	0.37
25-May	0.41	<1	2	<1	10.9	0.36
31-May	0.38	<1	<2	<1	11.2	0.31
05-Jun	0.28	<1	2	<1	12	0.38
08-Jun	0.32	<1	<2	<1	12	0.55
09-Jun	0.26	<1	2	<1	12.5	0.21
12-Jun	0.40	<1	<2	<1	12.8	0.26
20-Jun	0.24	<1	6	<1	12.7	0.31
28-Jun	0.25	<1	2	<1	13	0.26
29-Jun	0.35	<1	<2	<1	12.9	0.20
06-Jul	0.28	<1	2	<1	13.6	0.29
11-Jul	0.27	<1	6	<1	14.5	0.26
19-Jul	0.33	<1	8	<1	15.3	0.28
25-Jul	0.25	<1	6	<1	16.3	0.27
27-Jul	0.25	<1	8	<1	16	0.29
01-Aug	0.24	<1	4	<1	16.1	0.37
10-Aug	0.19	<1	<2	<1	16.7	0.22
17-Aug	0.20	<1	2	17.3	8.1	<1
24-Aug	0.20	<1	<2	<1	17.3	0.33
30-Aug	0.11	<1	6	<1	17.5	0.25
06-Sep	0.23	<1	6	<1	16.6	0.30
13-Sep	0.39	<1	8	<1	16.6	0.27
21-Sep	0.24	<1	4	<1	17.1	0.36
03-Oct	0.23	<1	6	<1	16	0.33
13-Oct	0.25	<1	<2	<1	15.1	0.31
17-Oct	0.24	<1	2	<1	15.2	0.26
23-Oct	0.23	<1	2	<1	13.9	0.49
31-Oct	0.22	<1	4	<1	12.3	0.38
06-Nov	0.28	<1	4	<1	11.7	0.30
09-Nov	0.26	<1	2	<1	11.8	0.41

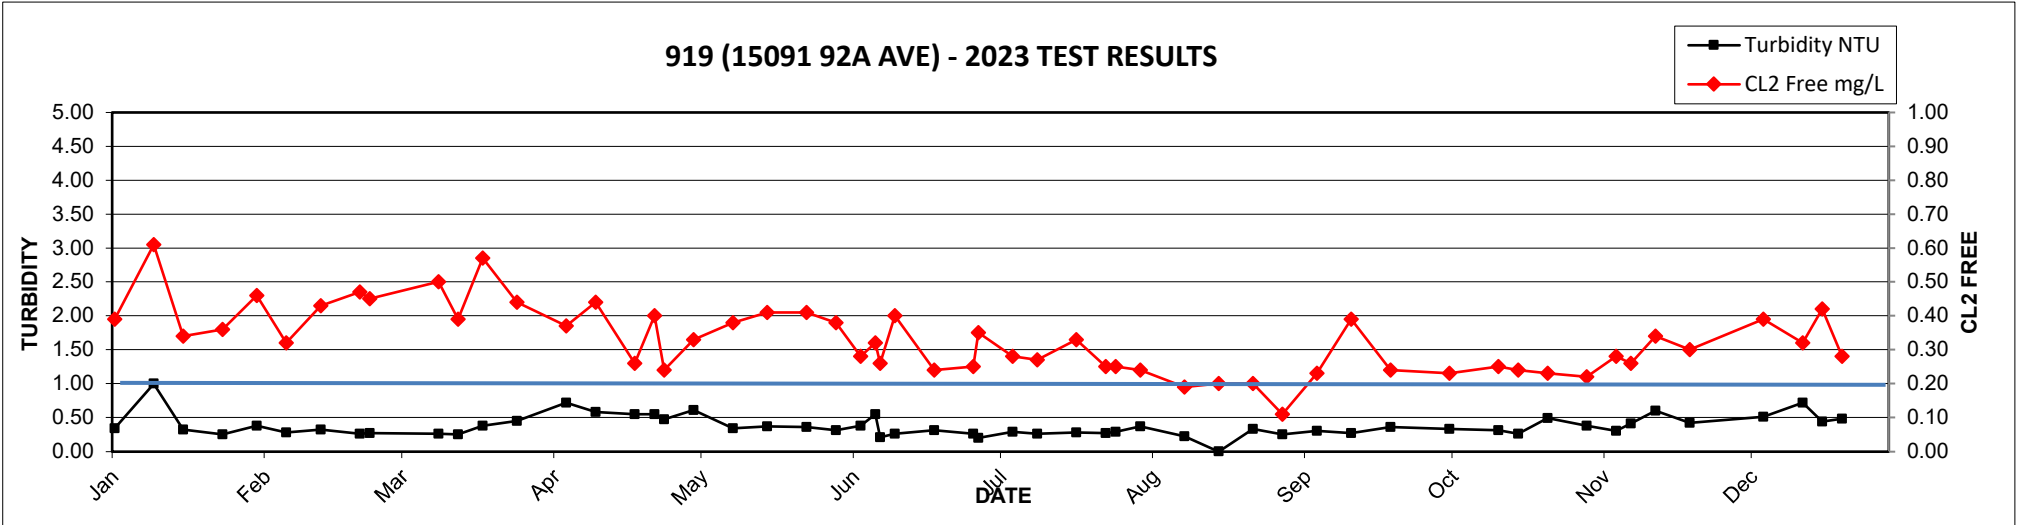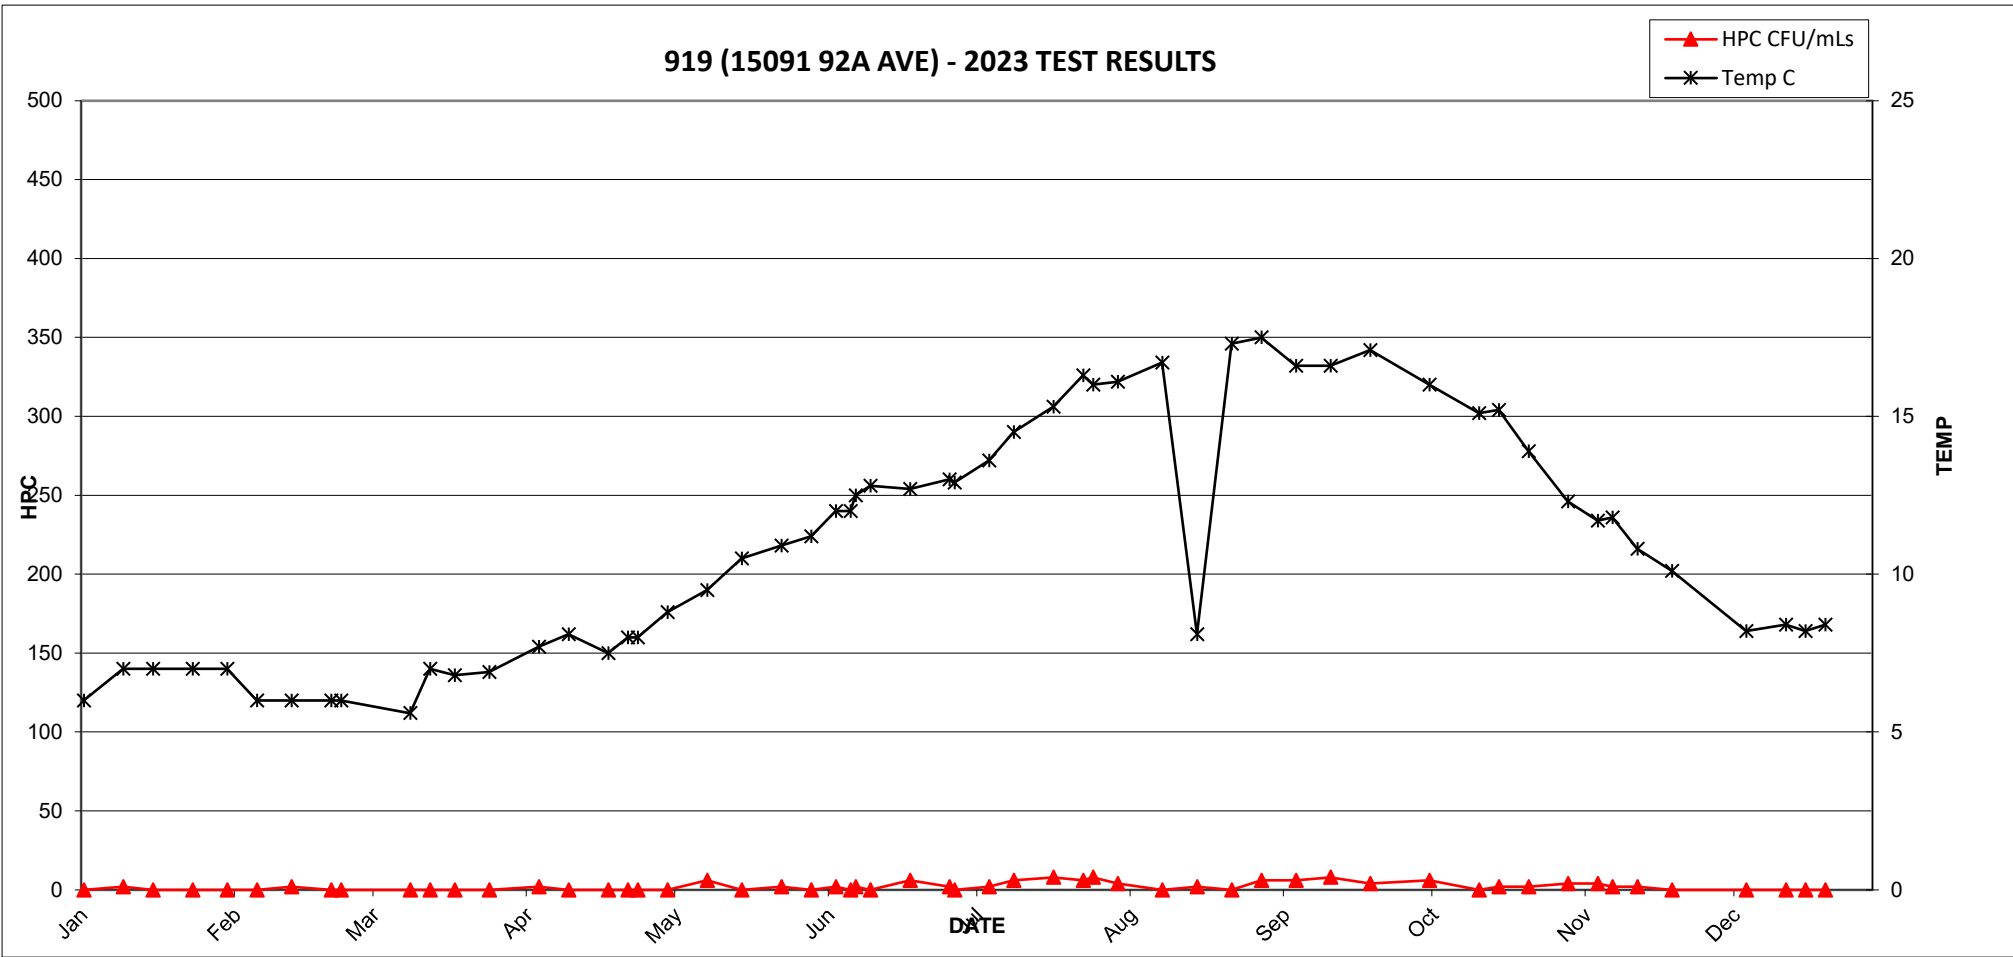

**2023 MV Laboratory Report - 920 (16222 90 AVE)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
12-Jan	0.77	<1	4	<1	6	0.12
18-Jan	0.33	<1	2	<1	7	0.30
26-Jan	0.28	<1	<2	<1	7	0.33
08-Feb	0.31	<1	<2	<1	6	0.32
15-Feb	0.31	<1	<2	<1	6	0.51
23-Feb	0.32	<1	8	<1	6	0.33
25-Feb	0.29	<1	<2	<1	6	0.51
11-Mar	0.30	<1	<2	<1	5.8	0.31
15-Mar	0.37	<1	<2	<1	6.3	0.44
20-Mar	0.31	<1	<2	<1	6.9	0.33
27-Mar	0.71	<1	2	<1	7	0.39
06-Apr	0.25	<1	<2	<1	7.7	0.71
20-Apr	0.41	<1	2	<1	7.9	0.63
24-Apr	0.54	<1	4	<1	7.9	0.51
27-Apr	0.50	<1	2	<1	7.9	0.57
02-May	0.31	<1	<2	<1	9	0.48
08-May	0.22	<1	8	<1	9.6	0.45
10-May	0.27	<1	<2	<1	9.8	0.40
17-May	0.26	<1	16	<1	11	0.31
25-May	0.18	<1	8	<1	11.8	0.39
31-May	0.21	<1	<2	<1	11.7	0.46
05-Jun	0.41	<1	34	<1	11.8	0.45
08-Jun	0.22	<1	4	<1	12.5	0.45
09-Jun	0.16	<1	8	<1	13.5	0.21
12-Jun	0.16	<1	36	<1	13.6	0.24
20-Jun	0.21	<1	8	<1	13.1	0.34
28-Jun	0.19	<1	36	<1	13	0.30
29-Jun	0.18	<1	4	<1	13.6	0.30
06-Jul	0.55	<1	80	<1	14.1	0.33
11-Jul	0.70	<1	110	<1	14.8	0.31
19-Jul	0.26	<1	46	<1	16.2	0.29
25-Jul	0.18	<1	48	<1	17.1	0.37
01-Aug	0.24	<1	50	<1	16.6	0.34
10-Aug	0.11	<1	40	<1	18.2	0.25
17-Aug	0.16	<1	28	18.9	8	<1
24-Aug	0.17	<1	48	<1	18.7	0.35
30-Aug	0.08	<1	12	<1	18.4	0.20
06-Sep	0.25	<1	120	<1	18.2	0.34
13-Sep	0.23	<1	8	<1	17.9	0.32
19-Sep	0.28	<1	<2	<1	16.2	0.37
21-Sep	0.22	<1	8	<1	17.1	0.33
03-Oct	0.61	<1	24	<1	15	0.31
10-Oct	0.39	<1	4	<1	14	0.31
17-Oct	0.15	<1	2	<1	15.5	0.24
23-Oct	0.14	<1	6	<1	14.5	0.41
31-Oct	0.12	<1	4	<1	13	0.32
06-Nov	0.13	<1	<2	<1	12.3	0.29
09-Nov	0.18	<1	24	<1	10.6	0.46
14-Nov	0.14	<1	6	<1	11.3	0.32
21-Nov	0.14	<1	2	<1	10.4	0.34
06-Dec	0.28	<1	6	<1	8.9	0.37
14-Dec	0.51	<1	42	<1	8	0.63




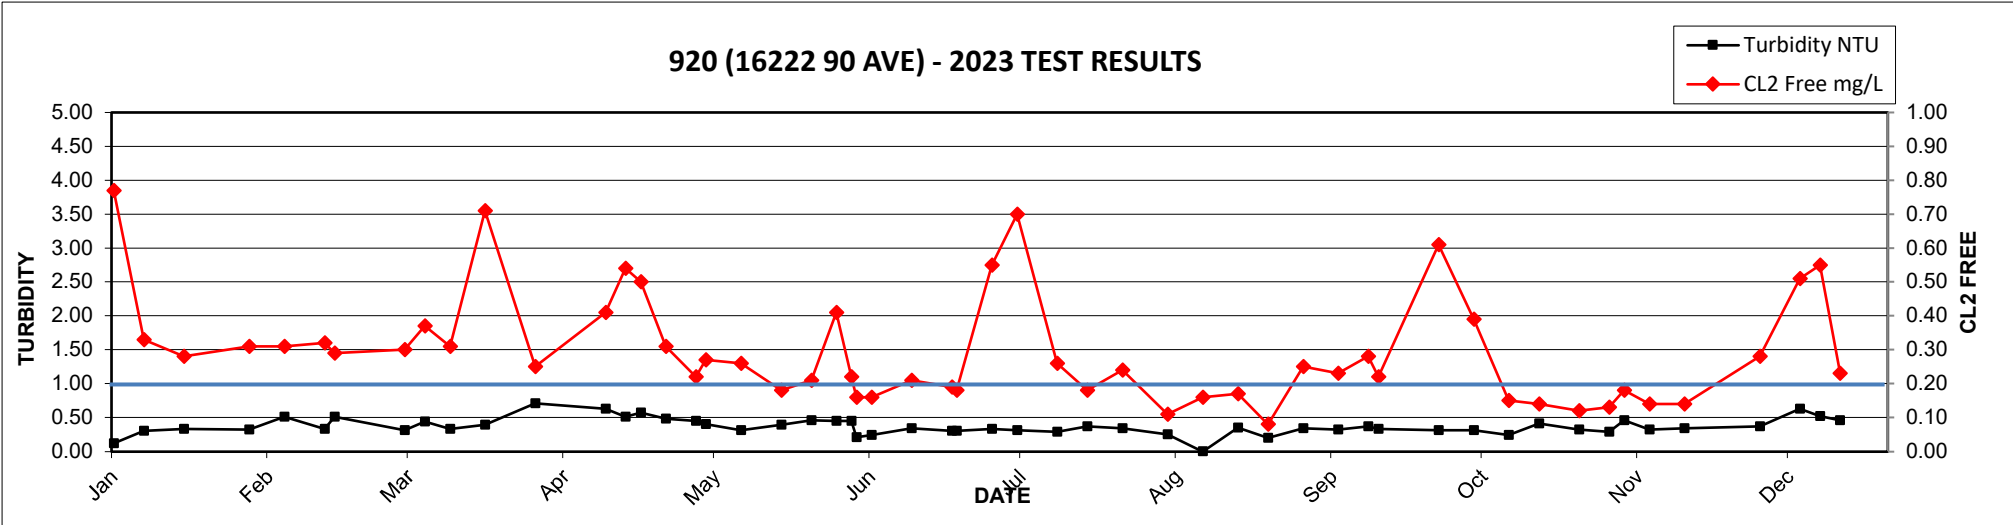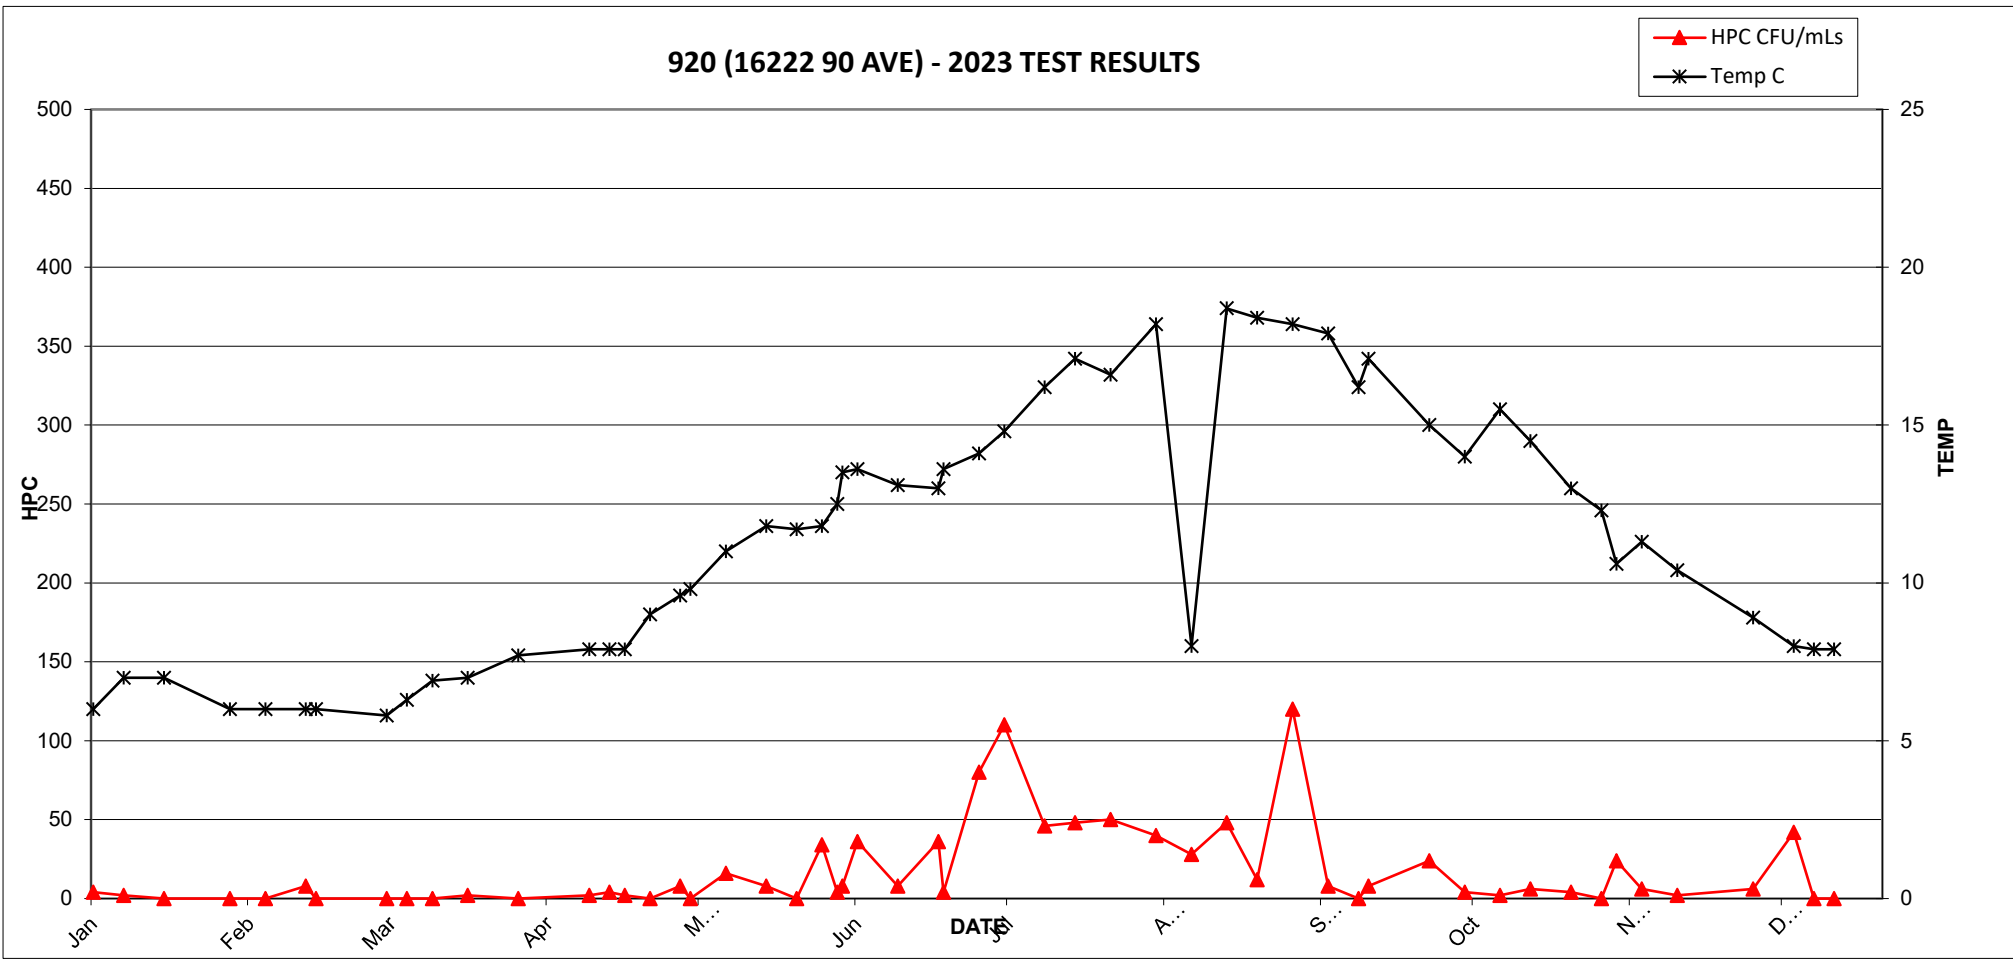


## 2023 MV Laboratory Report - 921 (17079 80 AVE)

Date Collected	CL2Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
04-Jan	0.76	<1	<2	<1	5	0.36
12-Jan	1.23	<1	<2	<1	7	0.38
13-Jan	0.86	<1	<2	<1	6	0.30
18-Jan	0.86	<1	<2	<1	6	0.37
26-Jan	0.91	<1	<2	<1	6	0.34
03-Feb	0.81	<1	<2	<1	6	0.50
08-Feb	1.00	<1	<2	<1	5	1.40
15-Feb	0.75	<1	<2	<1	5	0.37
23-Feb	0.84	<1	<2	<1	6	0.31
25-Feb	0.98	<1	<2	<1	5	0.34
05-Mar	0.61	<1	<2	<1	4.8	0.13
11-Mar	1.10	<1	<2	<1	5.4	0.38
15-Mar	1.04	<1	<2	<1	5.5	0.35
17-Mar	0.72	<1	<2	<1	5.8	0.31
20-Mar	0.86	<1	<2	<1	6.1	0.40
24-Mar	0.89	<1	<2	<1	6.1	0.32
27-Mar	1.04	<1	<2	<1	6.2	0.34
06-Apr	1.55	<1	<2	<1	6.9	0.47
12-Apr	0.92	<1	<2	<1	6.9	0.98
20-Apr	0.60	<1	<2	<1	6.9	0.62
27-Apr	0.69	<1	<2	<1	7	0.47
28-Apr	1.00	<1	2	<1	6.8	0.44
02-May	0.88	<1	<2	<1	7.5	0.34
04-May	0.88	<1	<2	<1	8	0.70
05-May	0.88	<1	2	<1	6.9	0.39
12-May	0.83	<1	<2	<1	7	0.86
17-May	0.97	<1	4	<1	8.7	0.39
25-May	0.94	<1	<2	<1	8.3	0.39
31-May	0.83	<1	<2	<1	8.7	0.30
08-Jun	0.63	<1	<2	<1	9.7	0.35
12-Jun	0.76	<1	<2	<1	11.8	0.29
20-Jun	0.77	<1	<2	<1	10	0.39
23-Jun	0.98	<1	<2	<1	11.1	0.63
29-Jun	0.89	<1	<2	<1	11.7	0.60
06-Jul	0.85	<1	2	<1	14	0.29
10-Jul	1.00	<1	<2	<1	14.4	0.29
11-Jul	0.79	<1	4	<1	13.2	0.24
19-Jul	0.89	<1	<2	<1	14	0.28
25-Jul	1.05	<1	70	<1	14.7	0.30
01-Aug	1.08	<1	<2	<1	15.1	0.34
10-Aug	0.20	<1	6	<1	16.5	0.31
17-Aug	0.82	<1	2	<1	16.60	0.27
24-Aug	0.78	<1	4	<1	17.3	0.33
30-Aug	0.73	<1	2	<1	17.3	0.32
06-Sep	1.01	<1	38	<1	15.9	0.51
13-Sep	0.83	<1	<2	<1	17.5	0.30
21-Sep	0.88	<1	<2	<1	15.9	0.42
28-Sep	0.71	<1	<2	<1	15	0.44
06-Oct	0.92	<1	<2	<1	14.7	0.45
10-Oct	0.66	<1	8	<1	14.1	0.47
17-Oct	0.64	<1	<2	<1	14.4	0.30
23-Oct	0.79	<1	4	<1	12.9	0.46
26-Oct	0.99	<1	<2	<1	12.5	0.48
06-Nov	0.77	<1	<2	<1	10.3	0.31
09-Nov	0.86	<1	6	<1	10.6	0.58

### 921 (17079 80 AVE) - 2023 TEST RESULTS

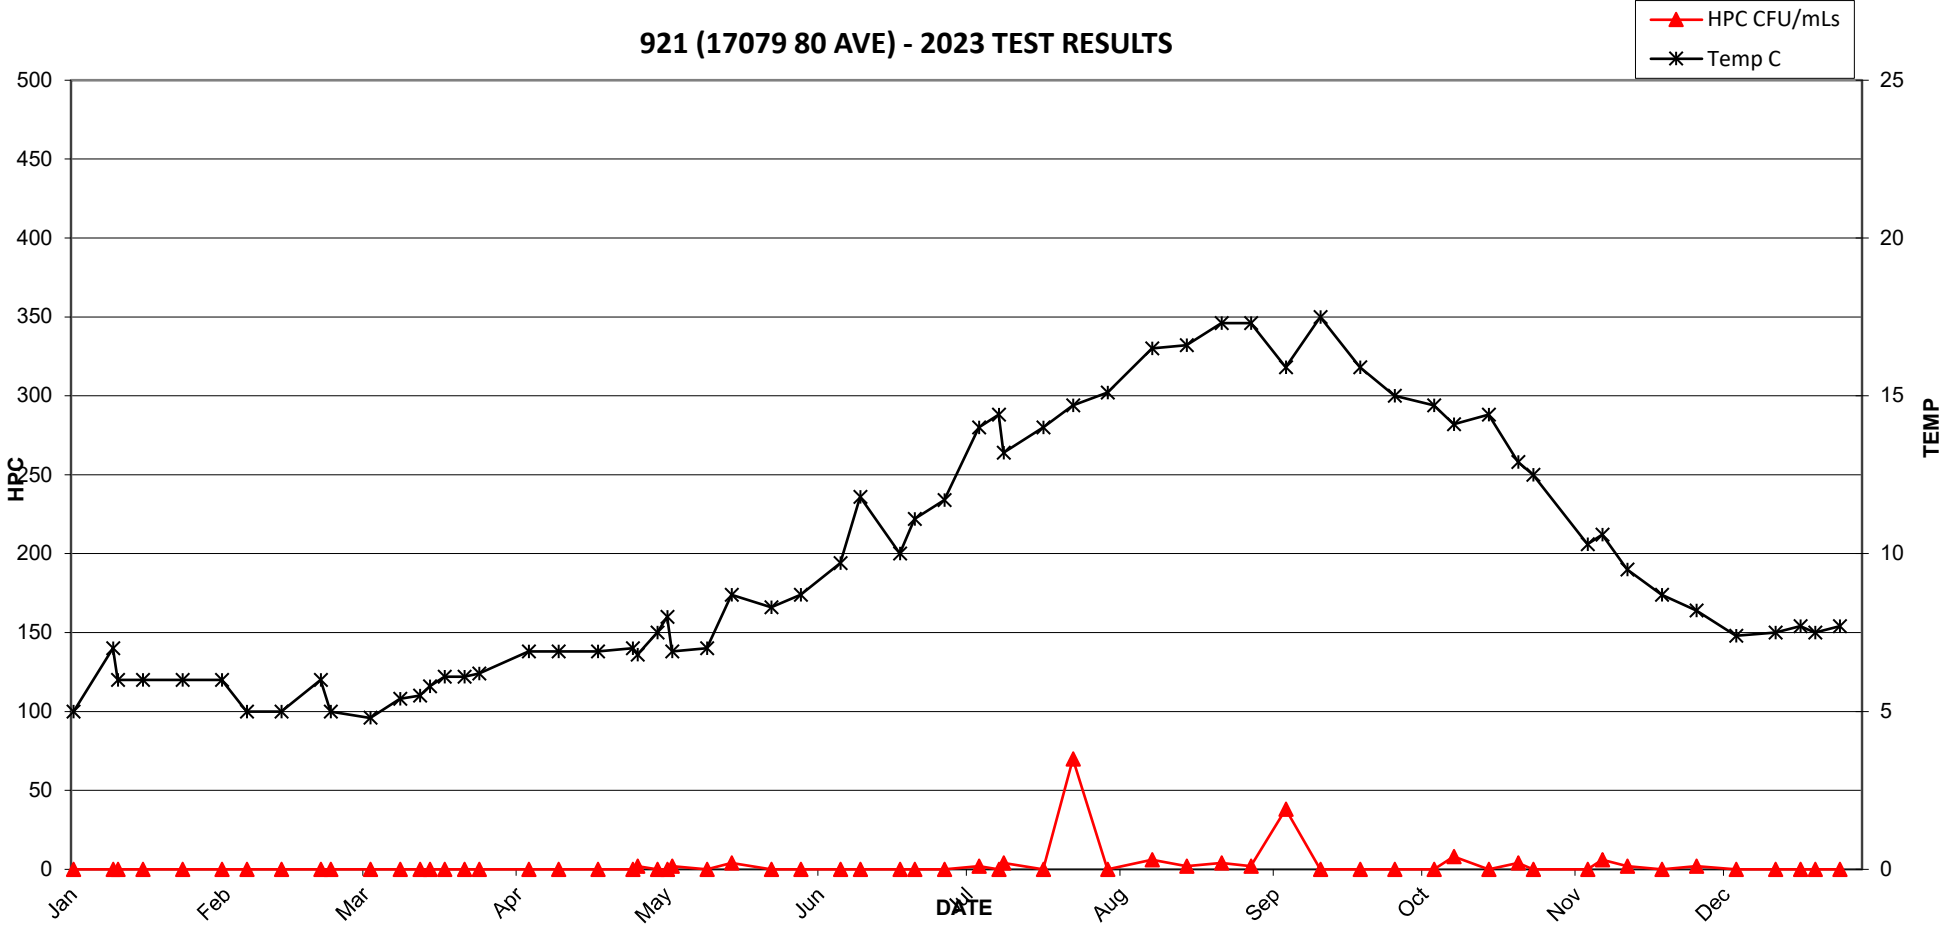


### 921 (17079 80 AVE) - 2023 TEST RESULTS

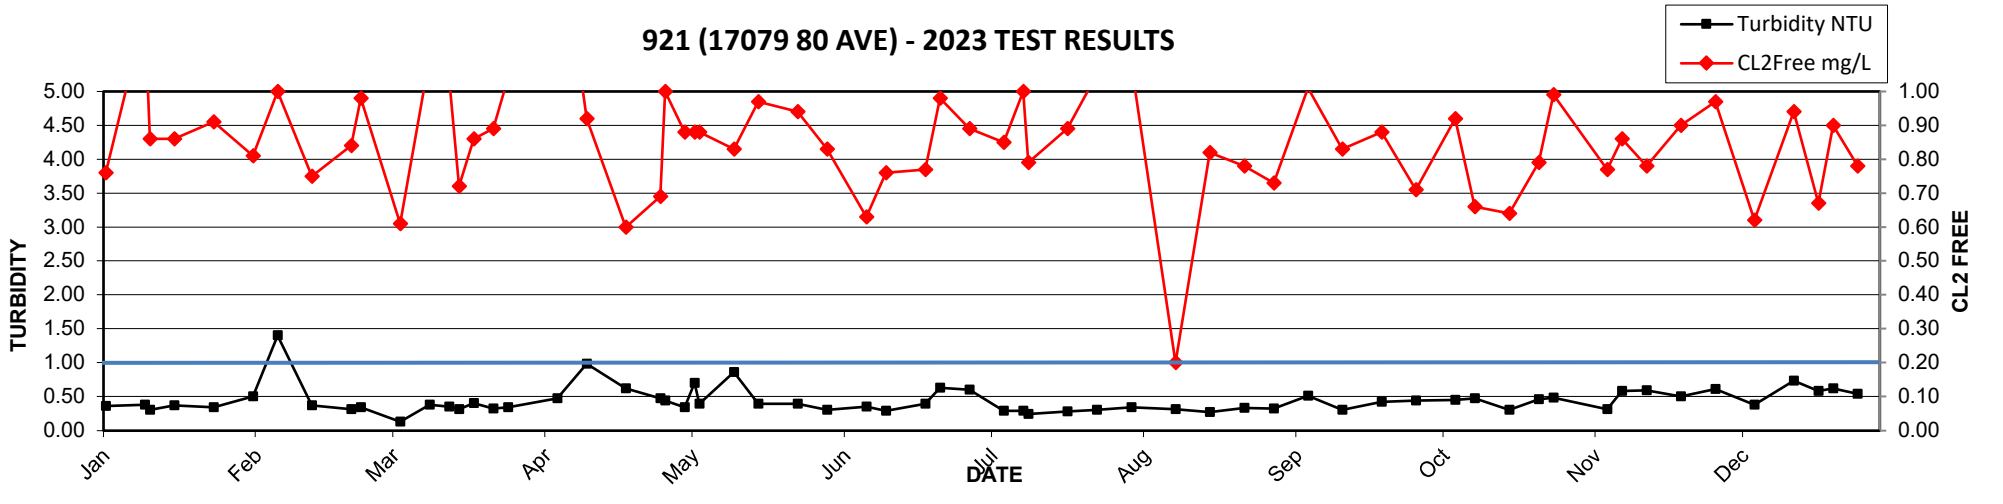


**2023 MV Laboratory Report - 922 (7768 155 ST)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.26	<1	<2	<1	7	0.35
12-Jan	0.44	<1	4	<1	8	0.86
18-Jan	0.18	<1	2	<1	7	0.38
26-Jan	0.28	<1	<2	<1	7	0.31
27-Jan	0.21	<1	<2	<1	7	0.40
30-Jan	0.17	<1	4	<1	7	0.36
08-Feb	0.26	<1	<2	<1	6	0.28
15-Feb	0.23	<1	2	<1	6	0.34
23-Feb	0.26	<1	<2	<1	6	0.31
25-Feb	0.26	<1	<2	<1	6	0.33
11-Mar	0.25	<1	2	<1	6.1	0.25
15-Mar	0.35	<1	<2	<1	6.4	0.24
20-Mar	0.30	<1	2	<1	7.3	0.42
27-Mar	0.26	<1	<2	<1	7.2	0.42
06-Apr	0.19	<1	8	<1	7.9	0.67
12-Apr	0.22	<1	14	<1	8	0.61
20-Apr	0.20	<1	10	<1	8.3	0.50
24-Apr	0.22	<1	8	<1	8.4	0.40
27-Apr	0.41	<1	8	<1	9.3	0.54
02-May	0.15	<1	16	<1	9.8	0.38
10-May	0.15	<1	12	<1	10.4	0.57
17-May	0.30	<1	12	<1	12.4	0.32
25-May	0.14	<1	6	<1	11.9	0.51
31-May	0.18	<1	6	<1	12.3	0.39
05-Jun	0.19	<1	16	<1	13.9	0.48
08-Jun	0.13	<1	34	<1	13.1	0.57
09-Jun	0.07	<1	4	<1	14.5	0.22
12-Jun	0.28	<1	26	<1	14.7	0.26
20-Jun	0.15	<1	<2	<1	13.3	0.45
28-Jun	0.19	<1	56	<1	14	0.32
29-Jun	0.16	<1	<2	<1	13.8	0.31
06-Jul	0.15	<1	24	<1	15.1	0.30
10-Jul	0.18	<1	46	<1	16.4	0.31
11-Jul	0.24	<1	12	<1	15.4	0.32
19-Jul	0.56	<1	34	<1	16.4	0.30
25-Jul	0.17	<1	8	<1	17.3	0.23
01-Aug	0.18	<1	12	<1	17.3	0.30
10-Aug	0.07	<1	14	<1	18	0.22
17-Aug	0.09	<1	20	<1	18.7	0.37
24-Aug	0.12	<1	72	<1	18.7	0.35
28-Aug	0.21	<1	30	<1	18.7	0.27
30-Aug	0.08	<1	8	<1	18.4	0.25
06-Sep	0.18	<1	14	<1	18.3	0.33
13-Sep	0.19	<1	6	<1	18.3	0.25
19-Sep	0.23	<1	2	<1	17.6	0.41
21-Sep	0.22	<1	6	<1	17.7	0.29
03-Oct	0.27	<1	30	<1	16	0.32
10-Oct	0.21	<1	10	<1	15	0.31
17-Oct	0.12	<1	<2	<1	15.4	0.27
23-Oct	0.12	<1	4	<1	14.2	0.52
31-Oct	0.12	<1	8	<1	12.8	0.38
02-Nov	0.24	<1	52	<1	12.9	0.32

922 (7768 155 ST) - 2023 TEST RESULTS


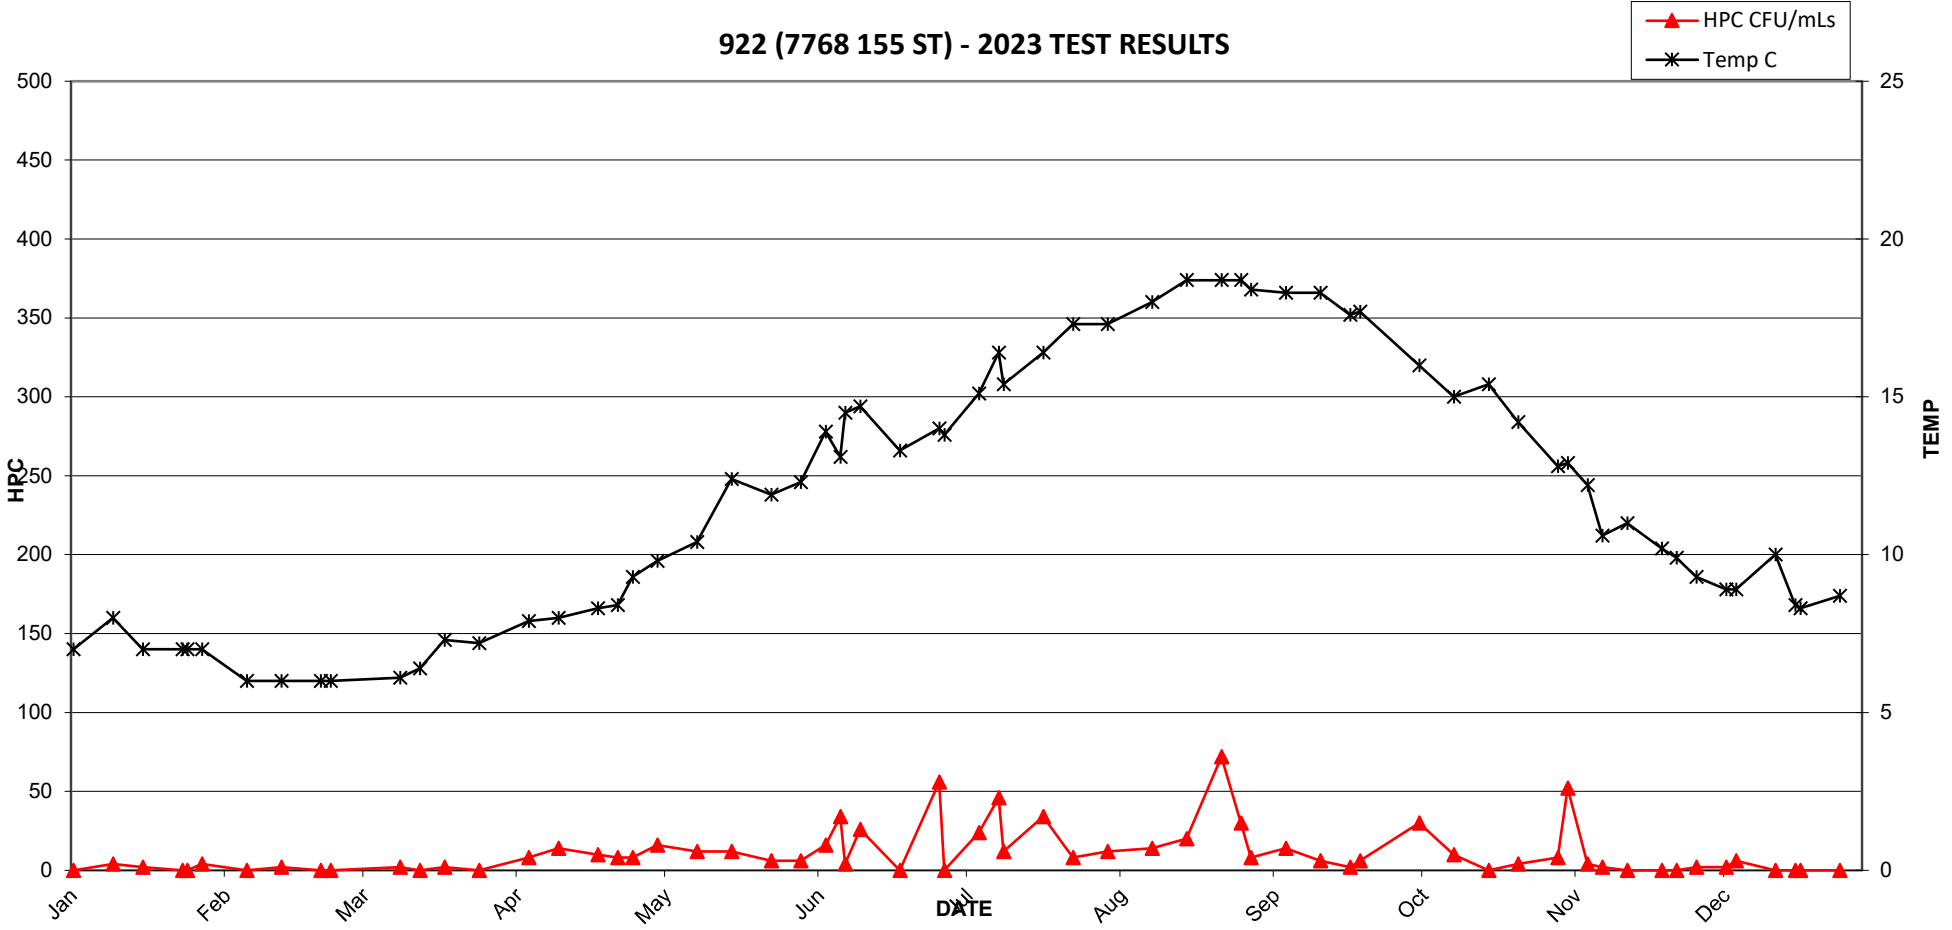


922 (7768 155 ST) - 2023 TEST RESULTS

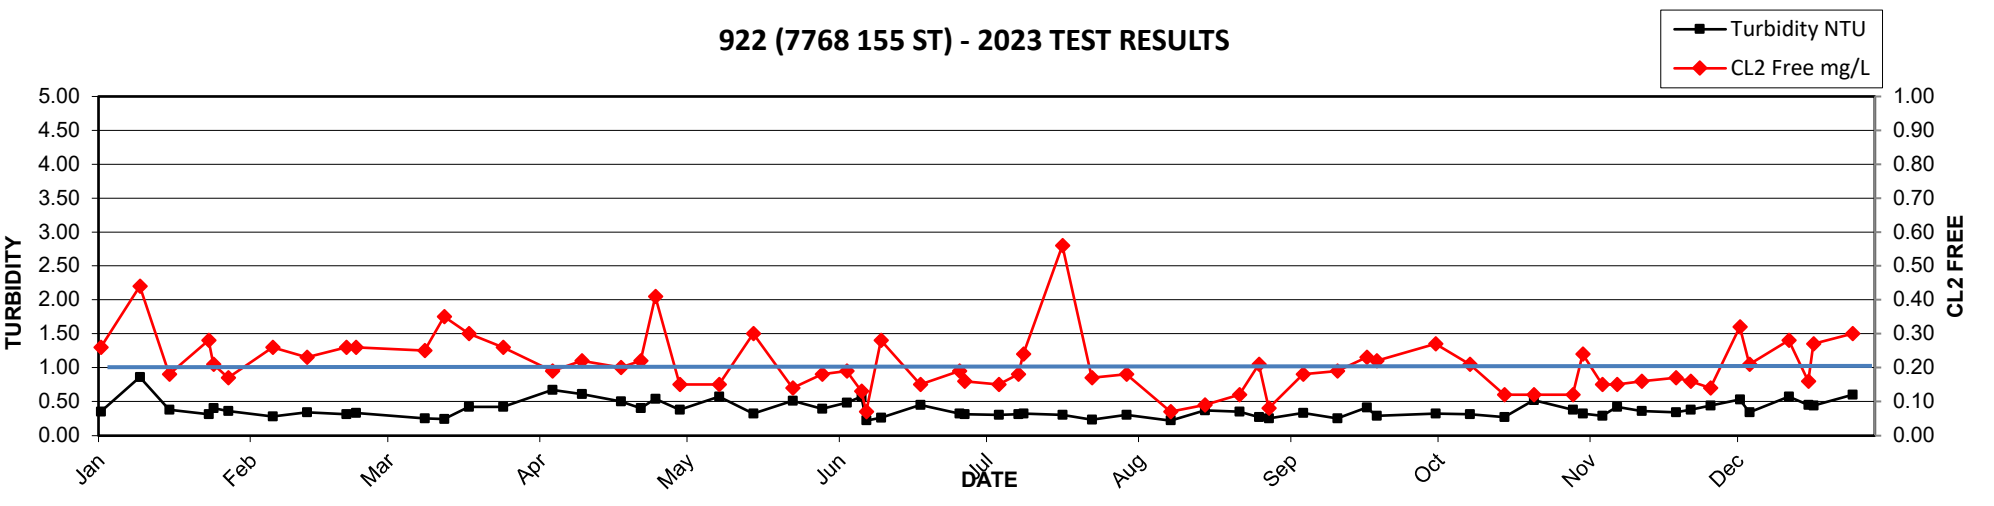

**2023 MV Laboratory Report - 923 (8241 120A ST)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
08-Jan	0.62	<1	4	<1	6	0.21
12-Jan	0.99	<1	<2	<1	6	0.24
19-Jan	0.69	<1	<2	<1	7	0.35
27-Jan	0.69	<1	<2	<1	6	0.32
30-Jan	0.71	<1	2	<1	6	0.30
09-Feb	0.70	<1	<2	<1	6	0.26
22-Feb	0.86	<1	<2	<1	6	0.26
05-Mar	0.92	<1	<2	<1	5.2	0.13
11-Mar	0.79	<1	<2	<1	4.7	0.12
17-Mar	1.22	<1	<2	<1	4.7	0.22
21-Mar	0.81	<1	<2	<1	5.9	0.13
31-Mar	0.64	<1	<2	<1	6.2	0.21
01-Apr	0.57	<1	<2	<1	6.1	0.08
05-Apr	0.48	<1	2	<1	6.3	0.27
12-Apr	0.99	<1	<2	<1	6.3	0.68
18-Apr	0.87	<1	<2	<1	6.8	0.52
25-Apr	0.68	<1	<2	<1	7	0.27
03-May	0.66	<1	<2	<1	7.6	0.33
10-May	0.82	<1	<2	<1	7.5	0.40
12-May	0.99	<1	<2	<1	7.8	0.40
18-May	0.92	<1	12	<1	9.6	0.40
24-May	0.57	<1	<2	<1	10.7	0.23
03-Jun	0.63	<1	<2	<1	10.1	0.53
06-Jun	0.89	<1	<2	<1	10.2	0.38
08-Jun	0.61	<1	2	<1	11.3	0.25
14-Jun	0.71	<1	<2	<1	12	0.21
16-Jun	0.61	<1	<2	<1	11.7	0.25
21-Jun	0.63	<1	<2	<1	12.5	0.11
22-Jun	0.62	<1	2	<1	12.6	0.15
28-Jun	0.79	<1	<2	<1	12	0.21
04-Jul	0.61	<1	<2	<1	13.7	0.25
11-Jul	0.76	<1	<2	<1	14.1	0.2
18-Jul	0.48	<1	<2	<1	15.5	0.27
28-Jul	0.84	<1	<2	<1	14.8	0.27
31-Jul	0.75	<1	<2	<1	16.3	0.47
09-Aug	0.73	<1	<2	<1	16.8	0.29
16-Aug	0.64	<1	<2	<1	17.3	0.31
26-Aug	0.74	<1	<2	<1	17.4	0.32
28-Aug	0.75	<1	<2	<1	17.7	0.39
09-Sep	0.67	<1	<2	<1	16.6	0.30
11-Sep	0.54	<1	<2	<1	17	0.25
18-Sep	0.59	<1	4	<1	16.4	0.26
21-Sep	0.70	<1	<2	<1	16.7	0.30
25-Sep	0.57	<1	<2	<1	16.3	0.35
28-Sep	0.55	<1	<2	<1	16	0.33
05-Oct	0.65	<1	2	<1	14.5	0.32
10-Oct	0.35	<1	<2	<1	15	0.42
13-Oct	0.60	<1	<2	<1	14.6	0.28
18-Oct	0.41	<1	<2	<1	13.5	0.17
23-Oct	0.52	<1	6	<1	12.8	0.20
02-Nov	0.45	<1	<2	<1	10.7	0.13
06-Nov	0.46	<1	<2	<1	10.6	0.17
17-Nov	0.55	<1	<2	<1	10.5	0.36
23-Nov	0.80	<1	<2	<1	8.8	0.33

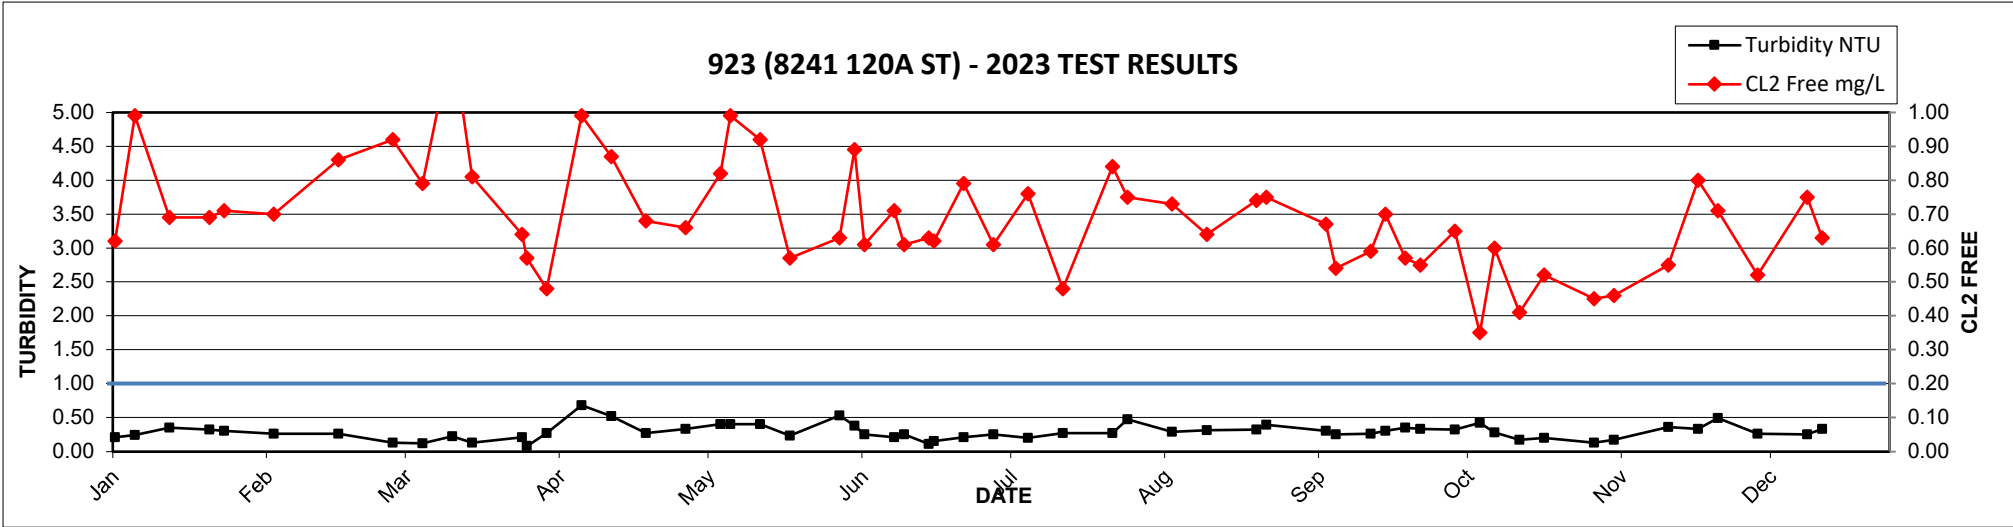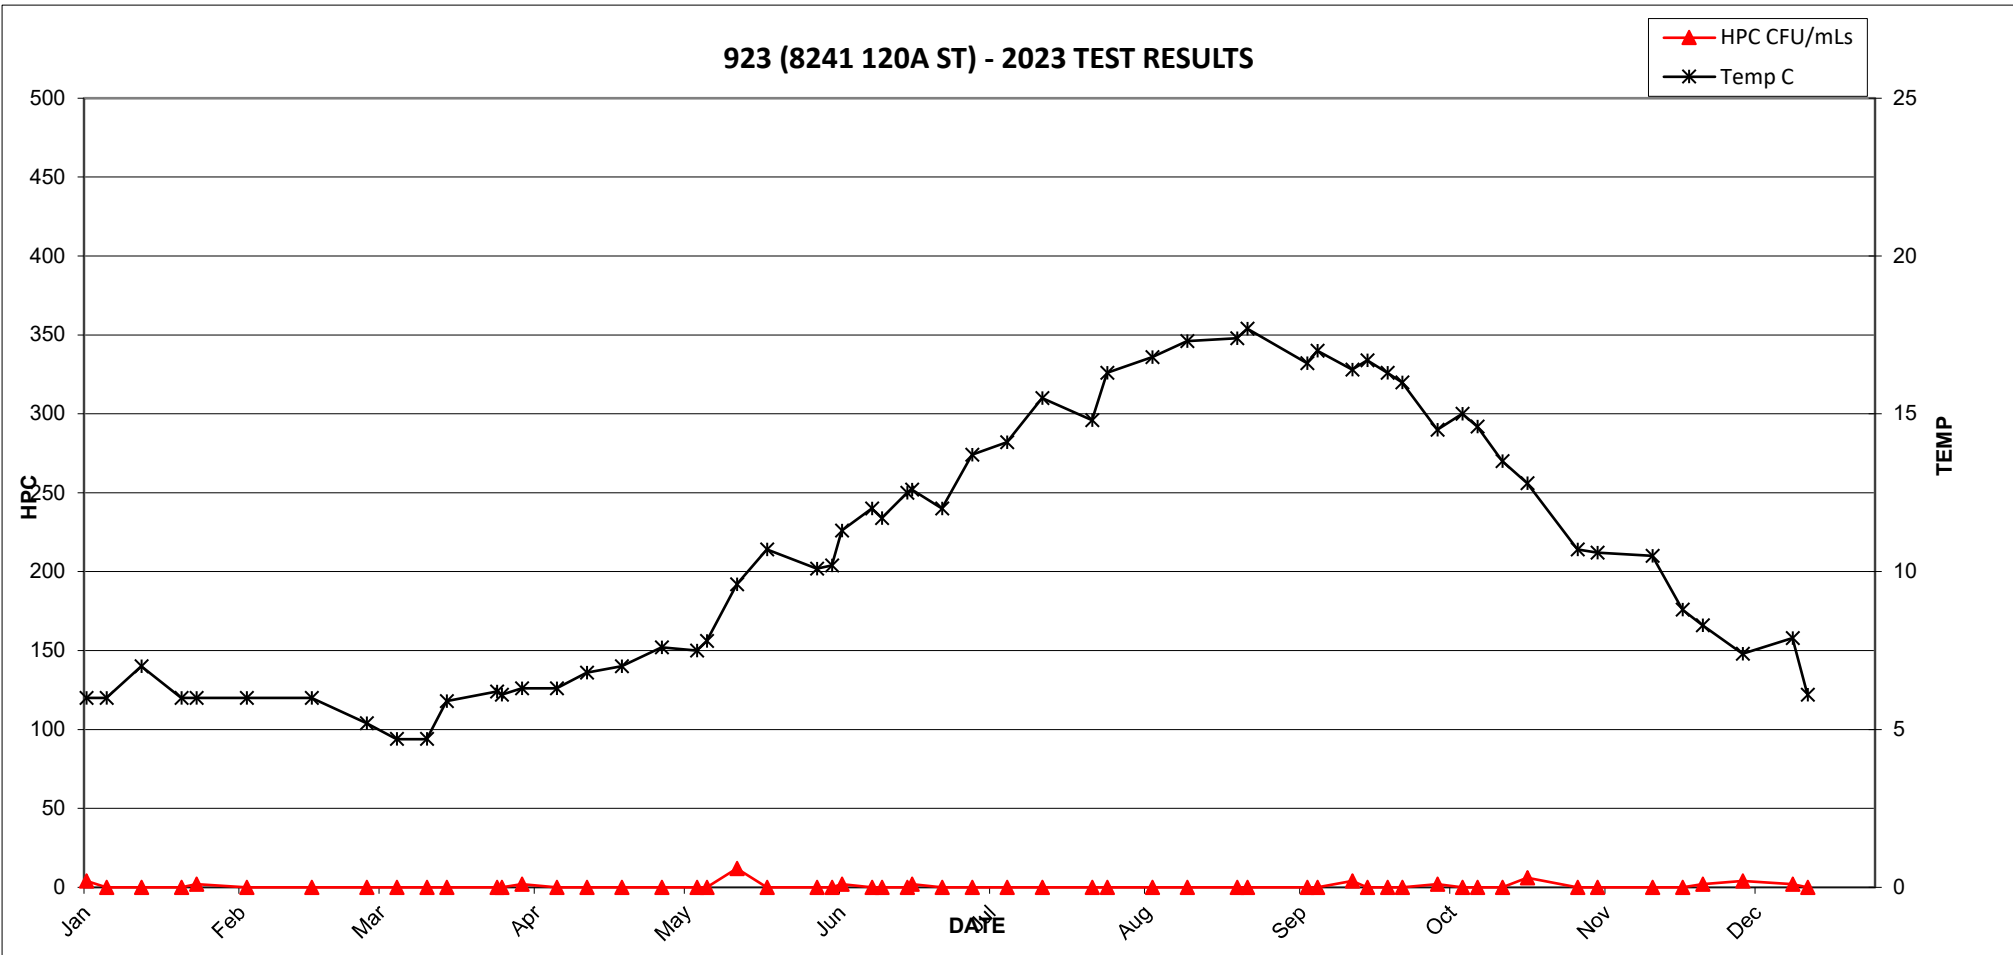


**2023 MV Laboratory Report - 924 (13782 74 AVE)**


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.86	<1	<2	<1	6	0.34
12-Jan	0.81	<1	26	<1	8	12.00
13-Jan	0.70	<1	<2	<1	6	0.45
18-Jan	0.58	<1	<2	<1	7	0.23
26-Jan	0.79	<1	2	<1	6	0.33
08-Feb	0.87	<1	<2	<1	6	0.46
15-Feb	0.80	<1	<2	<1	6	0.23
23-Feb	0.90	<1	<2	<1	6	0.19
24-Feb	0.47	<1	<2	<1	6	0.36
25-Feb	0.95	<1	<2	<1	6	0.12
11-Mar	0.77	<1	<2	<1	5.5	0.18
15-Mar	0.72	<1	<2	<1	5.4	0.12
20-Mar	0.67	<1	2	<1	6	0.13
27-Mar	0.63	<1	<2	<1	6.2	0.24
06-Apr	0.64	<1	<2	<1	7.2	0.31
12-Apr	0.96	<1	<2	<1	7.3	0.67
20-Apr	1.05	<1	2	<1	7.3	0.41
27-Apr	0.57	<1	<2	<1	8.4	0.29
04-May	0.64	<1	<2	<1	9.7	0.41
10-May	0.87	<1	<2	<1	9.1	0.37
17-May	0.55	<1	46	<1	10.3	0.34
25-May	0.72	<1	<2	<1	11.1	0.40
31-May	0.57	<1	<2	<1	11.9	0.25
07-Jun	0.92	<1	<2	<1	12.4	0.35
08-Jun	0.58	<1	<2	<1	11.3	0.40
09-Jun	0.64	<1	<2	<1	12.7	0.20
12-Jun	0.45	<1	12	<1	12.8	0.24
20-Jun	0.64	<1	4	<1	12.4	0.25
28-Jun	0.68	<1	32	<1	12	0.35
06-Jul	0.69	<1	4	<1	13.7	0.39
12-Jul	0.71	<1	12	<1	14.5	0.23
19-Jul	0.88	<1	6	<1	14.8	0.26
24-Jul	0.91	<1	4	<1	15.6	0.30
01-Aug	0.82	<1	14	<1	15.8	0.36
10-Aug	0.56	<1	NA	<1	16.7	0.30
17-Aug	0.59	<1	12	<1	17.9	0.31
24-Aug	0.59	<1	34	<1	17.3	0.50
30-Aug	0.68	<1	2	<1	17.1	0.32
06-Sep	0.67	<1	46	<1	17.3	0.52
13-Sep	0.50	<1	52	<1	16.5	0.38
21-Sep	0.54	<1	26	<1	15.9	0.43
28-Sep	0.46	<1	10	<1	16	0.56
10-Oct	0.47	<1	<2	<1	15.4	0.45
17-Oct	0.23	<1	12	<1	14.5	0.26
23-Oct	0.40	<1	14	<1	13.1	0.20
31-Oct	0.31	<1	<2	<1	11.5	0.22
06-Nov	0.36	<1	2	<1	11.2	0.15
09-Nov	0.63	<1	10	<1	11.1	0.46
14-Nov	0.57	<1	<2	<1	10	0.40



### 924 (13782 74 AVE) - 2023 TEST RESULTS

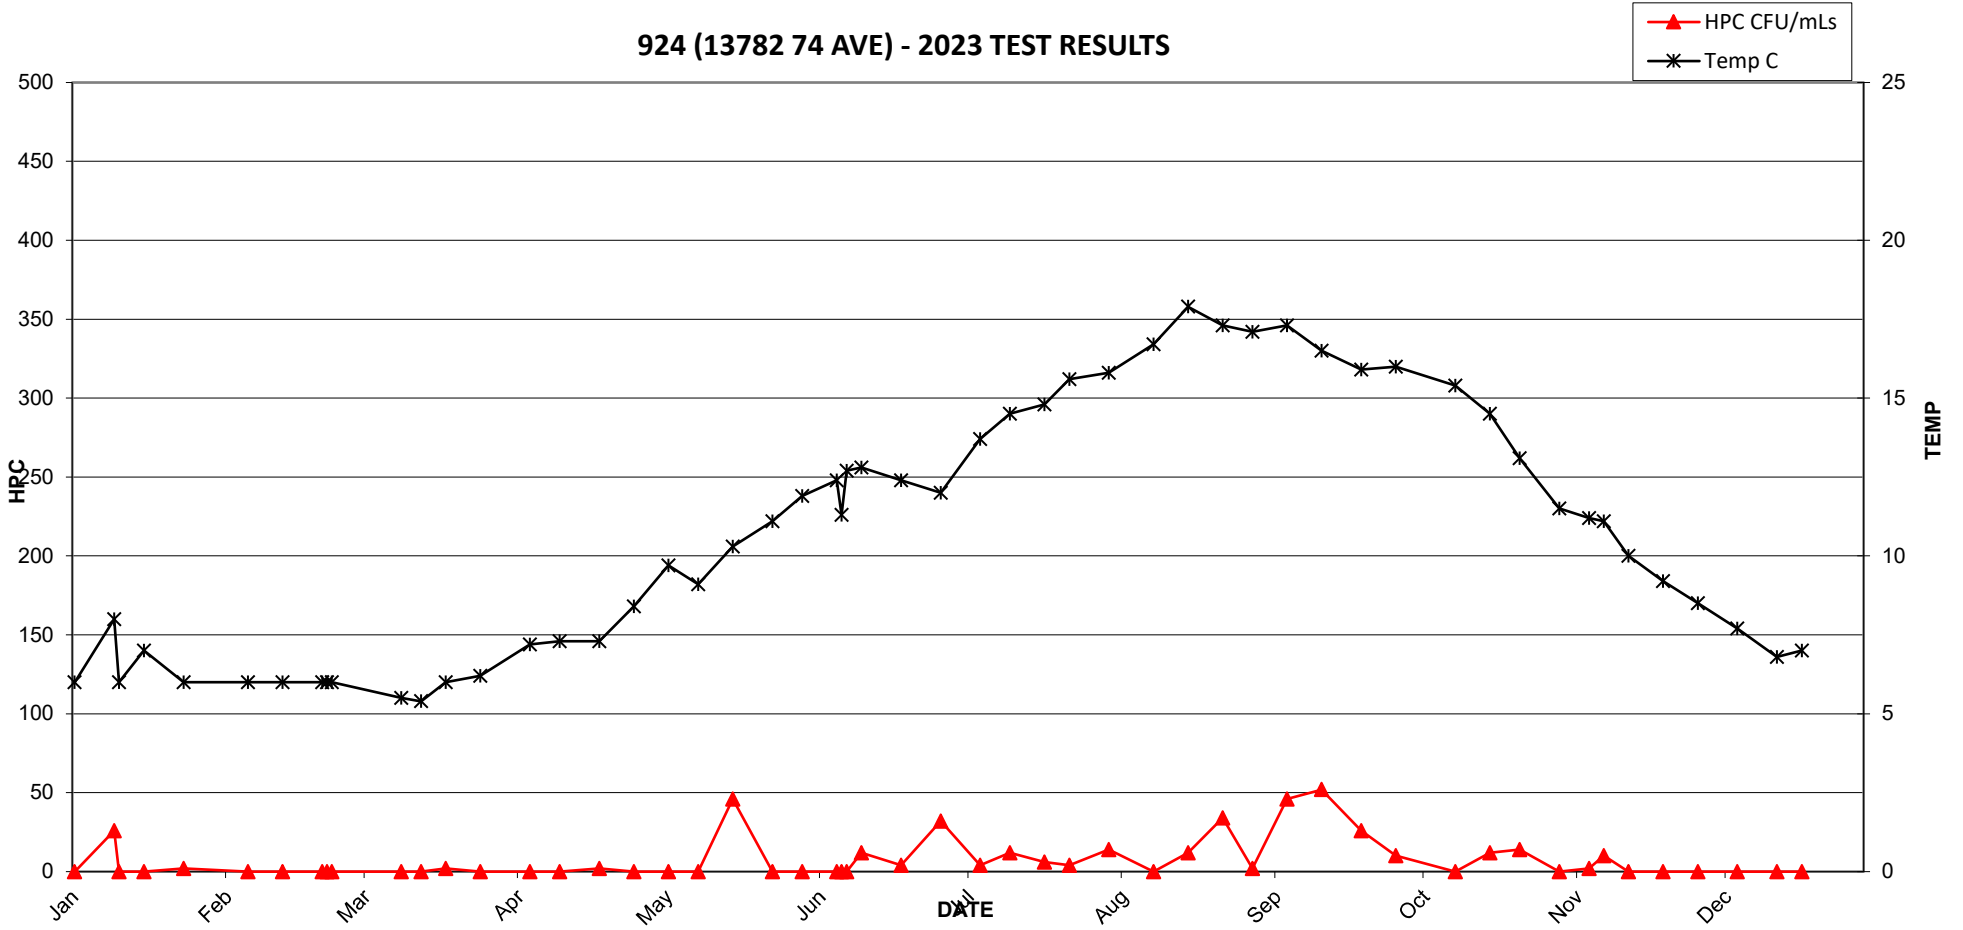


### 924 (13782 74 AVE) - 2023 TEST RESULTS

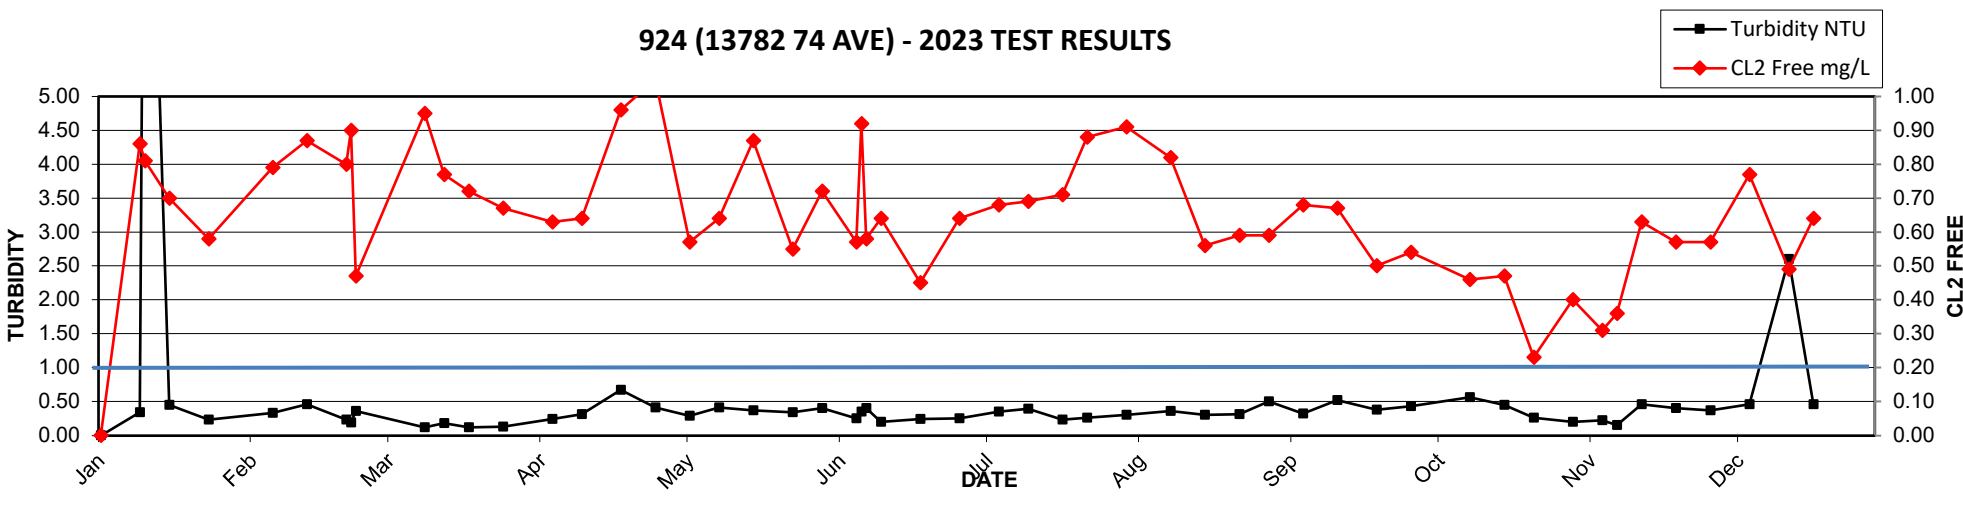


**2023 MV Laboratory Report - 925 (6234 128 ST)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	1.14	<1	<2	<1	4	0.16
12-Jan	1.05	<1	<2	<1	6	0.17
18-Jan	0.93	<1	<2	<1	5	0.26
26-Jan	0.99	<1	<2	<1	5	0.13
08-Feb	1.34	<1	<2	<1	5	0.34
15-Feb	1.19	<1	<2	<1	5	0.25
23-Feb	0.91	<1	<2	<1	5	0.13
25-Feb	1.17	<1	<2	<1	4	0.40
11-Mar	1.16	<1	<2	<1	4.5	0.13
15-Mar	1.15	<1	<2	<1	4.7	0.31
06-Apr	0.37	<1	<2	<1	7.4	0.66
12-Apr	1.07	<1	<2	<1	7.6	0.24
20-Apr	0.45	<1	<2	<1	8	0.25
24-Apr	0.81	<1	<2	<1	7.3	0.31
02-May	0.72	<1	<2	<1	8.4	0.34
17-May	0.44	<1	<2	<1	10	0.34
25-May	0.51	<1	2	<1	10.8	0.31
31-May	0.54	<1	6	<1	11.1	0.21
07-Jun	0.59	<1	32	<1	13.1	0.46
08-Jun	0.52	<1	2	<1	11.8	0.27
12-Jun	0.69	<1	18	<1	12.7	0.19
20-Jun	0.63	<1	6	<1	12.1	0.21
30-Jun	0.49	<1	50	<1	13.4	0.46
06-Jul	0.59	<1	30	<1	13.6	0.30
12-Jul	0.48	<1	120	<1	14.8	4.40
19-Jul	0.66	<1	50	<1	15.3	0.26
25-Jul	0.45	<1	120	<1	15.3	0.26
03-Aug	0.55	<1	94	<1	16.9	0.34
10-Aug	0.51	<1	260	<1	17.3	0.27
17-Aug	0.61	<1	800	<1	17.8	0.31
24-Aug	0.63	<1	110	<1	17	0.44
30-Aug	0.46	<1	670	<1	17	0.28
06-Sep	0.44	<1	580	<1	16.9	0.75
13-Sep	0.40	<1	300	<1	17.3	0.55
21-Sep	0.58	<1	140	<1	17.3	0.32
28-Sep	0.43	<1	210	<1	16	0.50
10-Oct	0.57	<1	1900	<1	14.8	0.50
19-Oct	0.48	<1	690	<1	13.2	0.28
23-Oct	0.60	<1	70	<1	12.4	0.20
31-Oct	0.42	<1	6	<1	10.5	0.16
06-Nov	0.52	<1	6	<1	10.2	0.17
09-Nov	0.46	<1	50	<1	10	0.66
14-Nov	0.59	<1	6	<1	9.4	0.21
21-Nov	0.56	<1	2	<1	8.4	0.21
28-Nov	0.54	<1	6	<1	7.5	0.31
06-Dec	0.69	<1	4	<1	6.7	0.56
14-Dec	0.61	<1	<2	<1	7.8	0.67
19-Dec	0.58	<1	NA	<1	7.7	0.19

925 (6234 128 ST) - 2023 TEST RESULTS


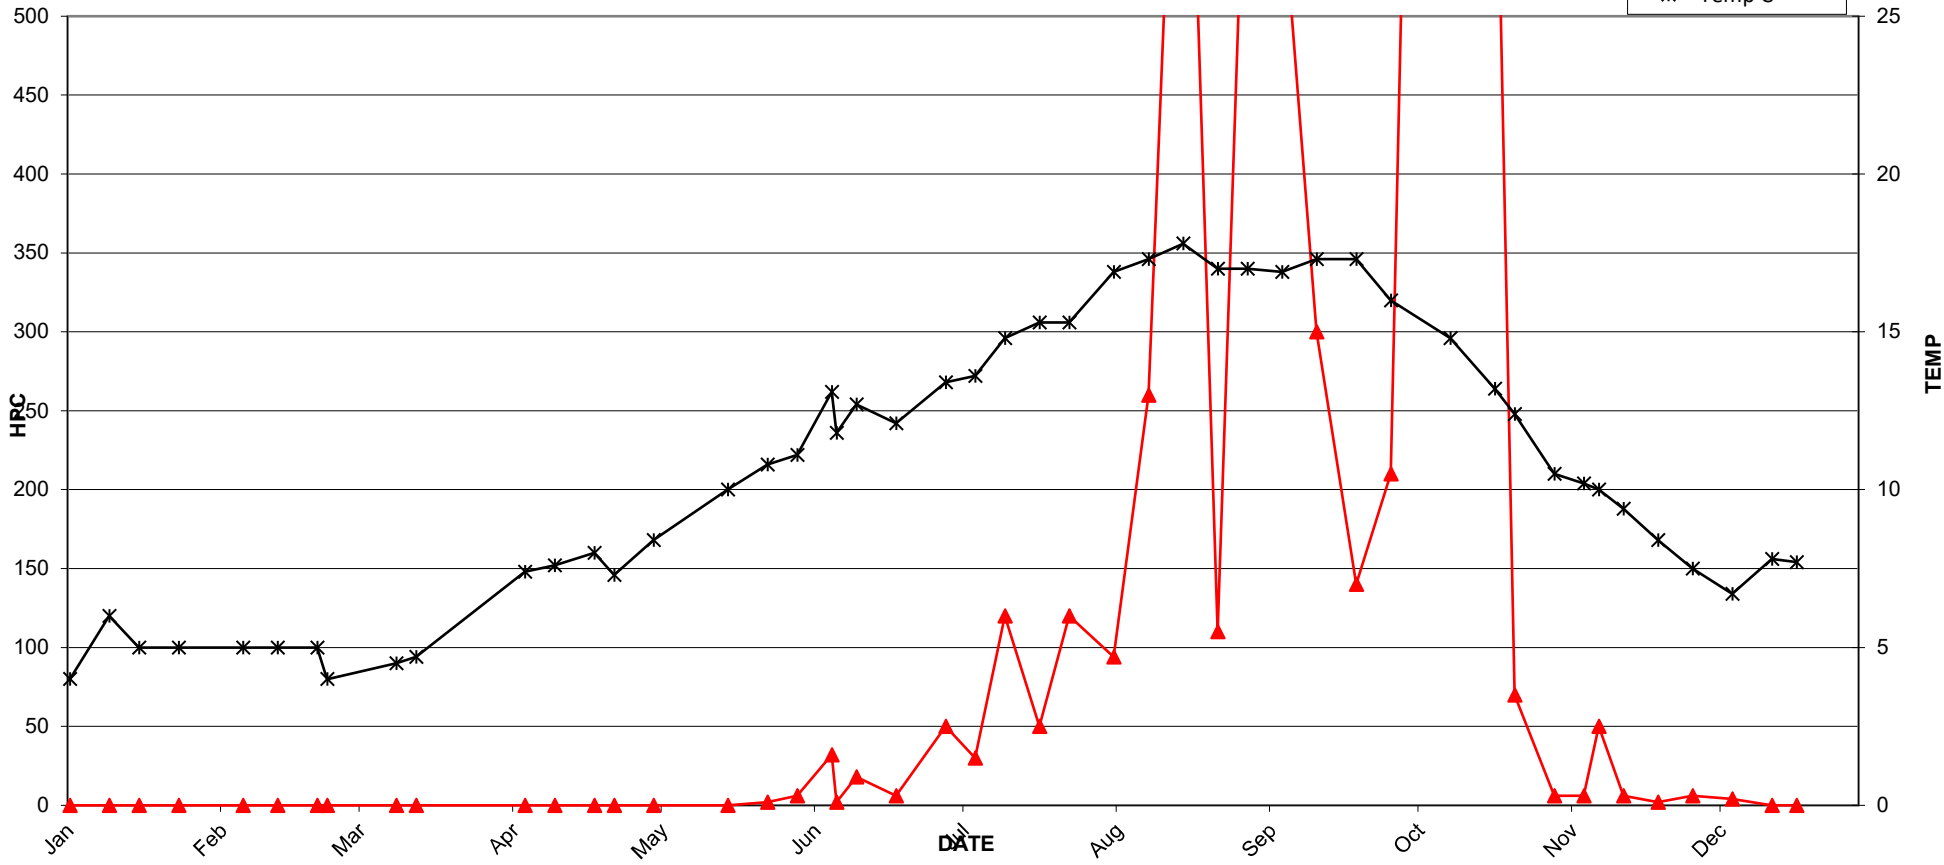


925 (6234 128 ST) - 2023 TEST RESULTS

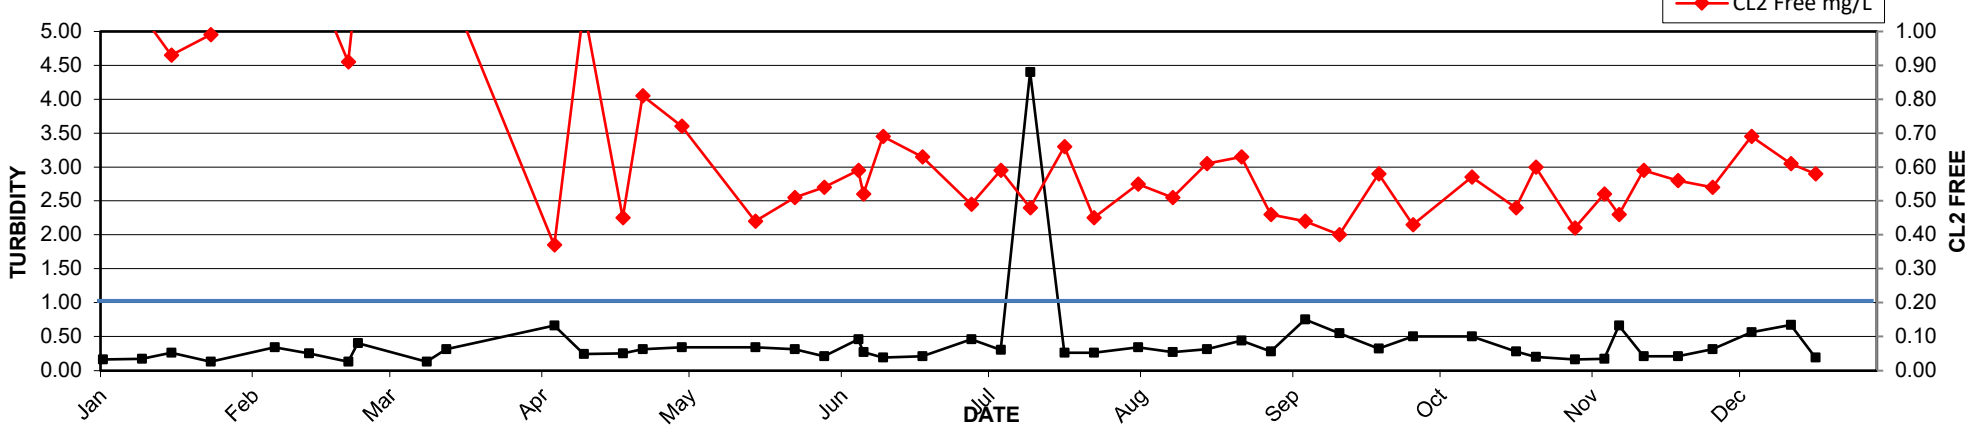

**2023 MV Laboratory Report - 926 (12049 56AVE)**


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.96	<1	<2	<1	6	0.13
12-Jan	1.20	<1	<2	<1	9	0.15
18-Jan	0.93	<1	<2	<1	7	0.16
26-Jan	0.98	<1	<2	<1	7	0.14
30-Jan	0.39	<1	<2	<1	7	0.14
08-Feb	0.91	<1	<2	<1	7	0.65
15-Feb	0.98	<1	<2	<1	6	0.15
22-Feb	0.96	<1	<2	<1	6	0.18
23-Feb	0.98	<1	<2	<1	6	0.12
24-Feb	1.06	<1	<2	<1	6	0.20
25-Feb	0.94	<1	<2	<1	6	0.10
11-Mar	1.00	<1	<2	<1	6.1	0.10
15-Mar	1.09	<1	<2	<1	6.5	0.15
20-Mar	0.93	<1	<2	<1	6.3	0.16
27-Mar	1.12	<1	<2	<1	6.5	0.12
06-Apr	0.65	<1	<2	<1	6.9	0.19
12-Apr	1.04	<1	<2	<1	7.2	0.46
20-Apr	0.79	<1	<2	<1	7.6	0.18
24-Apr	1.03	<1	<2	<1	8	0.18
02-May	0.55	<1	<2	<1	9.8	0.14
04-May	0.29	<1	<2	<1	10	0.34
17-May	0.51	<1	32	<1	11.8	0.26
25-May	0.66	<1	50	<1	12.6	0.18
31-May	0.53	<1	6	<1	13	0.20
07-Jun	0.49	<1	48	<1	13.1	0.32
08-Jun	0.56	<1	44	<1	13.5	0.20
12-Jun	0.30	<1	82	<1	13.6	0.14
20-Jun	0.54	<1	12	<1	14.1	0.28
29-Jun	0.63	<1	34	<1	14	0.19
30-Jun	0.64	<1	56	<1	14.6	0.23
06-Jul	0.45	<1	110	<1	14.7	0.35
12-Jul	0.45	<1	150	<1	15.3	0.19
19-Jul	0.44	<1	390	<1	16.1	0.34
25-Jul	0.54	<1	640	<1	15.2	0.22
01-Aug	0.44	<1	480	<1	15	0.38
03-Aug	0.71	<1	130	<1	16.6	0.35
10-Aug	0.18	<1	790	<1	18.4	0.19
17-Aug	0.42	<1	440	<1	20	0.23
24-Aug	0.36	<1	610	<1	18.2	0.39
30-Aug	0.22	<1	140	<1	18.1	0.22
06-Sep	0.33	<1	590	<1	17.9	0.28
13-Sep	0.32	<1	860	<1	17	0.39
21-Sep	0.21	<1	820	<1	16.3	0.35
28-Sep	0.27	<1	410	<1	16	0.39
03-Oct	0.26	<1	560	<1	16	0.23
10-Oct	0.22	<1	2300	<1	15.5	0.28
17-Oct	0.24	<1	140	<1	14.9	0.27
19-Oct	0.16	<1	1000	<1	14.8	0.21
23-Oct	0.26	<1	180	<1	14	0.18
30-Oct	0.61	<1	42	<1	10.5	0.16
31-Oct	0.28	<1	10	<1	12.3	0.22
06-Nov	0.37	<1	<2	<1	12	0.18

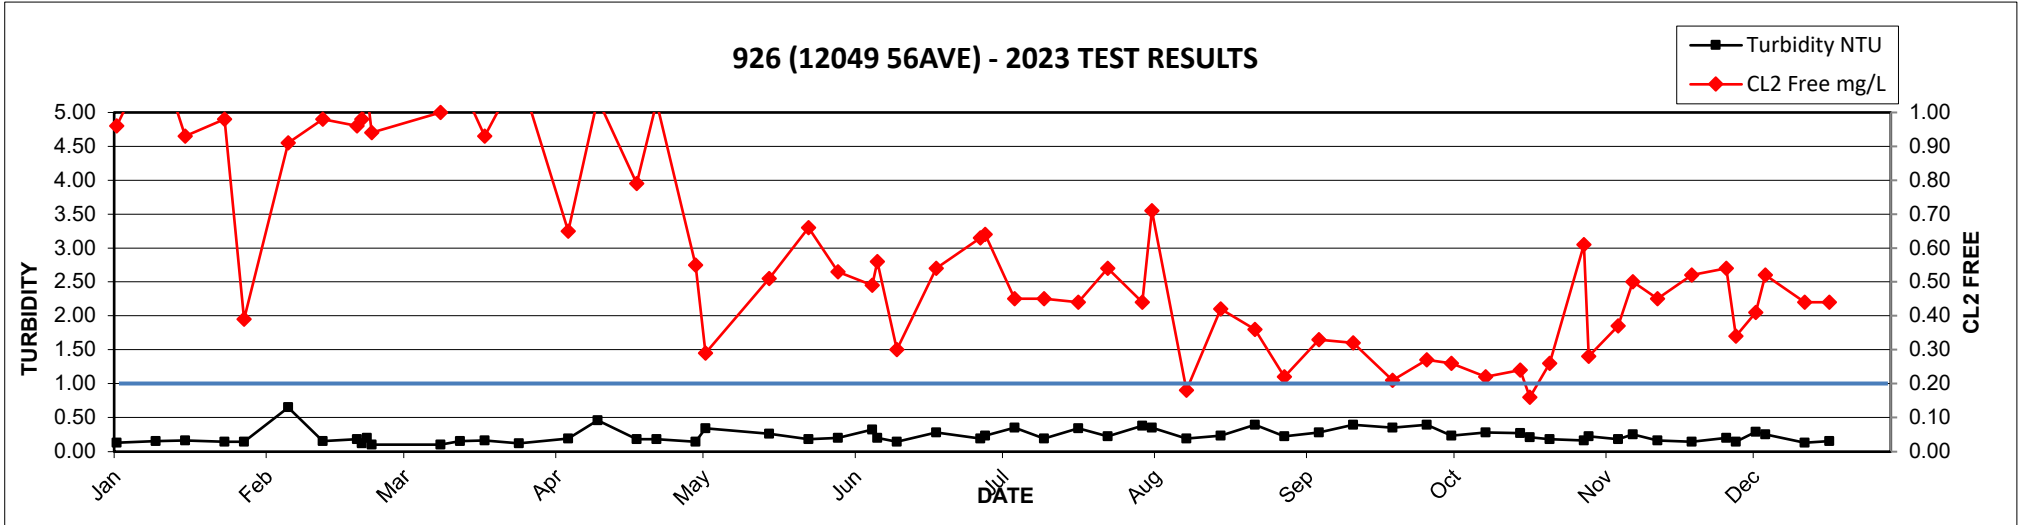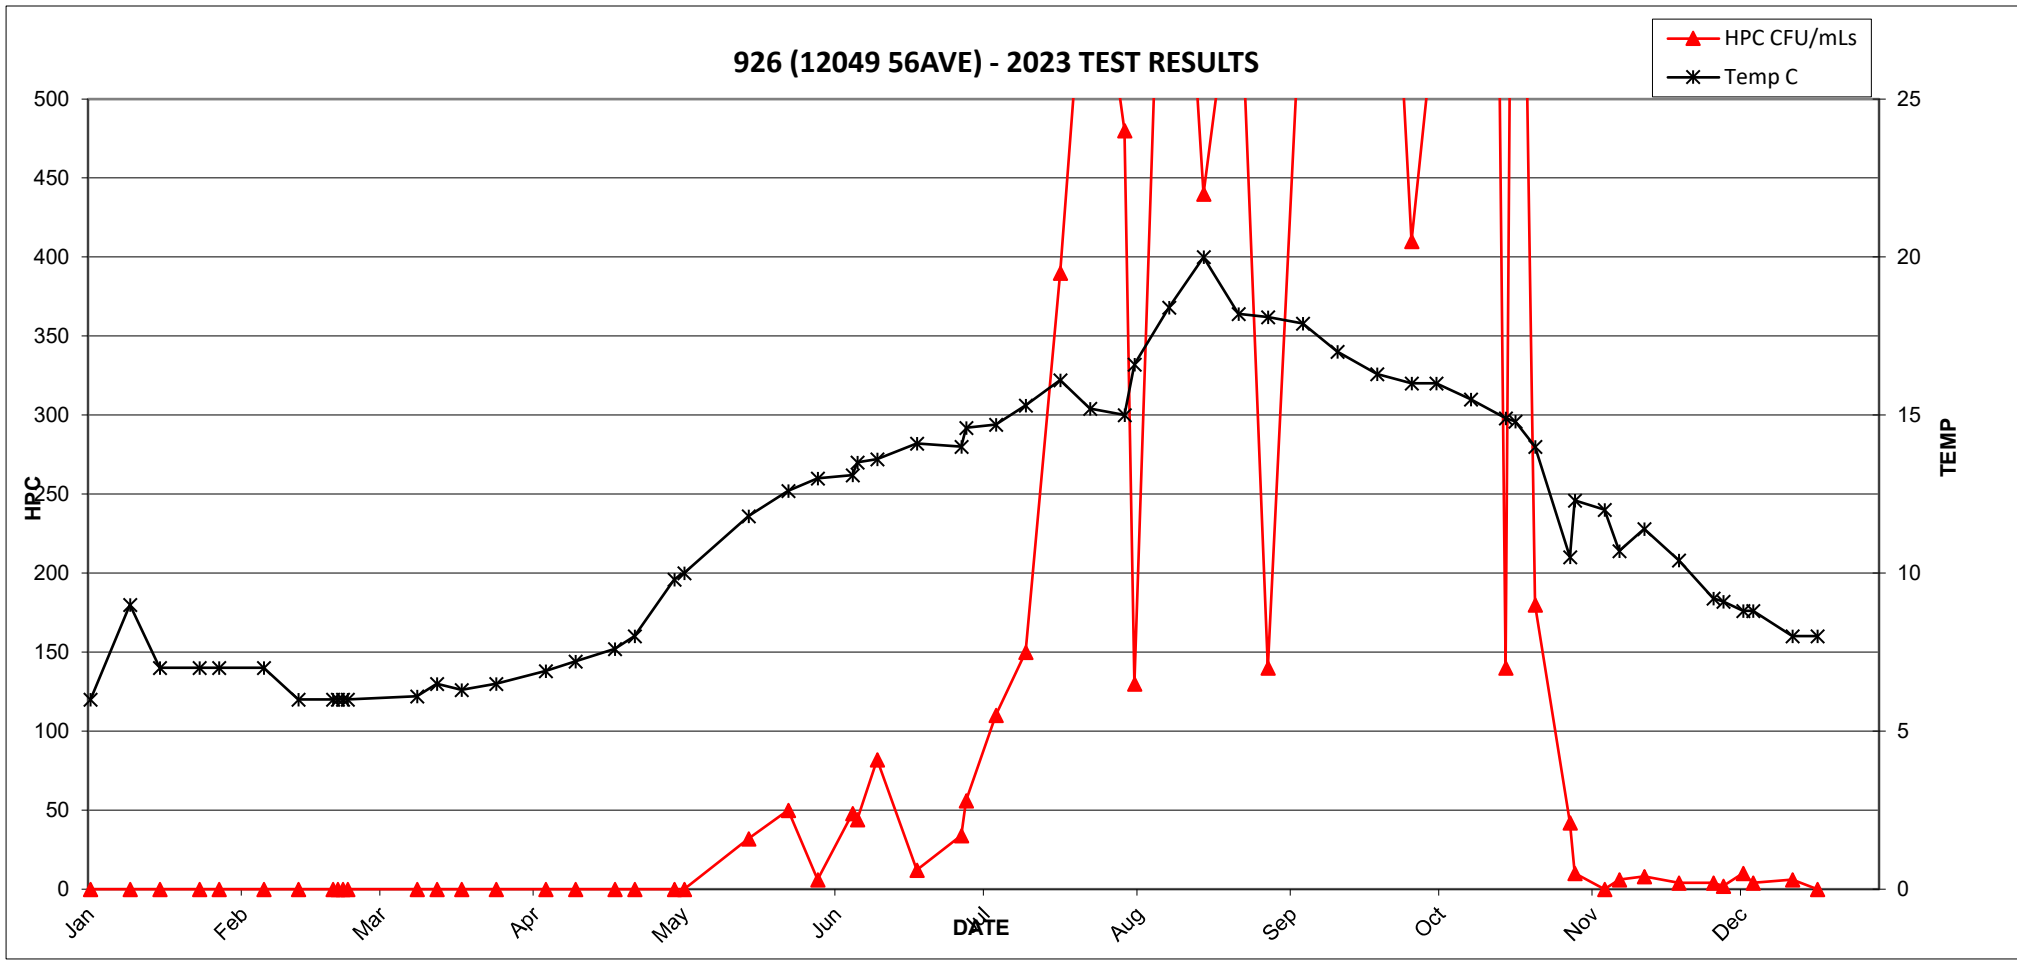


**2023 MV Laboratory Report - 927 (6651 148 ST)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.94	<1	<2	<1	6	0.12
12-Jan	1.30	<1	<2	<1	8	0.17
18-Jan	1.02	<1	<2	<1	7	0.61
26-Jan	0.86	<1	<2	<1	7	0.34
08-Feb	0.55	<1	<2	<1	7	0.20
15-Feb	1.02	<1	<2	<1	6	0.14
23-Feb	0.45	<1	<2	<1	6	0.23
25-Feb	0.59	<1	<2	<1	6	0.21
11-Mar	0.71	<1	<2	<1	6	0.09
15-Mar	1.02	<1	2	<1	6.5	0.24
20-Mar	0.85	<1	<2	<1	7	3.10
27-Mar	0.82	<1	<2	<1	6.9	0.69
06-Apr	0.54	<1	2	<1	7	1.10
12-Apr	0.90	<1	<2	<1	7.6	0.40
20-Apr	0.40	<1	12	<1	8.3	0.40
24-Apr	0.70	<1	10	<1	7.8	0.38
27-Apr	0.26	<1	<2	<1	8.6	0.39
02-May	0.32	<1	<2	<1	8.3	3.10
17-May	0.35	<1	<2	<1	13.3	0.41
25-May	0.55	<1	<2	<1	14	0.21
31-May	0.42	<1	36	<1	14.2	0.22
08-Jun	0.46	<1	<2	<1	15.1	0.29
12-Jun	0.41	<1	<2	<1	15.6	0.17
20-Jun	0.39	<1	<2	<1	15	0.30
30-Jun	0.37	<1	<2	<1	16.2	0.24
06-Jul	0.49	<1	<2	<1	15	0.37
12-Jul	0.36	<1	4	<1	15.1	0.18
20-Jul	0.34	<1	<2	<1	18.2	0.22
25-Jul	0.33	<1	16	<1	16.8	0.18
01-Aug	0.19	<1	160	<1	18.8	0.26
10-Aug	0.35	<1	82	<1	18.7	0.20
17-Aug	0.44	<1	220	<1	19.8	0.32
24-Aug	0.36	<1	240	<1	19.2	0.40
30-Aug	0.32	<1	140	<1	19.3	0.19
13-Sep	0.28	<1	650	<1	18.3	0.30
21-Sep	0.24	<1	560	<1	17	0.3
11-Oct	0.18	<1	320	<1	16.7	0.31
17-Oct	0.17	<1	500	<1	16	0.28
23-Oct	0.23	<1	290	<1	14.5	0.17
31-Oct	0.24	<1	10	<1	12.3	0.17
06-Nov	0.27	<1	4	<1	12.6	0.16
14-Nov	0.27	<1	<2	<1	11.7	0.13
21-Nov	0.39	<1	<2	<1	10.2	0.23
28-Nov	0.39	<1	<2	<1	8.8	0.32
06-Dec	0.43	<1	<2	<1	8.7	0.21
15-Dec	0.36	<1	2	<1	8.3	0.24
19-Dec	0.66	<1	NA	<1	8	0.11

927 (6651 148ST) - 2023 TEST RESULTS

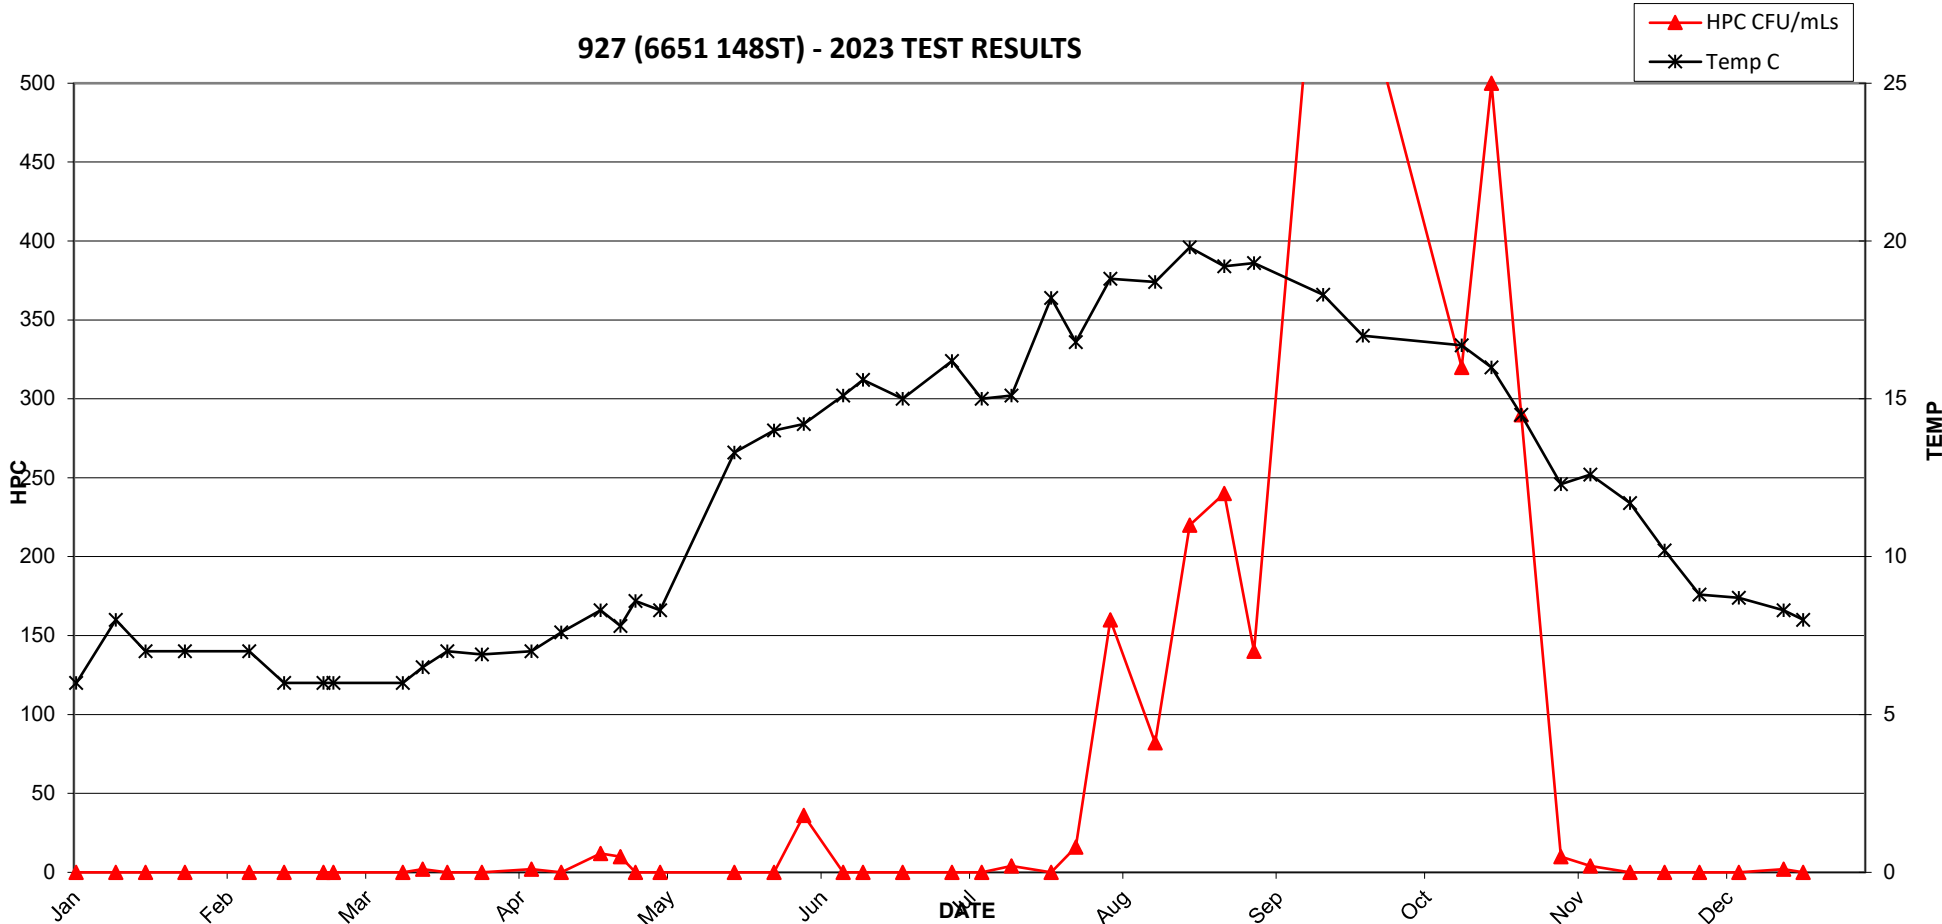

927 (6651 148ST) - 2023 TEST RESULTS

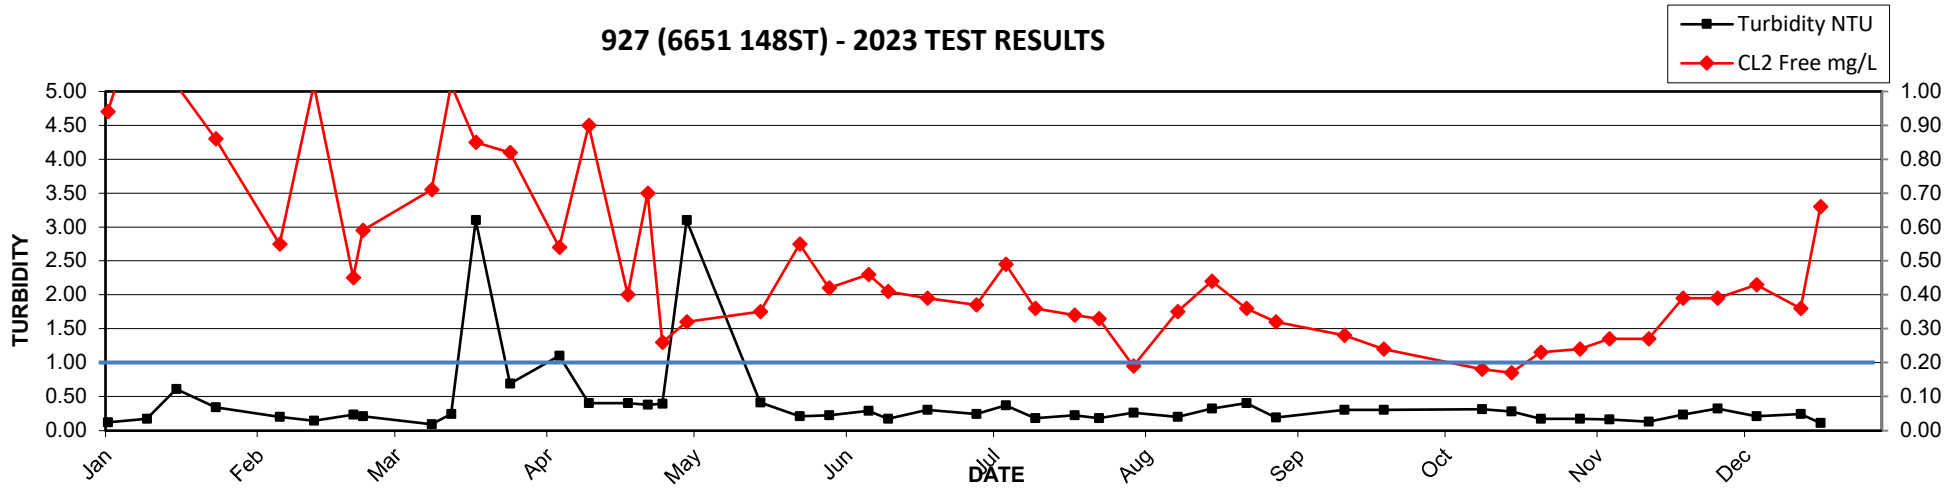


**2023 MV Laboratory Report - 928 (15335 57 AVE)**


<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.91	<1	<2	<1	7	0.12
12-Jan	0.61	<1	2	<1	9	0.14
18-Jan	1.10	<1	<2	<1	7	0.15
26-Jan	0.95	<1	<2	<1	7	0.13
30-Jan	0.21	<1	<2	<1	7	0.12
08-Feb	0.91	<1	<2	<1	7	0.54
14-Feb	1.06	<1	<2	<1	7	0.11
15-Feb	1.04	<1	2	<1	7	0.15
21-Feb	1.20	<1	<2	<1	7	0.31
22-Feb	1.02	<1	<2	<1	7	0.12
23-Feb	0.97	<1	<2	<1	7	0.11
24-Feb	1.16	<1	<2	<1	7	0.17
25-Feb	1.09	<1	<2	<1	6	0.08
11-Mar	1.13	<1	<2	<1	6.4	0.09
15-Mar	1.02	<1	<2	<1	6.7	0.11
20-Mar	1.04	<1	<2	<1	7.3	0.12
27-Mar	0.97	<1	<2	<1	7.4	0.15
06-Apr	1.10	<1	<2	<1	8.5	0.26
12-Apr	1.03	<1	<2	<1	7.9	0.34
19-Apr	1.19	<1	<2	<1	8.8	0.18
20-Apr	1.16	<1	<2	<1	8.6	0.12
24-Apr	1.16	<1	<2	<1	8.8	0.17
25-Apr	0.92	<1	<2	<1	8.9	0.19
27-Apr	0.81	<1	<2	<1	9	0.23
02-May	0.42	<1	<2	<1	10.3	0.19
04-May	0.47	<1	2	<1	10.9	0.26
08-May	0.59	<1	2	<1	11.6	0.33
12-May	0.43	<1	<2	<1	12.1	0.36
17-May	0.44	<1	10	<1	13.1	0.29
25-May	0.56	<1	4	<1	13.7	0.22
31-May	0.53	<1	10	<1	14.5	0.13
05-Jun	0.48	<1	24	<1	14.5	0.27
07-Jun	0.49	<1	10	<1	14.4	0.26
08-Jun	0.54	<1	8	<1	14.4	0.35
12-Jun	0.64	<1	24	<1	15.4	0.10
20-Jun	0.35	<1	20	<1	16	0.23
29-Jun	0.38	<1	8	<1	15.2	0.15
30-Jun	0.43	<1	14	<1	16.1	0.28
04-Jul	0.31	<1	26	<1	16.1	0.22
06-Jul	0.37	<1	14	<1	16.1	0.25
10-Jul	0.28	<1	46	<1	17.5	0.26
11-Jul	0.31	<1	28	<1	15.5	0.18
12-Jul	0.29	<1	10	<1	17.7	0.15
19-Jul	0.24	<1	54	<1	18.3	0.23
24-Jul	0.25	<1	48	<1	18.1	0.21
25-Jul	0.29	<1	18	<1	18.8	0.22
26-Jul	0.29	<1	100	<1	18.4	0.31
01-Aug	0.20	<1	360	<1	18.8	0.38
03-Aug	0.22	<1	330	<1	18.8	0.27
10-Aug	0.12	<1	630	<1	19.3	0.24
17-Aug	0.20	<1	1200	<1	19.4	0.25
24-Aug	0.12	<1	570	<1	19.8	0.35



### 928 (15335 57 AVE) - 2023 TEST RESULTS

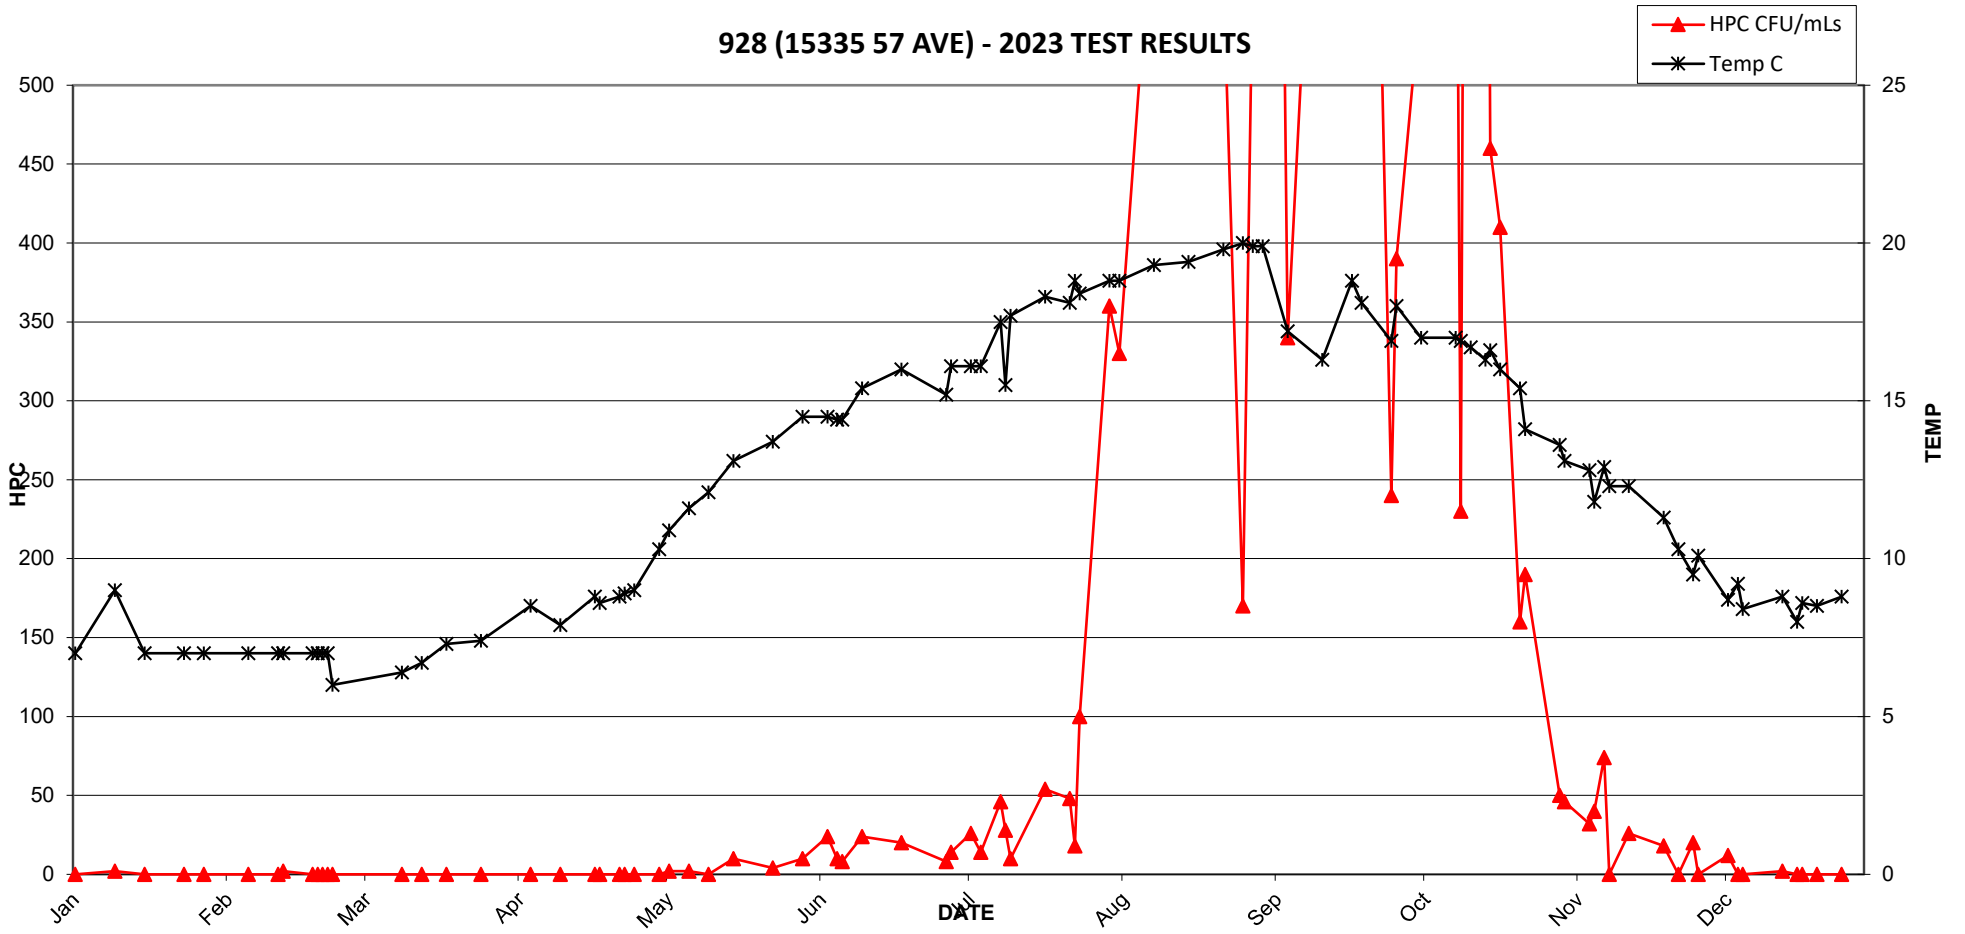


### 928 (15335 57 AVE) - 2023 TEST RESULTS

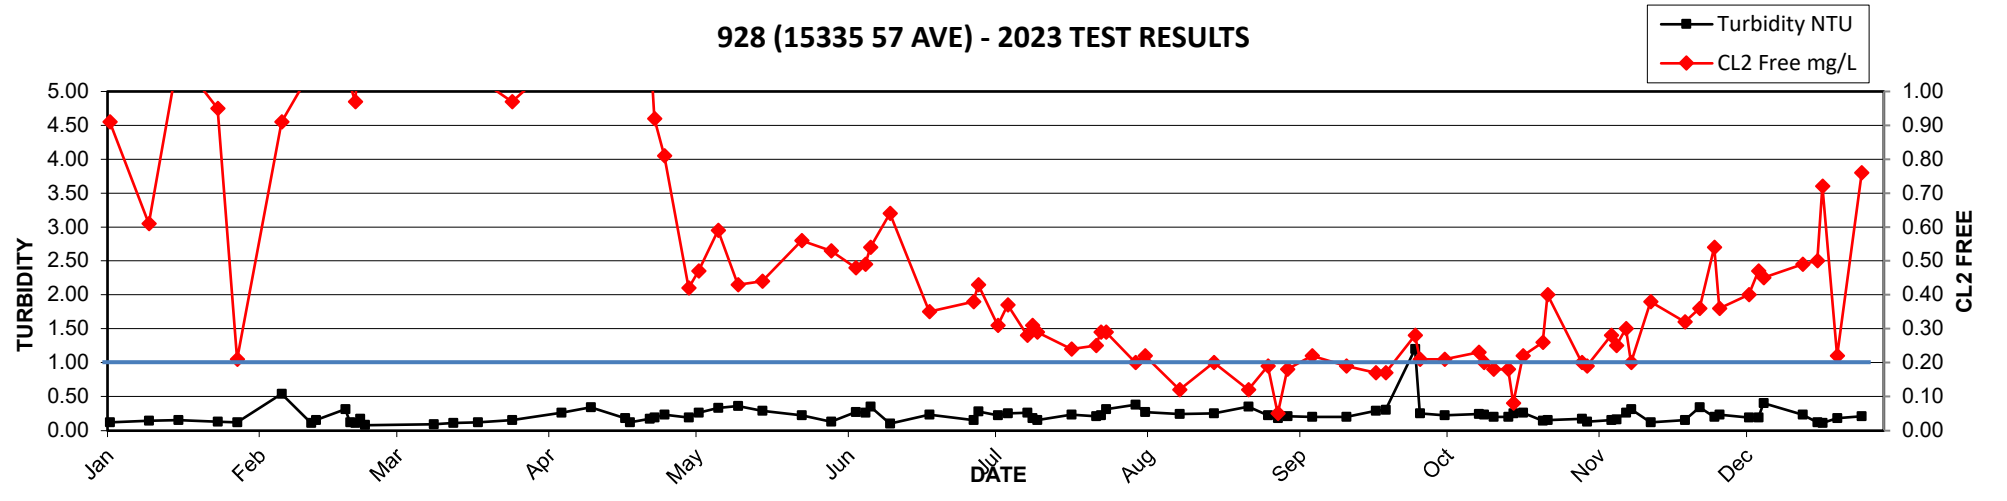


## 2023 MV Laboratory Report - 929 (14488 LOMBARD PL)

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.92	<1	<2	<1	7	0.09
12-Jan	0.88	<1	2	<1	9	0.13
18-Jan	0.99	<1	<2	<1	8	0.16
26-Jan	0.90	<1	<2	<1	7	0.11
30-Jan	0.40	<1	<2	<1	7	0.12
08-Feb	0.84	<1	<2	<1	7	0.09
15-Feb	1.04	<1	<2	<1	7	0.14
22-Feb	0.70	<1	<2	<1	6	0.13
23-Feb	0.95	<1	<2	<1	7	0.12
24-Feb	0.73	<1	<2	<1	6	0.15
25-Feb	0.95	<1	2	<1	6	0.10
11-Mar	0.89	<1	4	<1	6.3	0.09
15-Mar	1.03	<1	2	<1	7.1	0.11
20-Mar	1.00	<1	2	<1	6.4	0.11
27-Mar	0.66	<1	<2	<1	7	0.17
06-Apr	1.06	<1	<2	<1	8.9	0.52
12-Apr	1.11	<1	<2	<1	7.3	0.15
20-Apr	0.78	<1	<2	<1	9.3	0.11
24-Apr	0.88	<1	<2	<1	8	0.18
02-May	0.43	<1	<2	<1	11.4	0.17
04-May	0.47	<1	<2	<1	11.9	0.22
17-May	0.48	<1	<2	<1	14.4	0.24
25-May	0.58	<1	6	<1	14.9	0.22
31-May	0.53	<1	<2	<1	15	0.17
07-Jun	0.37	<1	<2	<1	15.7	0.37
08-Jun	0.47	<1	2	<1	15.6	0.26
12-Jun	0.34	<1	<2	<1	16.3	0.12
20-Jun	0.36	<1	8	<1	16.1	0.31
29-Jun	0.45	<1	NA	<1	16.5	0.43
06-Jul	0.60	<1	10	<1	16	0.18
12-Jul	0.44	<1	20	<1	16.6	0.20
19-Jul	0.49	<1	48	<1	17.1	0.23
25-Jul	0.25	<1	18	<1	20	0.17
01-Aug	0.29	<1	400	<1	19.4	0.28
03-Aug	0.24	<1	64	<1	19.4	0.31
10-Aug	0.12	<1	510	<1	20.2	0.21
17-Aug	0.16	<1	940	<1	20.3	0.30
24-Aug	0.17	<1	620	<1	20	0.25
30-Aug	0.09	<1	410	<1	20.2	0.20
06-Sep	0.29	<1	600	<1	18	0.32
13-Sep	0.16	<1	850	<1	18	0.21
21-Sep	0.17	<1	640	<1	17.7	0.30
28-Sep	0.20	<1	220	<1	17	0.33
03-Oct	0.29	<1	860	<1	17	0.21
10-Oct	0.29	<1	800	<1	16	0.24
11-Oct	0.19	<1	340	<1	17	0.22
13-Oct	0.23	<1	1400	<1	16.6	0.20
17-Oct	0.08	<1	1300	<1	16.1	0.19
23-Oct	0.20	<1	220	<1	15.3	0.20
30-Oct	0.29	<1	110	<1	13.7	0.13
31-Oct	0.12	<1	50	<1	13.5	0.14
06-Nov	0.20	<1	16	<1	12.8	0.15
09-Nov	0.37	<1	4	<1	12.1	0.32
14-Nov	0.32	<1	8	<1	12.2	0.13

### 929 (14488 LOMBARD PL) - 2023 TEST RESULTS


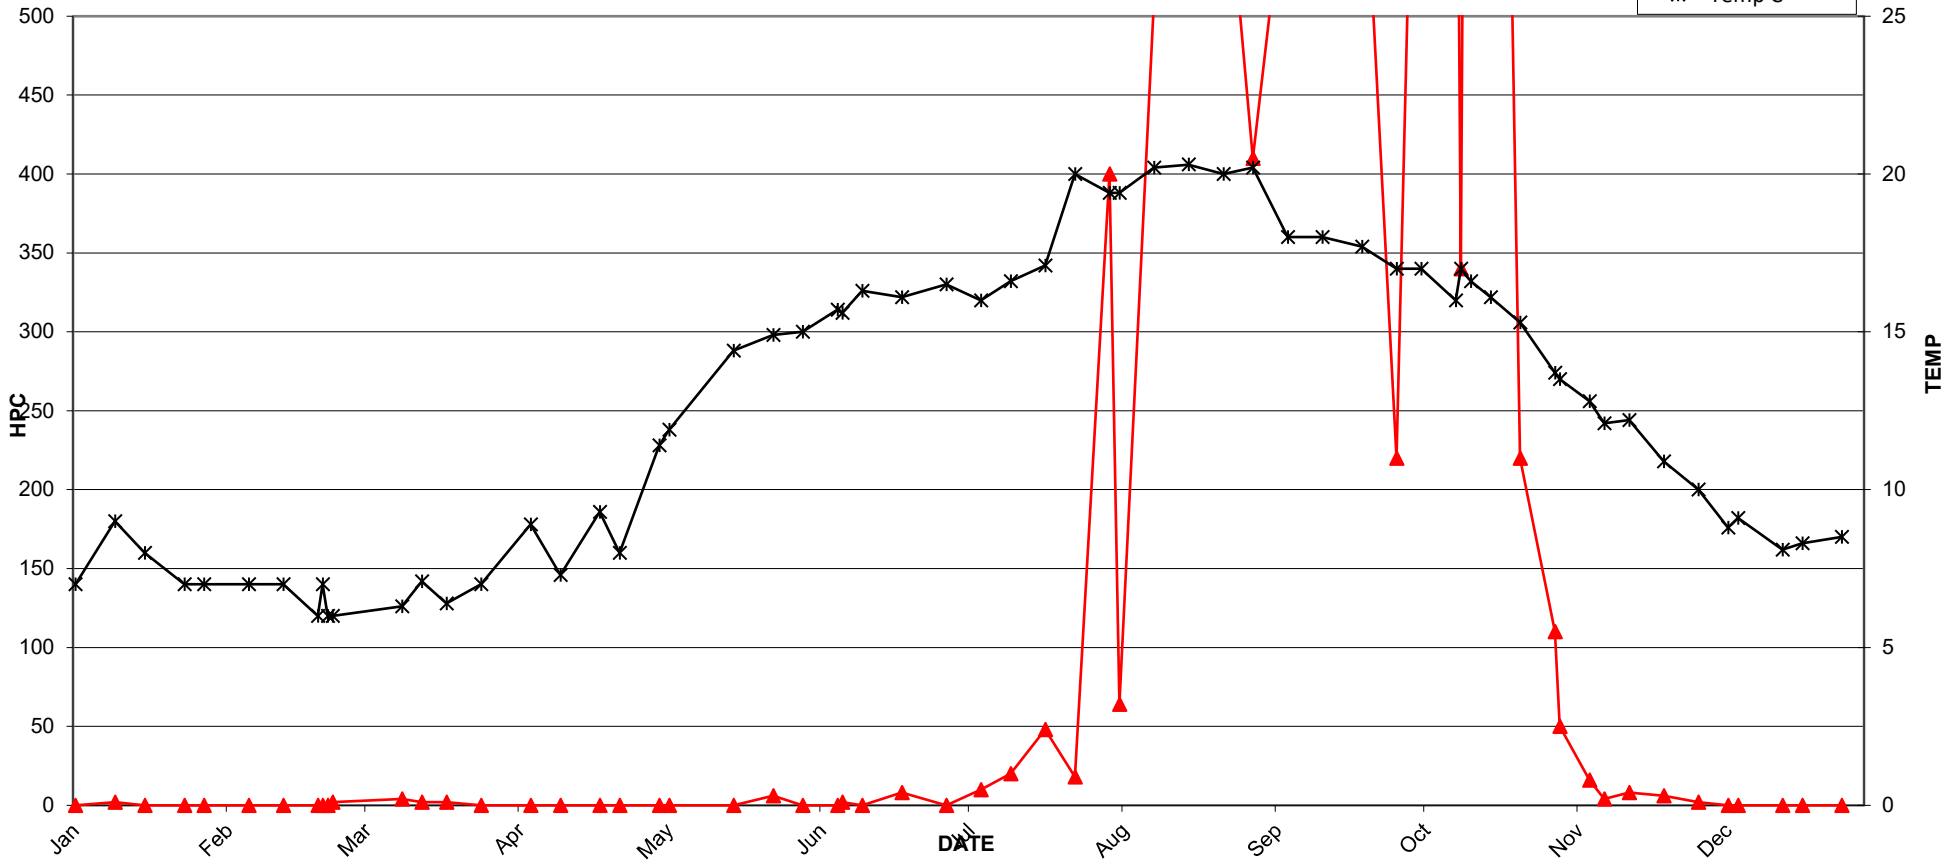


### 929 (14488 LOMBARD PL) - 2023 TEST RESULTS

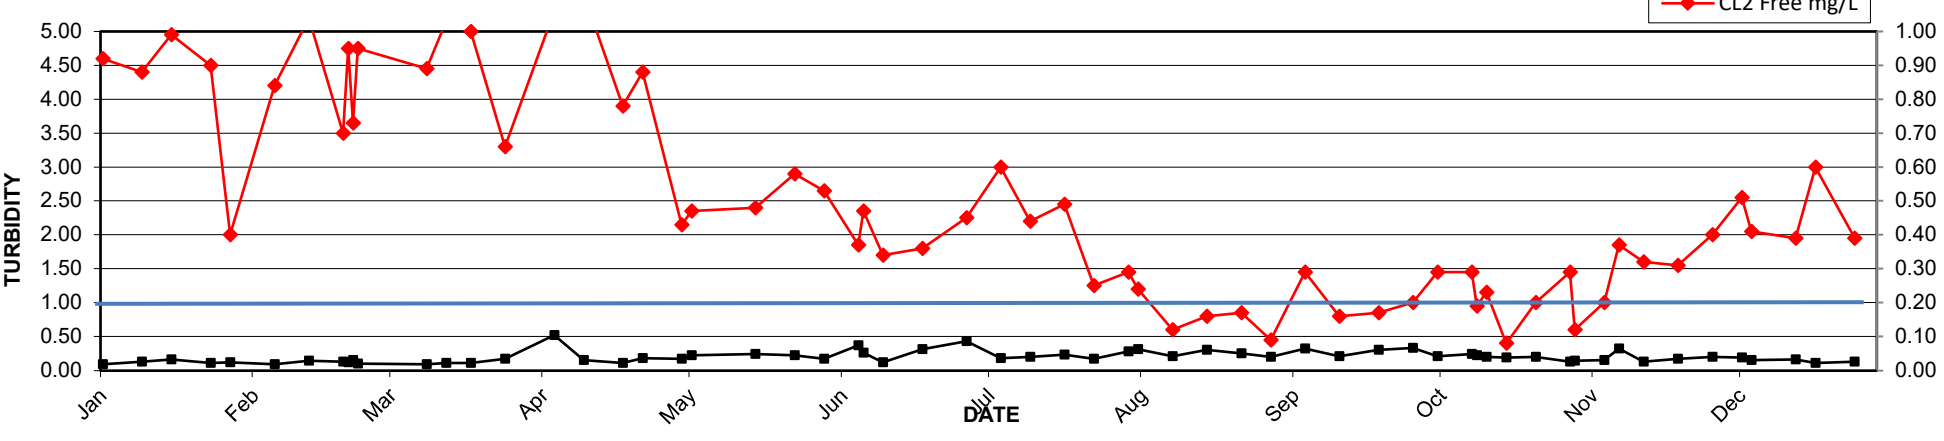



## 2023 MV Laboratory Report - 930 (3031 139 ST)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.27	<1	2	<1	7	0.32
12-Jan	0.61	<1	<2	<1	7	0.47
24-Jan	0.30	<1	<2	<1	7	0.39
02-Feb	0.20	<1	<2	<1	7	0.25
07-Feb	0.29	<1	2	<1	7	0.21
14-Feb	0.33	<1	<2	<1	7	0.27
21-Feb	0.27	<1	<2	<1	8	0.25
04-Mar	0.18	<1	<2	<1	6.4	0.20
11-Mar	0.16	<1	<2	<1	6.7	0.21
14-Mar	0.19	<1	4	<1	7	0.26
22-Mar	0.28	<1	<2	<1	7.6	0.30
25-Mar	0.54	<1	<2	<1	7.8	0.30
29-Mar	0.24	<1	<2	<1	8	0.91
05-Apr	0.22	<1	4	<1	7.9	0.25
11-Apr	0.28	<1	<2	<1	9	0.35
19-Apr	0.22	<1	<2	<1	9	0.42
25-Apr	0.23	<1	4	<1	9.3	0.31
26-Apr	0.19	<1	4	<1	8.6	0.33
01-May	0.28	<1	4	<1	10.3	0.59
08-May	0.27	<1	<2	<1	11	0.31
11-May	0.46	<1	<2	<1	11.4	0.35
15-May	0.46	<1	<2	<1	11.5	0.43
24-May	0.43	<1	<2	<1	12.3	0.33
01-Jun	0.43	<1	2	<1	12.2	0.33
05-Jun	0.43	<1	<2	<1	12.9	0.45
07-Jun	0.51	<1	6	<1	12.9	0.32
13-Jun	0.34	<1	6	<1	14	0.27
16-Jun	0.38	<1	<2	<1	13.2	0.22
20-Jun	0.39	<1	4	<1	13.7	0.21
28-Jun	0.43	<1	<2	<1	13.3	0.30
04-Jul	0.42	<1	6	<1	14.4	0.33
10-Jul	0.44	<1	34	<1	14.30	0.37
11-Jul	0.43	<1	8	<1	15.4	0.22
12-Jul	0.35	<1	<2	<1	15	0.25
18-Jul	0.46	<1	6	<1	15.5	0.32
28-Jul	0.30	<1	10	<1	16.5	0.37
01-Aug	0.35	<1	2	<1	16.5	0.29
09-Aug	0.22	<1	6	<1	17.2	0.22
14-Aug	0.31	<1	<2	<1	17.2	0.29
23-Aug	0.25	<1	12	<1	18.2	0.37
01-Sep	0.24	<1	10	<1	17.7	0.20
05-Sep	0.18	<1	2	<1	17.4	0.21
13-Sep	0.19	<1	<2	<1	17.3	0.21
19-Sep	0.37	<1	16	<1	17.3	0.31
27-Sep	0.23	<1	12	<1	16.2	0.24
04-Oct	0.20	<1	24	<1	16	0.22
10-Oct	0.20	<1	14	<1	15.5	0.26
12-Oct	0.12	<1	4	<1	15.6	0.25
16-Oct	0.19	<1	40	<1	15.7	0.25
24-Oct	0.24	<1	10	<1	14.6	0.39
27-Oct	0.07	<1	40	<1	14	0.36
30-Oct	0.17	<1	36	<1	13.7	0.33
01-Nov	0.14	<1	6	<1	13	0.28
07-Nov	0.39	<1	30	<1	12.2	0.27
09-Nov	0.09	<1	30	<1	12.6	0.42
14-Nov	0.19	<1	110	<1	12	0.29
22-Nov	0.18	<1	28	<1	11.1	0.24
27-Nov	0.33	<1	50	<1	9.7	0.26
04-Dec	0.13	<1	12	<1	9.2	0.14
12-Dec	0.45	<1	<2	<1	8.9	0.16
18-Dec	0.55	<1	NA	<1	9	0.39
27-Dec	0.72	<1	NA	<1	9	0.44

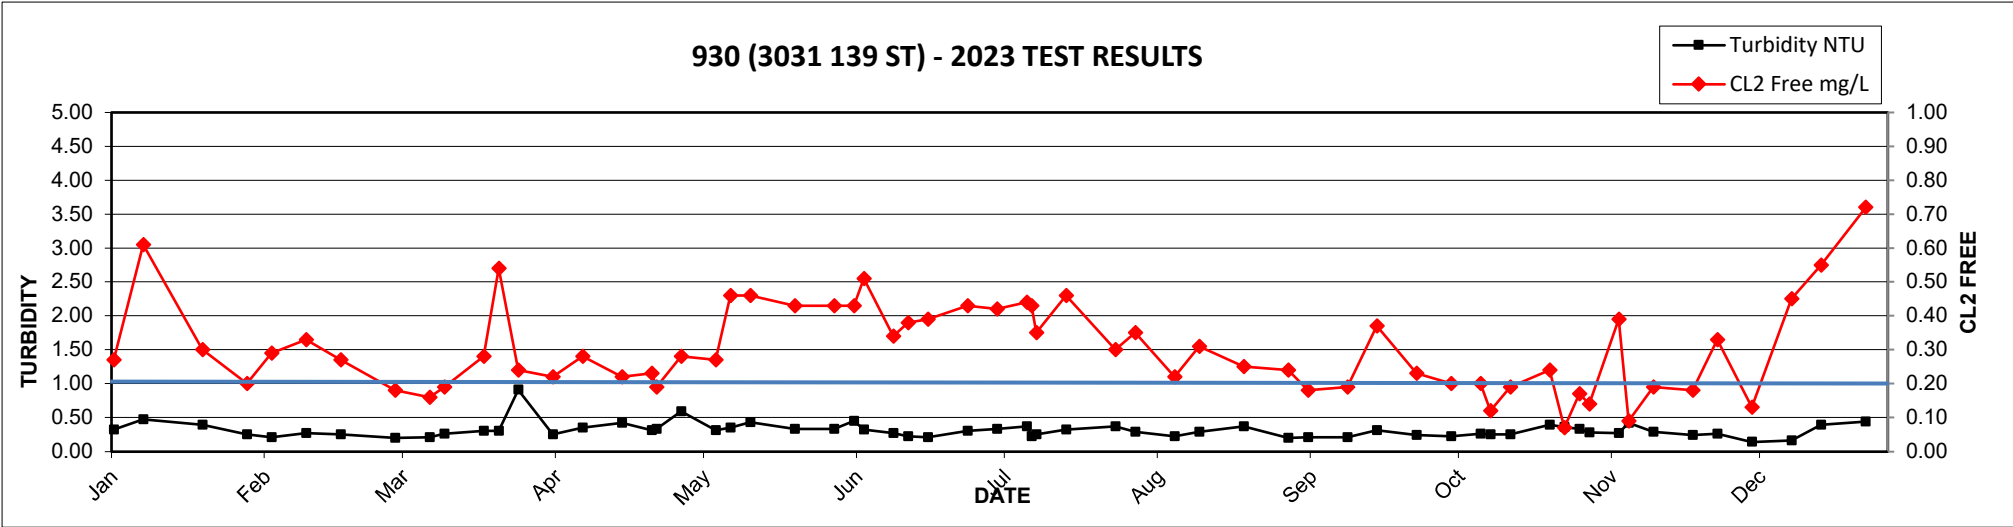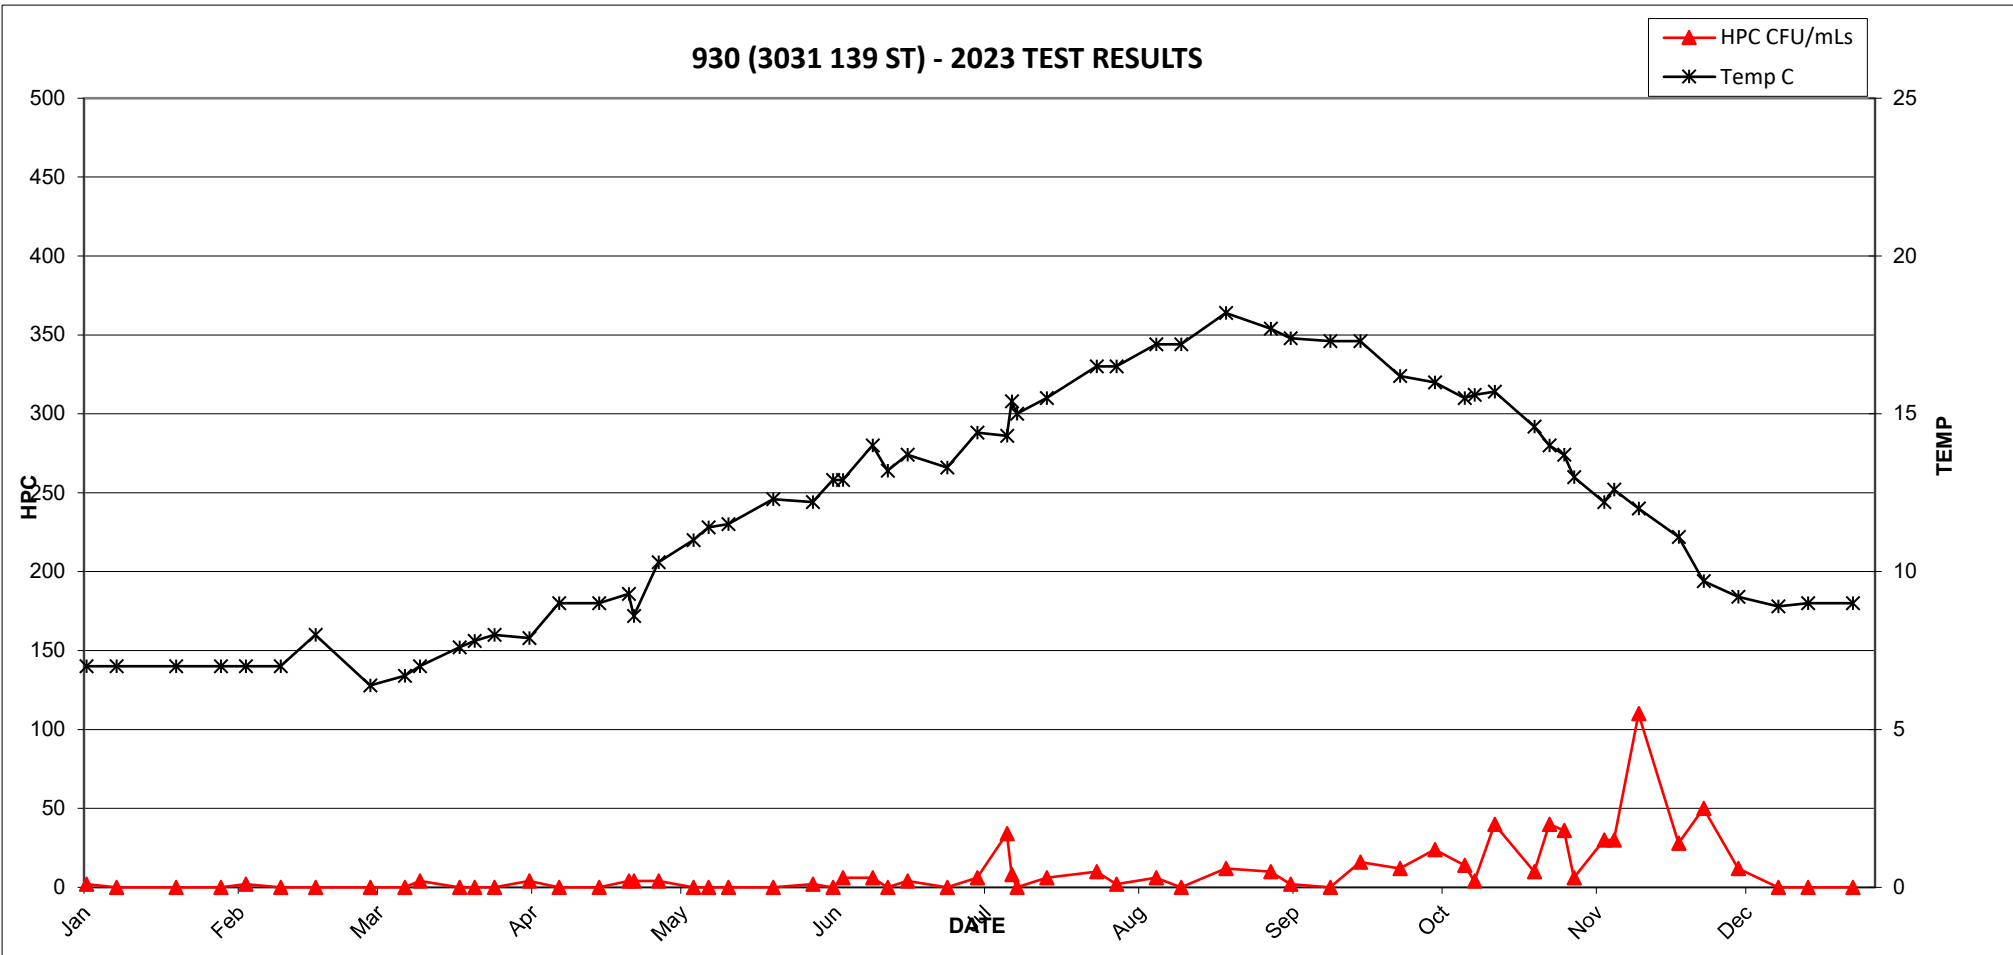

## 2023 MV Laboratory Report - 931 (2389 124 ST)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.50	<1	<2	<1	7	0.42
12-Jan	0.34	<1	<2	<1	7	0.31
17-Jan	0.39	<1	<2	<1	7	0.27
24-Jan	0.28	<1	<2	<1	7	0.33
02-Feb	0.31	<1	2	<1	7	0.26
07-Feb	0.21	<1	<2	<1	7	0.38
14-Feb	0.40	<1	<2	<1	6	0.28
21-Feb	0.40	<1	<2	<1	6	0.25
04-Mar	0.28	<1	<2	<1	6.1	0.27
14-Mar	0.31	<1	<2	<1	6.6	0.23
22-Mar	0.19	<1	<2	<1	7.3	0.23
25-Mar	0.59	<1	2	<1	7.4	0.38
29-Mar	0.23	<1	<2	<1	7.9	0.37
05-Apr	0.29	<1	8	<1	7.7	0.43
11-Apr	0.33	<1	<2	<1	7.8	0.38
19-Apr	0.24	<1	<2	<1	8.1	0.40
25-Apr	0.22	<1	14	<1	8.3	0.37
26-Apr	0.39	<1	<2	<1	8.2	0.40
01-May	0.24	<1	2	<1	8.9	0.45
04-May	0.41	<1	<2	<1	10	0.41
08-May	0.23	<1	<2	<1	9.1	0.36
11-May	0.16	<1	<2	<1	11.7	0.40
15-May	0.48	<1	2	<1	10.5	0.64
24-May	0.38	<1	<2	<1	11.9	0.31
01-Jun	0.31	<1	2	<1	11.8	0.31
05-Jun	0.32	<1	<2	<1	12.5	0.48
13-Jun	0.20	<1	2	<1	13.3	0.29
16-Jun	0.29	<1	<2	<1	13.2	0.25
20-Jun	0.24	<1	<2	<1	13.7	0.40
28-Jun	0.30	<1	<2	<1	13.2	0.32
04-Jul	0.25	<1	2	<1	14.4	0.30
10-Jul	0.31	<1	4	<1	14.5	0.36
11-Jul	0.25	<1	2	<1	15	0.32
12-Jul	0.25	<1	<2	<1	14.8	0.31
18-Jul	0.3	<1	<2	<1	15	0.41
28-Jul	0.22	<1	<2	<1	16.5	0.40
01-Aug	0.24	<1	<2	<1	16.4	0.39
09-Aug	0.21	<1	4	<1	17	0.38
14-Aug	0.17	<1	<2	<1	17.2	0.32
23-Aug	0.41	<1	<2	<1	16.3	0.45
28-Aug	0.31	<1	<2	<1	17.7	0.31
05-Sep	0.30	<1	4	<1	17.7	0.21
13-Sep	0.20	<1	8	<1	17.4	0.29
19-Sep	0.35	<1	6	<1	17.5	0.30
27-Sep	0.17	<1	8	<1	16.7	0.25
04-Oct	0.30	<1	6	<1	15	0.22
10-Oct	0.22	<1	2	<1	15.5	0.21
12-Oct	0.19	<1	24	<1	15.5	0.19
16-Oct	0.27	<1	20	<1	15.2	0.32
24-Oct	0.22	<1	18	<1	14.4	0.41
27-Oct	0.08	<1	50	<1	14	0.43
01-Nov	0.31	<1	24	<1	12.7	0.36
09-Nov	0.07	<1	8	<1	12.4	0.32
14-Nov	0.39	<1	36	<1	11.1	0.33
22-Nov	0.18	<1	28	<1	10.9	0.27
27-Nov	0.29	<1	20	<1	9.4	0.42
04-Dec	0.21	<1	<2	<1	9	0.14
12-Dec	0.58	<1	<2	<1	8.8	0.2
18-Dec	0.44	<1	NA	<1	7.9	0.39
27-Dec	0.77	<1	NA	<1	8.2	0.94

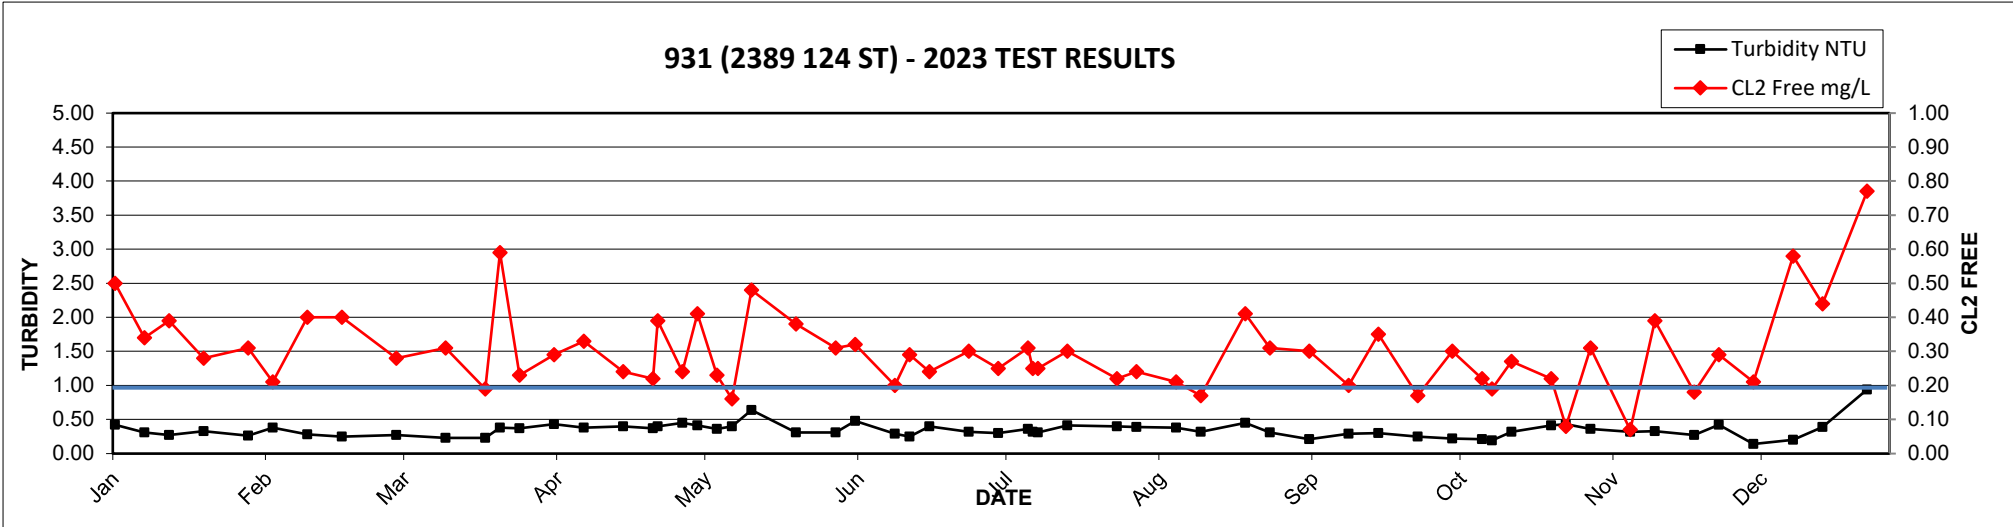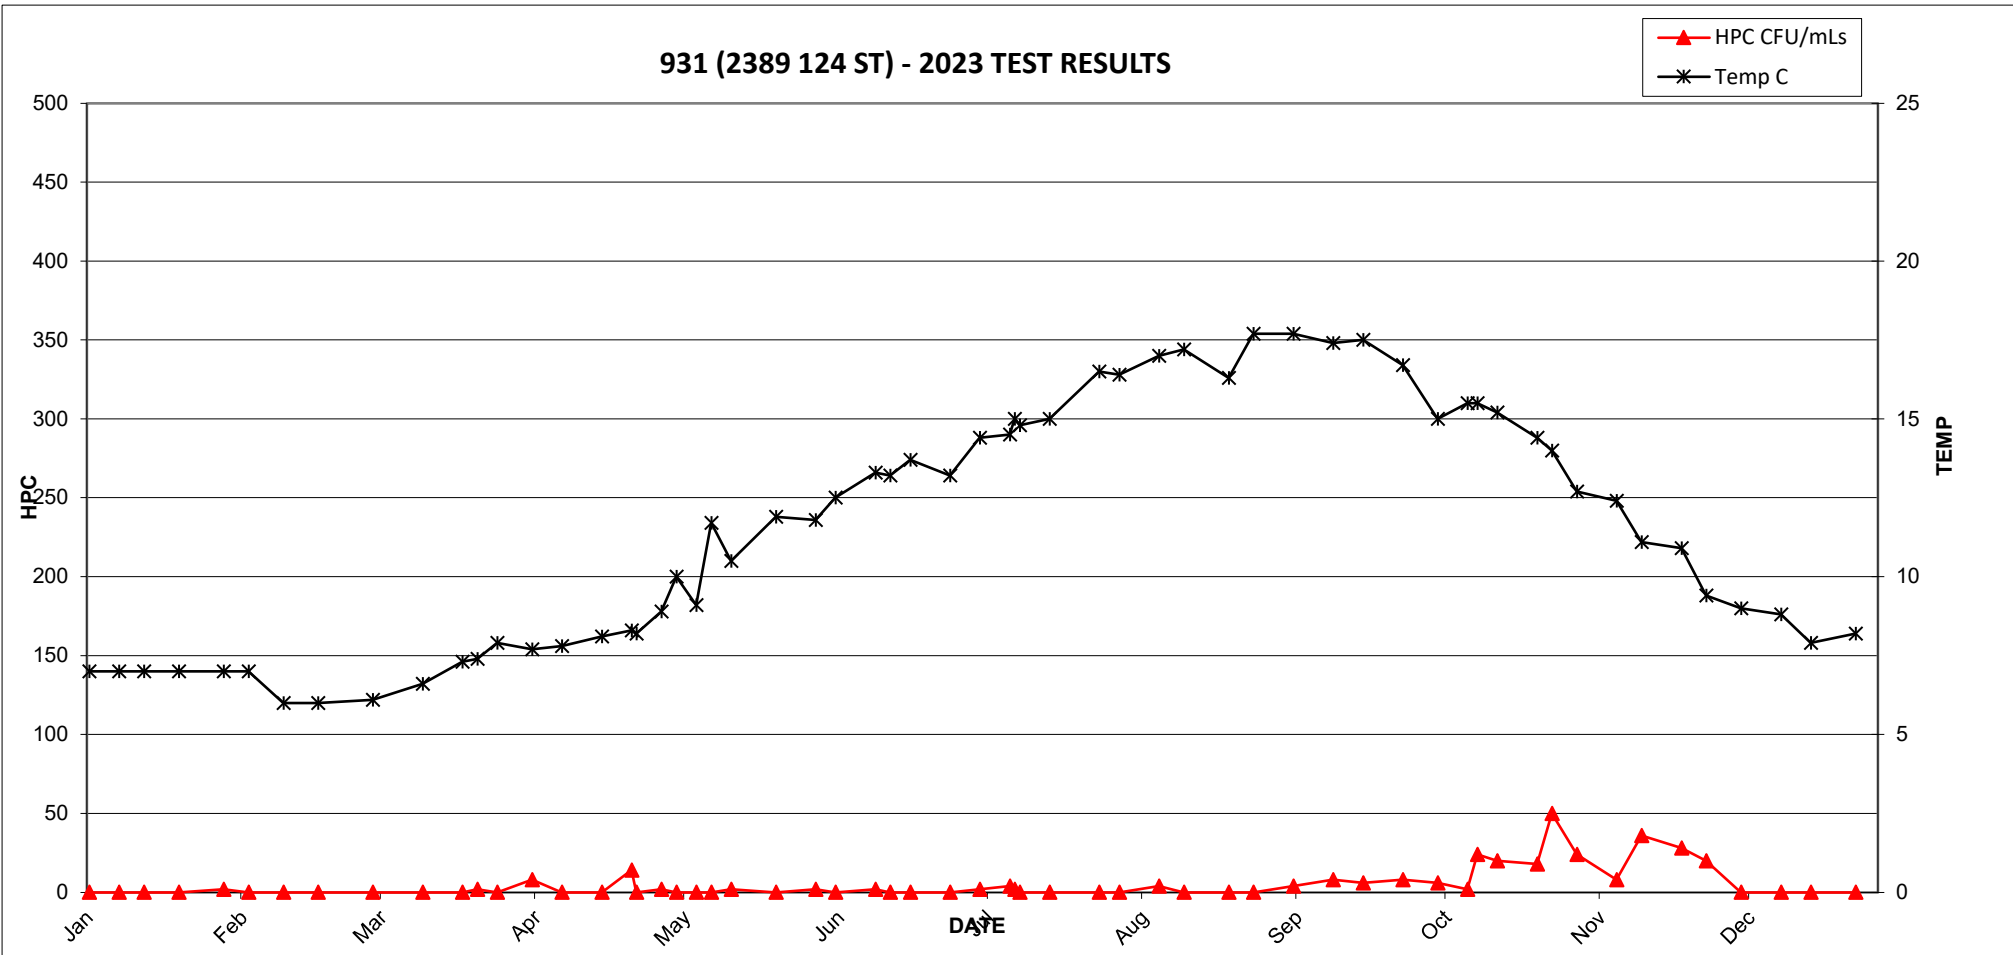


## 2023 MV Laboratory Report - 932 (1473 126A ST)


Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
06-Jan	0.40	<1	2	<1	6	0.59
12-Jan	0.19	<1	<2	<1	8	0.25
17-Jan	0.20	<1	<2	<1	8	0.26
24-Jan	0.18	<1	<2	<1	8	0.33
26-Jan	0.19	<1	4	<1	8	0.28
02-Feb	0.21	<1	<2	<1	7	0.32
07-Feb	0.18	<1	2	<1	7	0.24
14-Feb	0.27	<1	<2	<1	7	0.34
21-Feb	0.15	<1	<2	<1	8	0.31
04-Mar	0.20	<1	<2	<1	6.5	0.24
14-Mar	0.11	<1	<2	<1	7.3	0.24
22-Mar	0.07	<1	2	<1	8.2	0.23
25-Mar	0.53	<1	4	<1	8	0.32
29-Mar	0.07	<1	<2	<1	8.4	0.36
05-Apr	0.15	<1	<2	<1	8.6	0.30
11-Apr	0.16	<1	2	<1	8	0.33
19-Apr	0.21	<1	<2	<1	9	0.45
25-Apr	0.33	<1	2	<1	9	0.33
26-Apr	0.21	<1	2	<1	9.5	0.38
01-May	0.21	<1	<2	<1	10.1	0.38
04-May	0.18	<1	<2	<1	11	0.42
08-May	0.18	<1	<2	<1	11.2	0.32
11-May	0.20	<1	<2	<1	12.6	0.37
15-May	0.33	<1	<2	<1	11.6	0.41
24-May	0.21	<1	<2	<1	13.5	0.24
01-Jun	0.23	<1	2	<1	13.4	0.33
05-Jun	0.17	<1	<2	<1	14.4	0.56
07-Jun	0.23	<1	<2	<1	13	0.26
13-Jun	0.18	<1	<2	<1	14.3	0.34
16-Jun	0.10	<1	<2	<1	14.4	0.30
20-Jun	0.23	<1	2	<1	14.8	0.29
28-Jun	0.17	<1	<2	<1	14.5	0.25
04-Jul	0.20	<1	LA	<1	15.1	0.52
10-Jul	0.22	<1	6	<1	16	0.30
18-Jul	0.16	<1	2	<1	17	0.27
25-Jul	0.07	<1	<2	<1	11.7	0.25
01-Aug	0.17	<1	2	<1	17.5	0.33
03-Aug	0.17	<1	4	<1	17.4	0.29
09-Aug	0.16	<1	<2	<1	18	0.28
14-Aug	0.11	<1	2	<1	17.8	0.29
23-Aug	0.22	<1	18	<1	18.3	0.40
28-Aug	0.24	<1	6	<1	18	0.23
05-Sep	0.15	<1	10	<1	18.2	0.21
13-Sep	0.08	<1	14	<1	17.8	0.23
19-Sep	0.23	<1	12	<1	18	0.37
27-Sep	0.15	<1	24	<1	17	0.27
04-Oct	0.18	<1	22	<1	16	0.24
10-Oct	0.13	<1	50	<1	15.7	0.27
12-Oct	0.10	<1	64	<1	15.8	0.20
13-Oct	0.27	<1	52	<1	15.9	0.21
16-Oct	0.21	<1	50	<1	15.5	0.28
24-Oct	0.32	<1	170	<1	14.7	0.42
27-Oct	0.07	<1	130	<1	14.1	0.39
01-Nov	0.19	<1	190	<1	13.1	0.29
07-Nov	0.14	<1	80	<1	12.3	0.31
09-Nov	0.06	<1	110	<1	12.7	0.4
10-Nov	0.19	<1	96	<1	12.6	0.33



932 (1473 126A ST) - 2023 TEST RESULTS

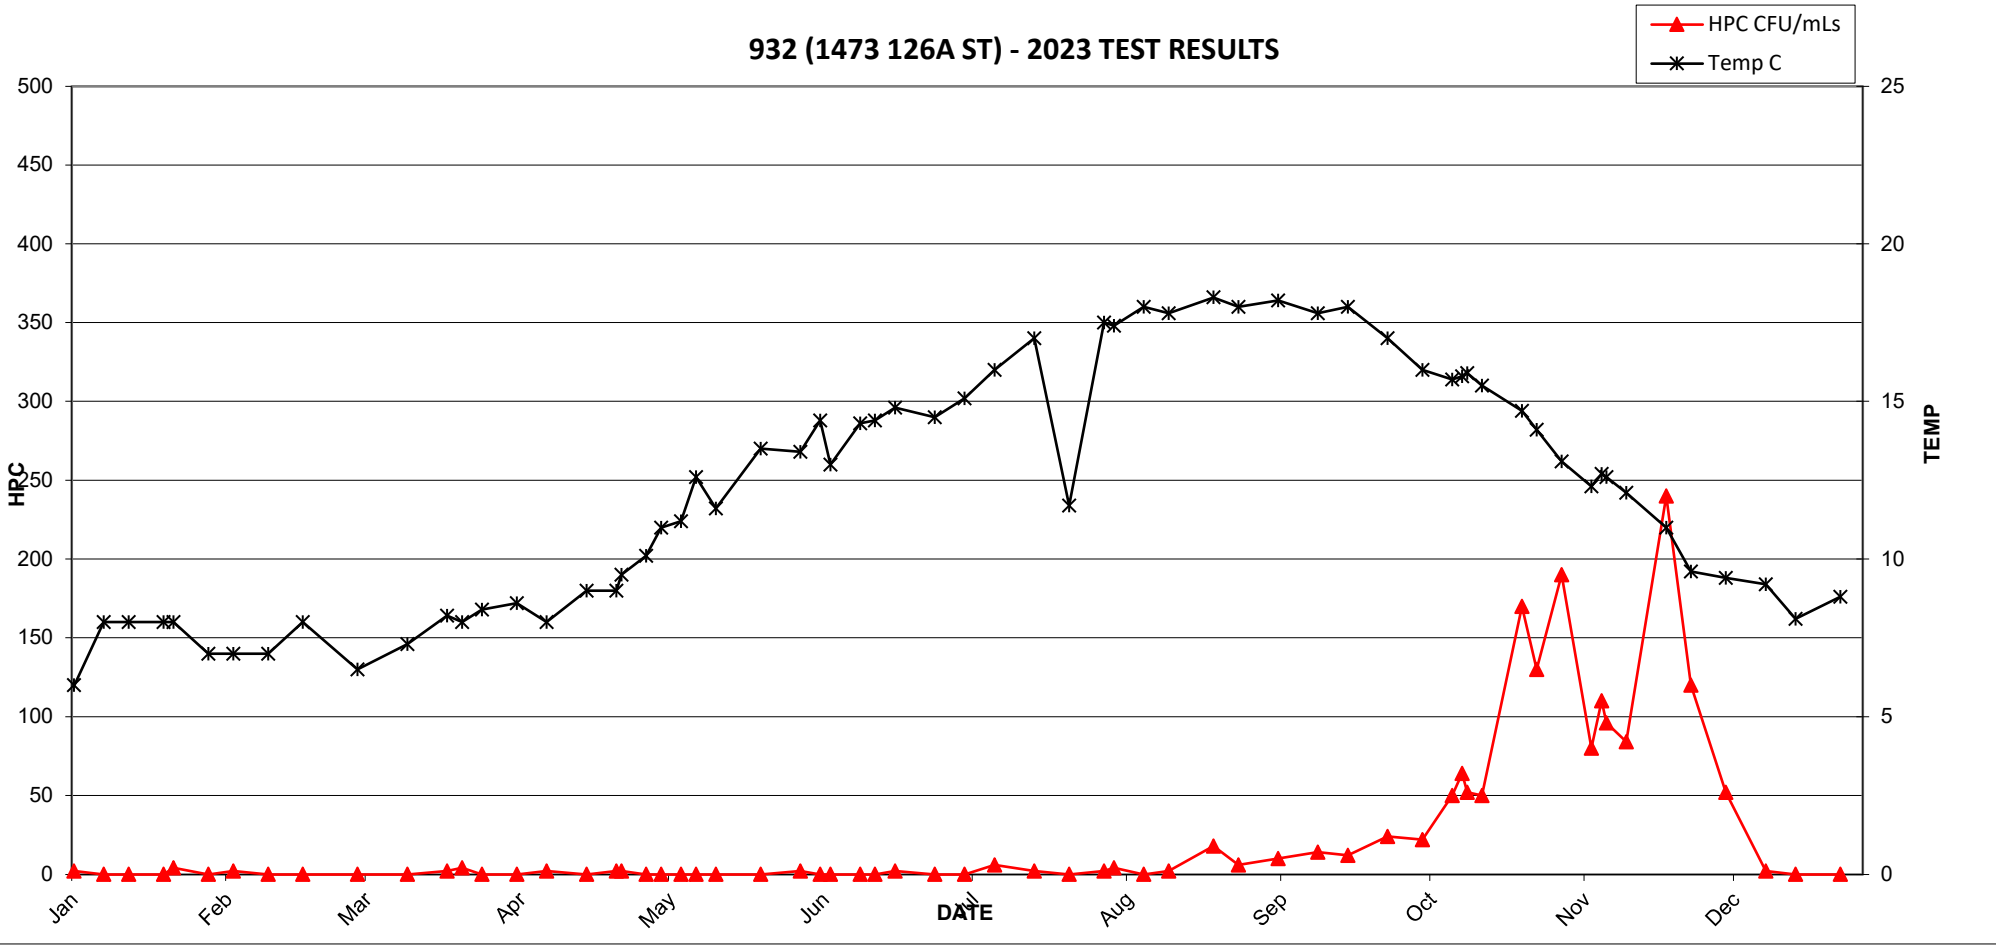


932 (1473 126A ST) - 2023 TEST RESULTS

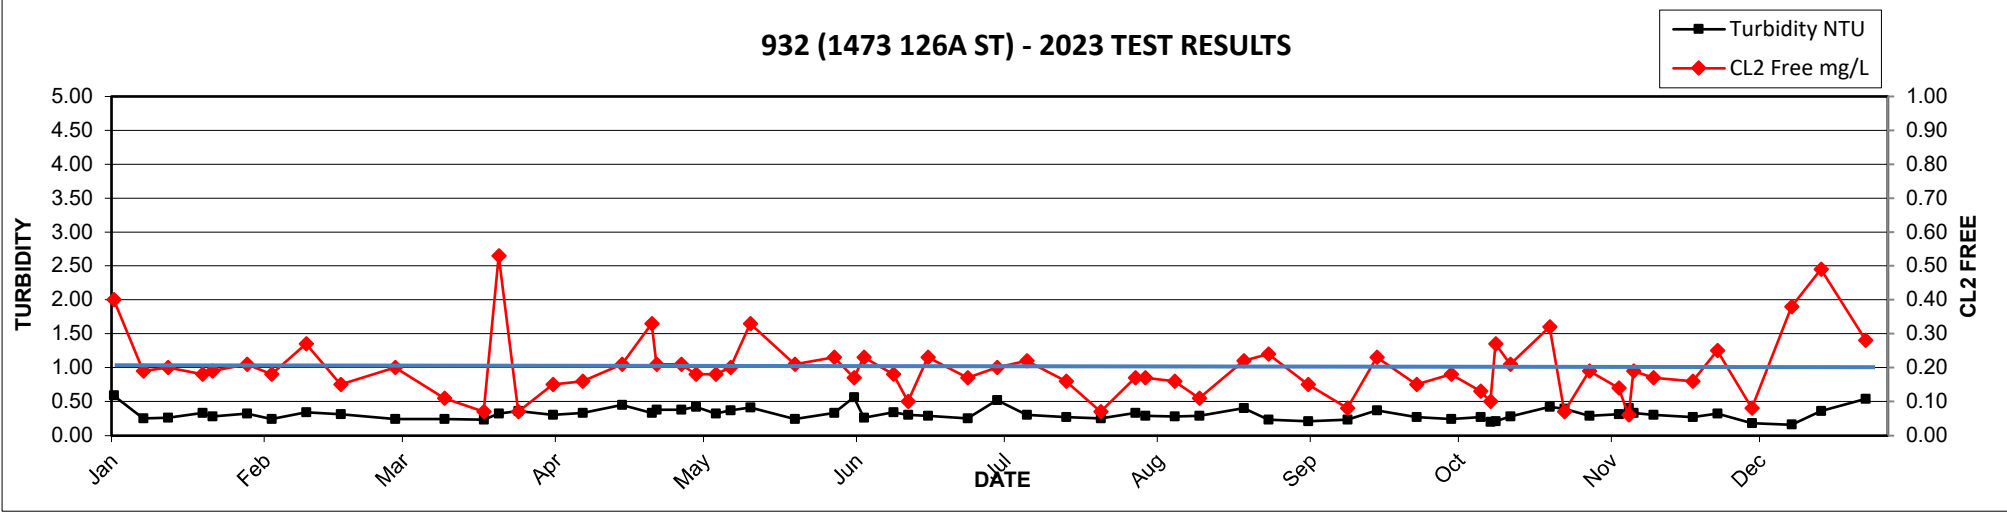


## 2023 MV Laboratory Report - 933 (1547 133B ST)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.39	<1	<2	<1	6	0.36
12-Jan	0.48	<1	<2	<1	7	0.31
17-Jan	0.46	<1	<2	<1	7	0.25
24-Jan	0.37	<1	<2	<1	7	0.27
26-Jan	0.50	<1	<2	<1	7	0.24
02-Feb	0.25	<1	<2	<1	7	0.35
07-Feb	0.24	<1	<2	<1	7	0.25
14-Feb	0.55	<1	<2	<1	6	0.28
21-Feb	0.31	<1	2	<1	6	0.50
04-Mar	0.34	<1	<2	<1	5.9	0.26
14-Mar	0.44	<1	<2	<1	6.6	0.30
22-Mar	0.39	<1	<2	<1	7.2	0.24
25-Mar	0.69	<1	<2	<1	7.3	0.34
29-Mar	0.38	<1	<2	<1	7.5	0.38
05-Apr	0.45	<1	4	<1	7.9	0.45
11-Apr	0.40	<1	2	<1	7.7	0.43
19-Apr	0.44	<1	<2	<1	8.4	0.42
25-Apr	0.28	<1	<2	<1	8.2	0.64
26-Apr	0.54	<1	<2	<1	7.9	0.43
01-May	0.45	<1	6	<1	9	0.53
08-May	0.45	<1	<2	<1	9.5	0.34
11-May	0.33	<1	<2	<1	11.8	0.44
15-May	0.65	<1	<2	<1	10.2	0.45
24-May	0.52	<1	<2	<1	11.1	0.26
01-Jun	0.54	<1	<2	<1	11.2	0.32
07-Jun	0.65	<1	<2	<1	11.9	0.27
13-Jun	0.52	<1	<2	<1	12.9	0.33
16-Jun	0.44	<1	<2	<1	12.5	0.29
20-Jun	0.48	<1	4	<1	13.1	0.31
28-Jun	0.50	<1	4	<1	12.7	0.24
04-Jul	0.45	<1	14	<1	13	0.30
10-Jul	0.69	<1	12	<1	14.1	0.27
18-Jul	0.49	<1	10	<1	15	0.26
25-Jul	0.30	<1	2	<1	16	0.22
01-Aug	0.34	<1	6	<1	16.1	0.34
03-Aug	0.39	<1	2	<1	16.4	0.34
09-Aug	0.31	<1	2	<1	16.7	0.33
14-Aug	0.28	<1	4	<1	16.9	0.22
23-Aug	0.45	<1	4	<1	17.6	0.29
28-Aug	0.39	<1	12	<1	17.9	0.28
05-Sep	0.32	<1	6	<1	19	0.27
13-Sep	0.35	<1	4	<1	17.2	0.25
19-Sep	0.49	LA	48	LA	17.9	0.36
27-Sep	0.38	<1	36	<1	16	0.26
04-Oct	0.27	<1	8	<1	16	0.23
10-Oct	0.36	<1	10	<1	14.8	0.22
12-Oct	0.39	<1	24	<1	15.4	0.20
16-Oct	0.34	<1	6	<1	16.2	0.25
24-Oct	0.34	<1	20	<1	14	0.43
27-Oct	0.23	<1	10	<1	13.7	0.44
07-Nov	0.40	<1	14	<1	12	0.32
09-Nov	0.25	<1	10	<1	12.3	0.35
14-Nov	0.24	<1	2	<1	11	0.26
22-Nov	0.22	<1	4	<1	10.8	0.27
27-Nov	0.27	<1	8	<1	9.4	0.38
08-Dec	0.44	<1	<2	<1	9.1	0.26
12-Dec	0.66	<1	<2	<1	8.7	0.20
18-Dec	0.62	<1	NA	<1	8.5	0.35
27-Dec	0.78	<1	NA	<1	8.7	0.59

933 (1547 133B ST) - 2023 TEST RESULTS


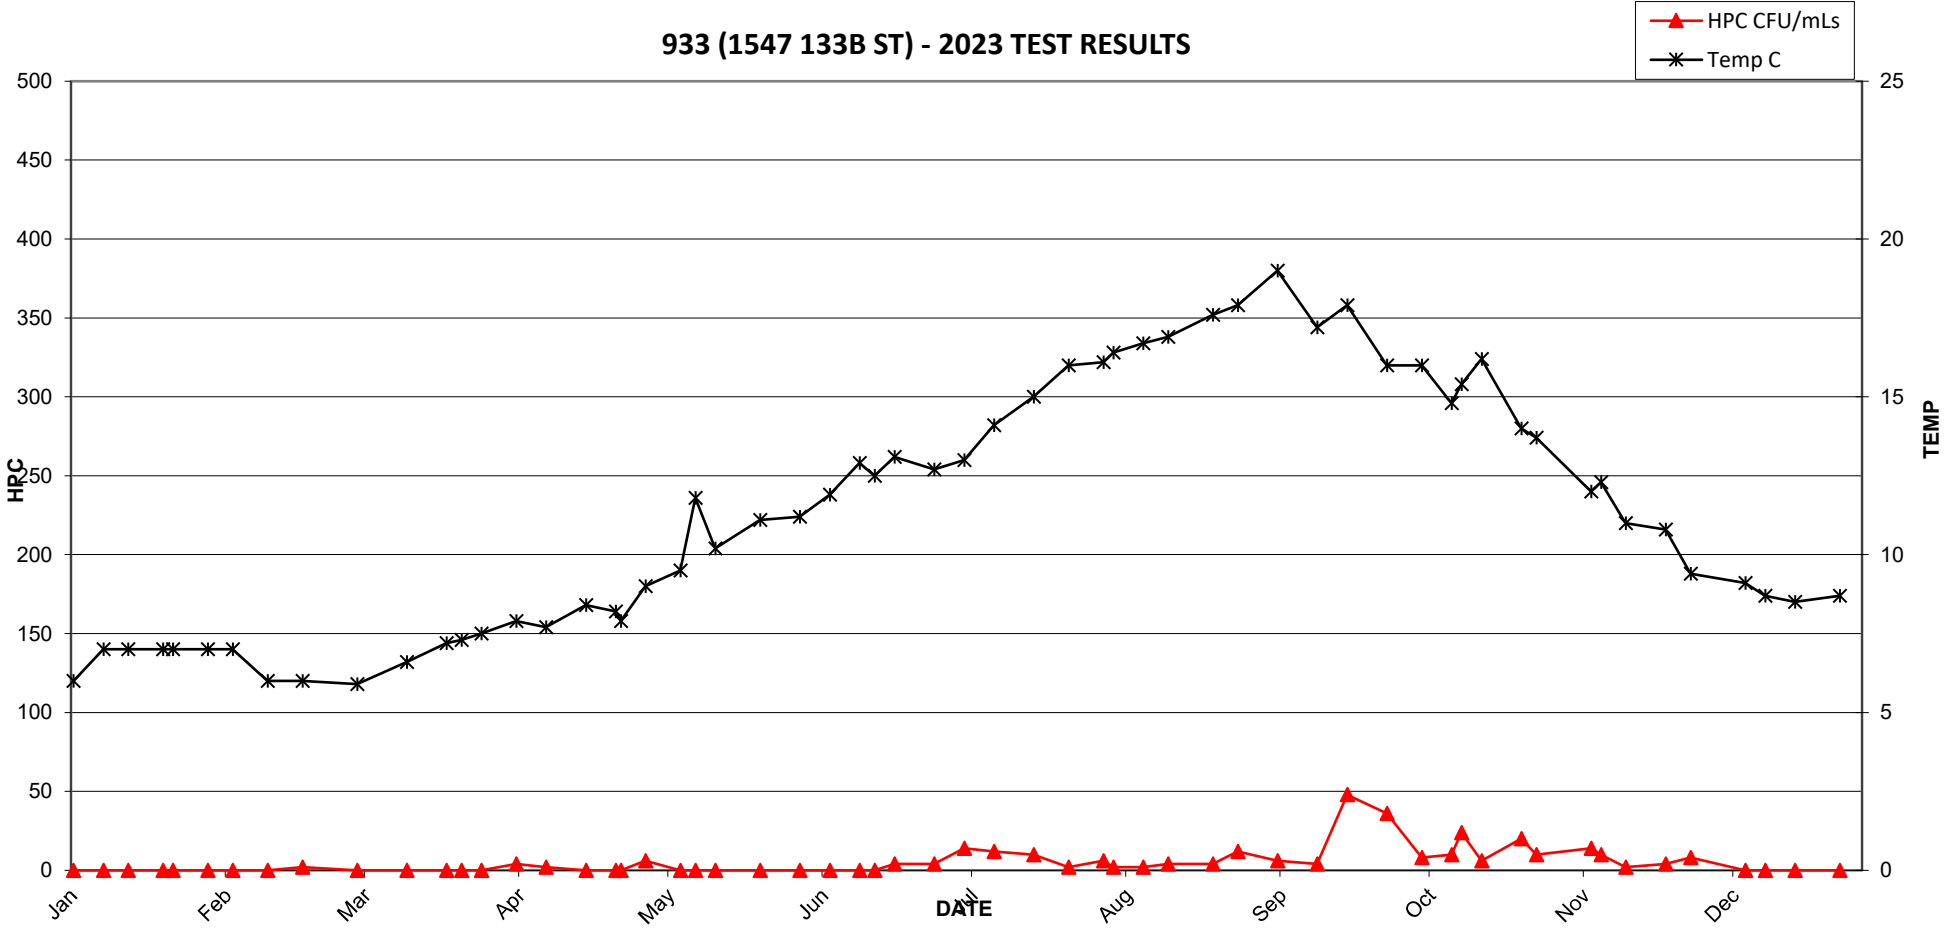


933 (1547 133B ST) - 2023 TEST RESULTS

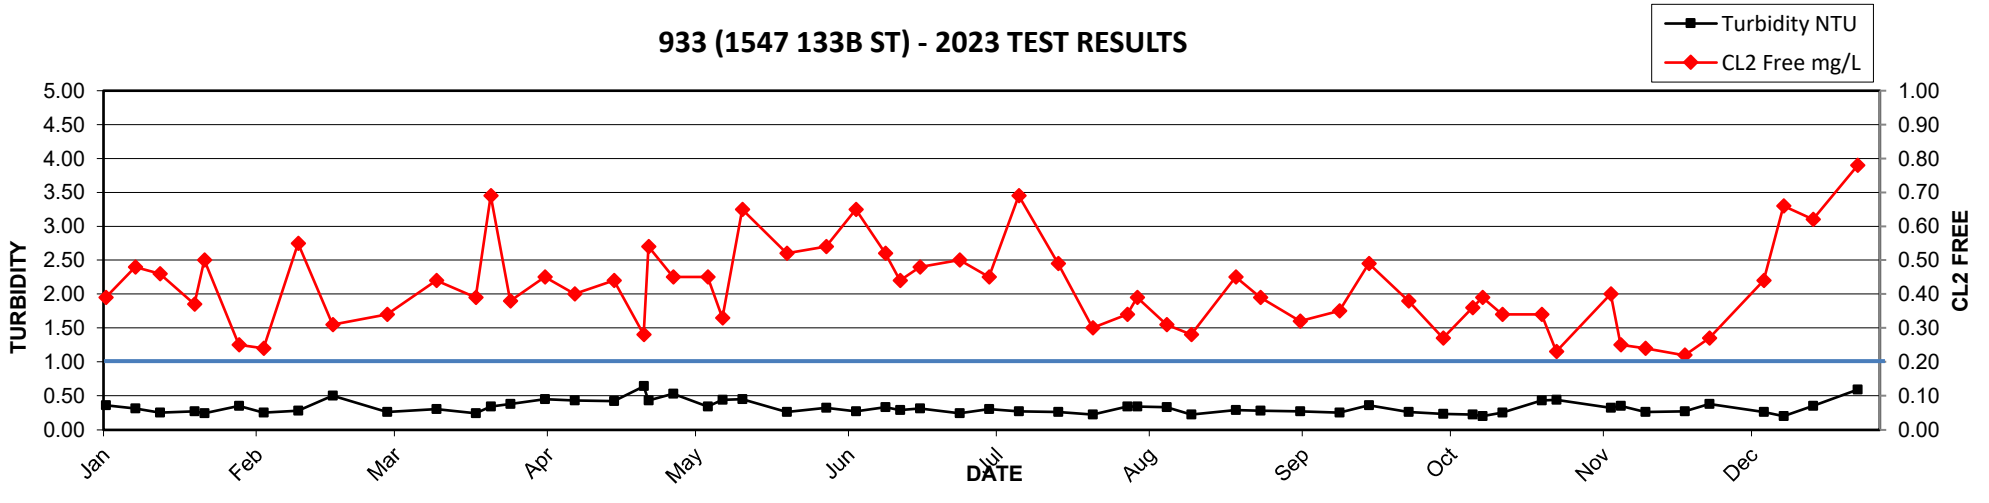



## 2023 MV Laboratory Report - 934 (1662 146 ST)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.70	<1	<2	<1	6	0.47
12-Jan	0.74	<1	2	<1	6	0.27
17-Jan	0.67	<1	<2	<1	6	0.44
24-Jan	0.44	<1	<2	<1	6	0.44
26-Jan	0.84	<1	<2	<1	6	0.37
02-Feb	0.55	<1	<2	<1	6	0.73
07-Feb	0.51	<1	<2	<1	6	0.37
14-Feb	0.53	<1	<2	<1	6	0.49
21-Feb	0.66	<1	<2	<1	7	0.45
04-Mar	0.69	<1	<2	<1	4.9	0.26
14-Mar	0.57	<1	<2	<1	5.8	0.36
22-Mar	0.72	<1	<2	<1	6.9	0.28
25-Mar	0.71	<1	<2	<1	6.7	0.34
29-Mar	0.71	<1	<2	<1	7	0.36
05-Apr	0.73	<1	8	<1	7.2	0.46
11-Apr	0.86	<1	<2	<1	7.4	0.55
19-Apr	0.61	<1	6	<1	8	0.55
25-Apr	0.71	<1	6	<1	8	0.68
26-Apr	0.28	<1	4	<1	7.6	0.47
01-May	0.71	<1	46	<1	7.8	0.70
04-May	0.65	<1	32	<1	8.3	0.45
08-May	0.71	<1	34	<1	8.5	0.38
11-May	0.91	<1	84	<1	9.1	0.55
15-May	0.85	<1	18	<1	10	0.48
24-May	0.67	<1	22	<1	10	0.32
01-Jun	0.68	<1	66	<1	10.9	0.29
07-Jun	0.68	<1	68	<1	12.1	0.27
09-Jun	0.65	<1	10	<1	12	0.24
13-Jun	0.42	<1	90	<1	10.4	0.25
16-Jun	0.60	<1	20	<1	11.7	0.35
20-Jun	0.82	<1	60	<1	11.8	0.22
28-Jun	0.67	<1	8	<1	12	0.27
04-Jul	0.65	<1	82	<1	13.6	0.31
10-Jul	0.84	<1	46	<1	13.8	0.28
18-Jul	0.82	<1	42	<1	14.4	0.39
25-Jul	0.58	<1	2	<1	14.9	0.26
26-Jul	0.73	<1	22	<1	15.1	0.32
01-Aug	0.61	<1	18	<1	15.4	0.32
03-Aug	0.87	<1	20	<1	15.9	0.25
09-Aug	0.51	<1	6	<1	15.8	0.43
14-Aug	0.57	<1	20	<1	16.7	0.30
23-Aug	0.47	<1	170	<1	17.2	0.32
28-Aug	0.42	<1	4	<1	17.9	0.28
05-Sep	0.60	<1	22	<1	16.7	0.27
13-Sep	0.62	<1	4	<1	17	0.25
19-Sep	0.73	<1	48	<1	15.9	0.39
27-Sep	0.73	<1	60	<1	16.1	0.30
04-Oct	0.6	<1	40	<1	15	0.36
10-Oct	0.67	<1	8	<1	15	0.24
11-Oct	0.69	<1	52	<1	13.9	0.25
12-Oct	0.63	<1	16	<1	15	0.24
16-Oct	0.66	<1	50	<1	14.7	0.37
24-Oct	0.56	<1	18	<1	13.4	0.49
27-Oct	0.4	<1	8	<1	13.4	0.40
02-Nov	0.81	<1	100	<1	12.1	0.39
07-Nov	0.60	<1	60	<1	11.1	0.78
09-Nov	0.24	<1	10	<1	12.6	0.38
14-Nov	0.55	<1	90	<1	10.3	0.28
22-Nov	0.33	<1	16	<1	11	0.32
24-Nov	0.33	<1	8	<1	10.5	0.48
27-Nov	0.25	<1	40	<1	9.3	0.47
04-Dec	0.44	<1	6	<1	8.7	0.19
08-Dec	0.55	<1	2	<1	8.9	0.30

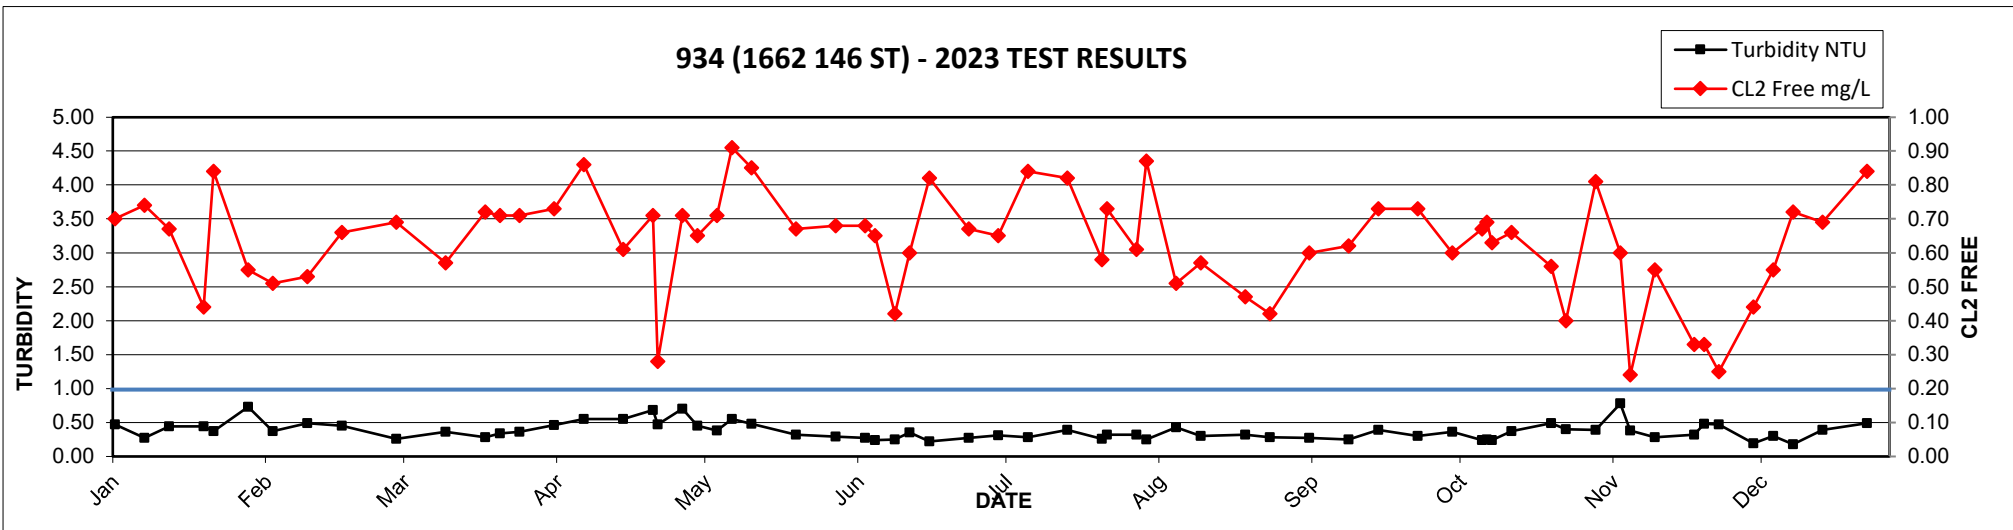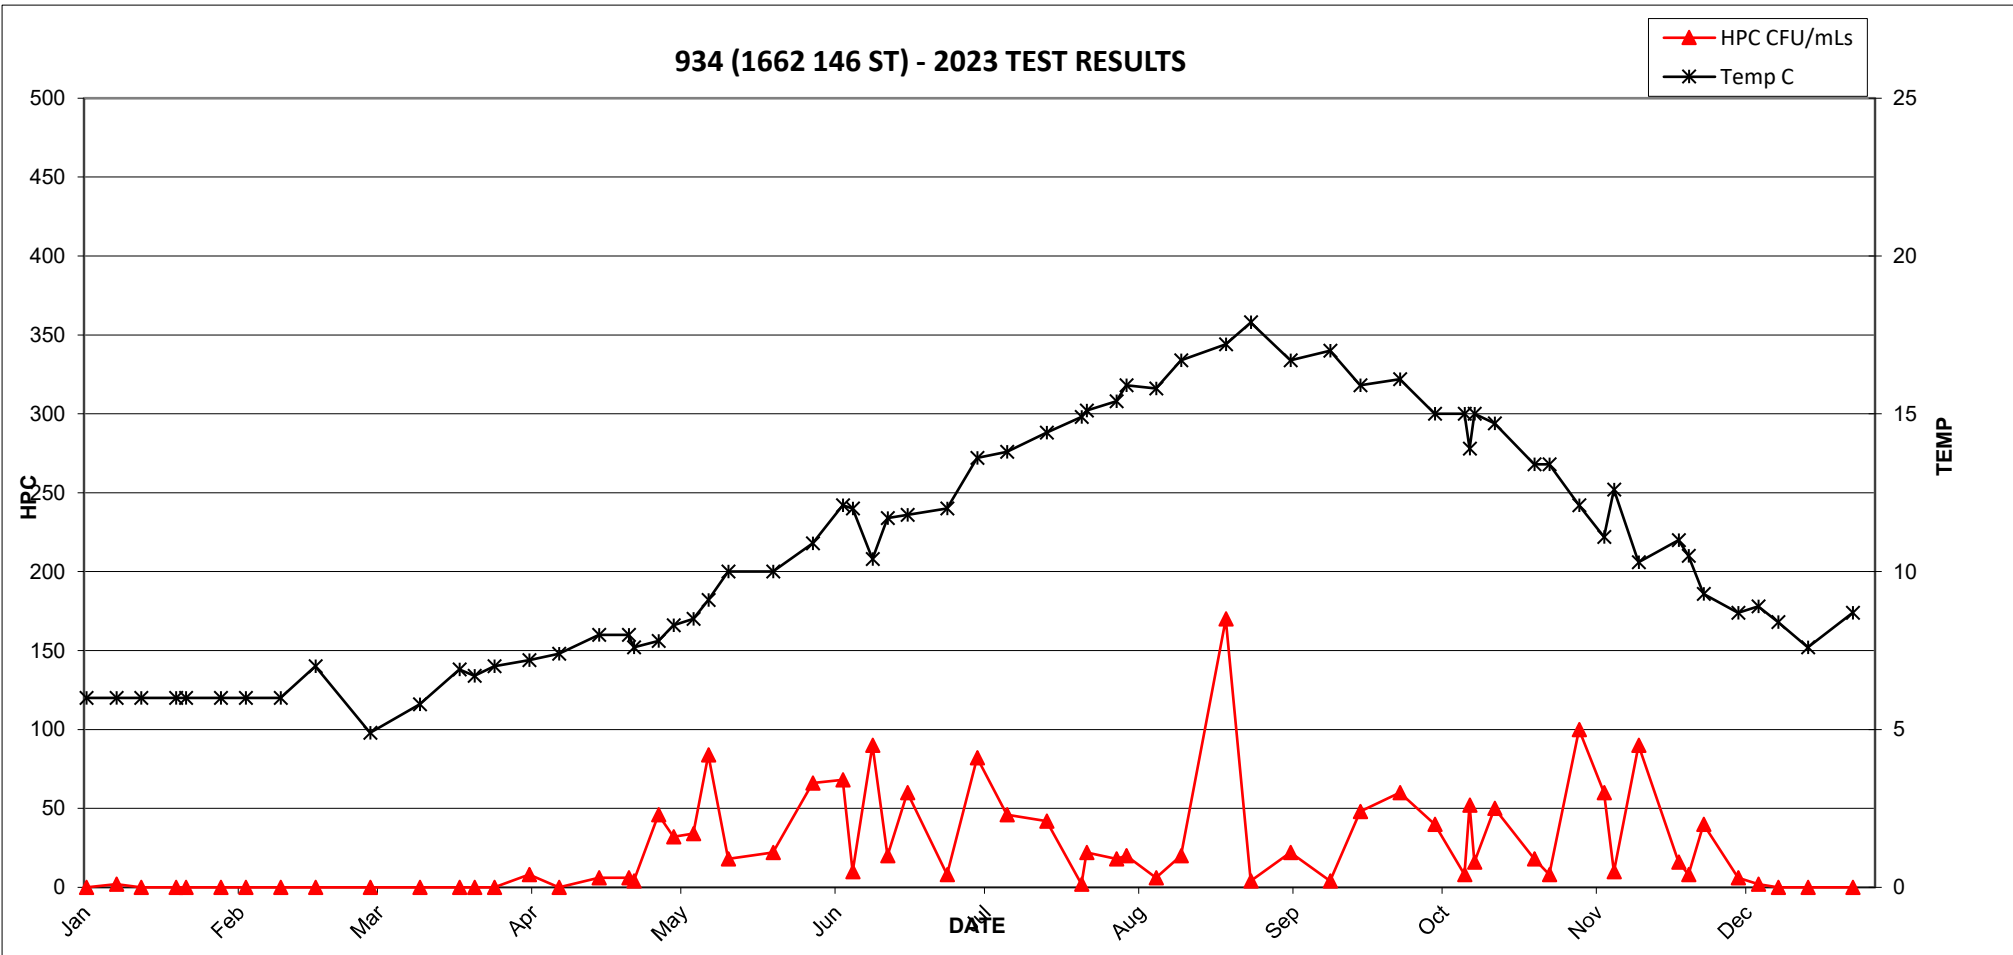

## 2023 MV Laboratory Report - 935 (16391 11 AVE)



Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.69	<1	<2	<1	6	3.00
12-Jan	0.65	<1	<2	<1	6	0.88
17-Jan	0.64	<1	<2	<1	7	1.80
24-Jan	0.60	<1	2	<1	6	1.10
26-Jan	0.57	<1	<2	<1	6	1.20
02-Feb	0.48	<1	<2	<1	6	1.60
07-Feb	0.53	<1	<2	<1	6	2.00
14-Feb	0.87	<1	<2	<1	6	1.00
21-Feb	0.51	<1	<2	<1	6	0.94
04-Mar	0.61	<1	<2	<1	5.3	0.41
14-Mar	0.75	<1	<2	<1	6	0.65
22-Mar	0.64	<1	<2	<1	7.2	0.50
25-Mar	0.49	<1	<2	<1	7	3.50
29-Mar	0.65	<1	<2	<1	6.8	0.39
05-Apr	0.41	<1	20	<1	7.8	1.70
11-Apr	0.49	<1	<2	<1	7.9	1.70
25-Apr	0.60	<1	<2	<1	8.2	1.90
26-Apr	0.55	<1	<2	<1	8	2.60
01-May	0.38	<1	<2	<1	8.3	2.60
08-May	0.62	<1	<2	<1	9.5	2.30
11-May	0.64	<1	<2	<1	9.2	0.71
15-May	0.58	<1	<2	<1	9.7	0.54
24-May	0.56	<1	<2	<1	10.9	0.60
01-Jun	0.62	<1	<2	<1	10.8	0.55
05-Jun	0.52	<1	<2	<1	12.6	0.56
13-Jun	0.62	<1	<2	<1	12.9	0.82
16-Jun	0.53	<1	<2	<1	12.6	0.36
20-Jun	0.16	<1	4	<1	13.3	0.44
28-Jun	0.52	<1	<2	<1	12.5	0.24
04-Jul	0.57	<1	<2	<1	16	0.34
10-Jul	0.59	<1	210	<1	14	0.64
18-Jul	0.65	<1	2	<1	15.4	0.23
25-Jul	0.35	<1	<2	<1	16.2	0.34
01-Aug	0.31	<1	<2	<1	16.1	0.28
03-Aug	0.46	<1	2	<1	16.4	0.29
09-Aug	0.28	<1	<2	<1	17.3	0.37
14-Aug	0.38	<1	<2	<1	17.3	0.37
23-Aug	0.39	<1	<2	<1	18.5	0.47
28-Aug	0.5	<1	12	<1	18.2	0.30
05-Sep	0.40	<1	<2	<1	17.8	0.30
13-Sep	0.40	<1	<2	<1	17.6	0.27
19-Sep	0.56	<1	<2	<1	16.2	0.44
27-Sep	0.45	<1	<2	<1	15.9	0.31
04-Oct	0.40	<1	4	<1	16	0.33
10-Oct	0.33	<1	4	<1	15.4	0.28
12-Oct	0.30	<1	<2	<1	15.4	0.33
16-Oct	0.51	<1	2	<1	15.1	0.35
19-Oct	0.30	<1	6	<1	14.6	0.36
24-Oct	0.17	<1	<2	<1	14.3	0.50
27-Oct	0.27	<1	<2	<1	13.4	0.45
30-Oct	0.43	<1	<2	<1	12.7	0.40
01-Nov	0.39	<1	<2	<1	12.4	0.34
07-Nov	0.35	<1	<2	<1	12	0.34
09-Nov	0.35	<1	<2	<1	11.9	0.34
10-Nov	0.22	<1	<2	<1	11.6	0.49
14-Nov	0.45	<1	<2	<1	10.6	0.32
22-Nov	0.26	<1	<2	<1	10.1	0.31
27-Nov	0.44	<1	120	<1	9.9	0.69
04-Dec	0.35	<1	<2	<1	8.5	0.33
06-Dec	0.5	<1	<2	<1	8.6	0.37
12-Dec	0.33	<1	<2	<1	8.4	0.50
18-Dec	0.48	<1	NA	<1	8.9	1.40
27-Dec	0.40	<1	NA	<1	7.8	0.57

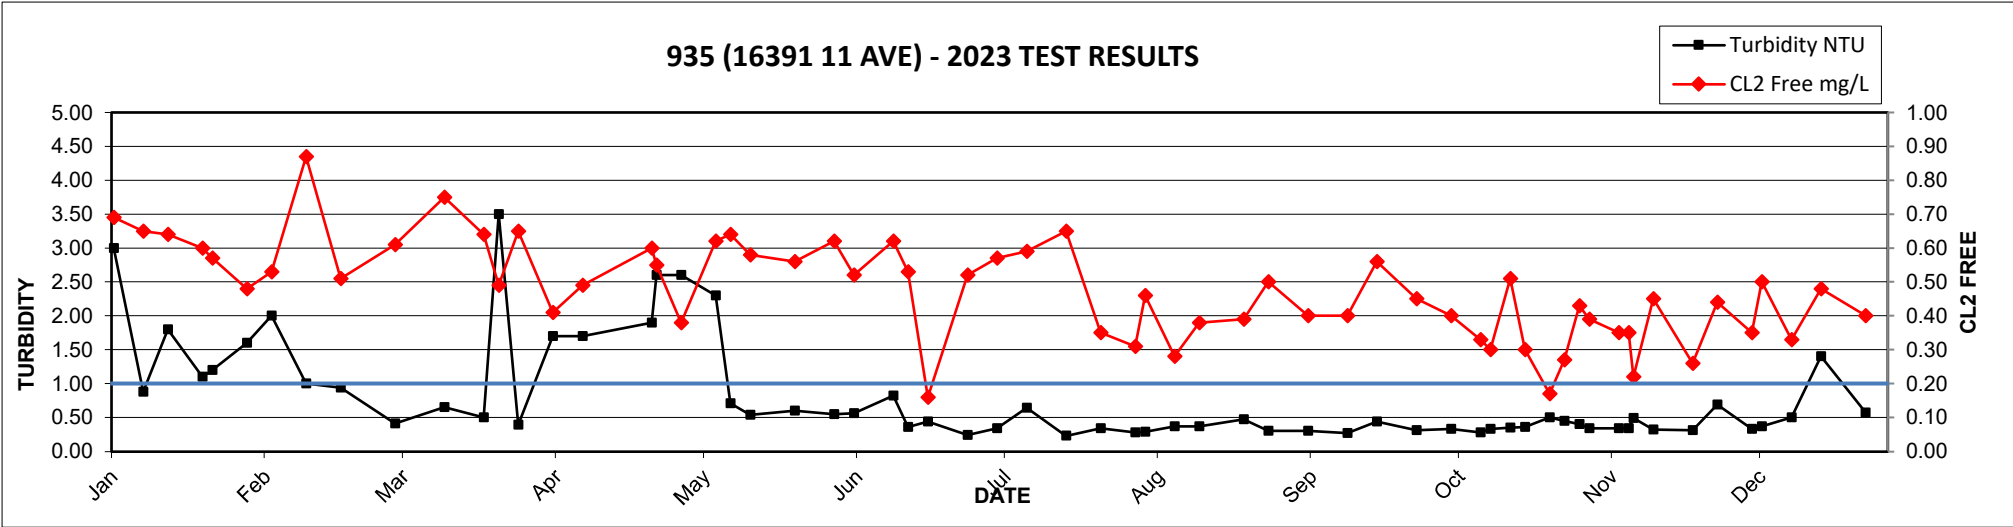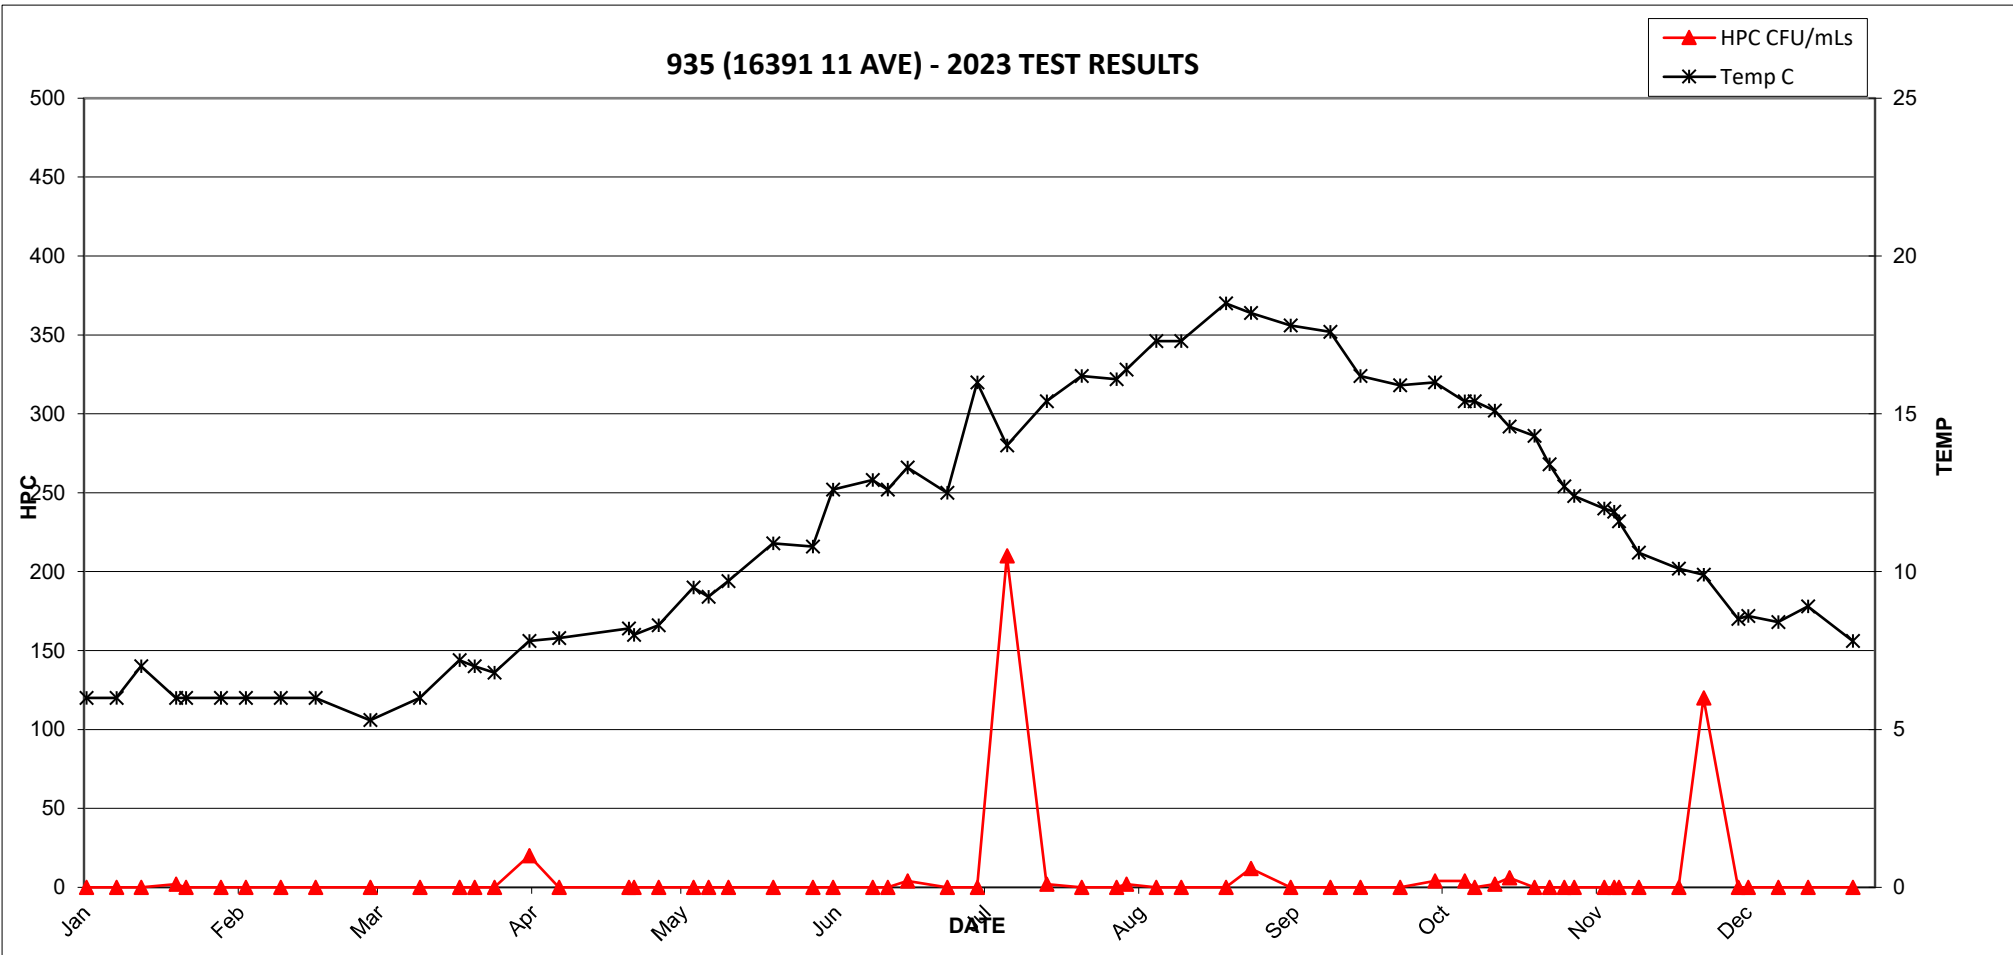

**2023 MV Laboratory Report - 936 (17195 0 AVE)**



<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
06-Jan	0.27	<1	2	<1	7	0.35
12-Jan	0.34	<1	<2	<1	7	0.44
17-Jan	0.25	<1	10	<1	7	0.64
24-Jan	0.37	<1	6	<1	7	0.64
26-Jan	0.40	<1	<2	<1	7	0.33
02-Feb	0.30	<1	<2	<1	6	0.65
07-Feb	0.36	<1	<2	<1	6	0.51
14-Feb	0.36	<1	<2	<1	7	0.42
21-Feb	0.15	<1	<2	<1	7	0.65
04-Mar	0.28	<1	<2	<1	5.9	0.30
14-Mar	0.29	<1	2	<1	6.8	0.33
22-Mar	0.24	<1	<2	<1	7.6	0.33
25-Mar	0.31	<1	4	<1	7.9	0.51
29-Mar	0.26	<1	<2	<1	8.2	0.44
05-Apr	0.23	<1	2	<1	8.7	0.44
11-Apr	0.28	<1	4	<1	8.3	0.43
19-Apr	0.22	<1	26	<1	9.2	0.41
25-Apr	0.21	<1	18	<1	9.1	0.35
01-May	0.19	<1	24	<1	11.1	0.46
11-May	0.19	<1	76	<1	12	0.59
15-May	0.24	<1	<2	<1	11.9	0.44
24-May	0.20	<1	14	<1	14.2	0.30
01-Jun	0.11	<1	14	<1	15.2	0.27
09-Jun	0.10	<1	2	<1	16.1	0.24
13-Jun	0.25	<1	36	<1	15.3	0.45
20-Jun	0.19	<1	28	<1	16.3	0.28
28-Jun	0.25	<1	20	<1	15.3	0.24
04-Jul	0.23	<1	4	<1	18.6	0.24
10-Jul	0.19	<1	22	<1	18	0.36
12-Jul	0.22	<1	<2	<1	17.4	0.26
18-Jul	0.23	<1	40	<1	18.4	0.28
25-Jul	0.11	<1	6	<1	19.3	0.21
01-Aug	0.15	<1	2	<1	18.4	0.38
09-Aug	0.12	<1	2	<1	19.4	0.34
14-Aug	0.10	<1	4	<1	19.7	0.27
23-Aug	0.24	<1	14	<1	19.8	0.28
28-Aug	0.20	<1	18	<1	19.3	0.25
05-Sep	0.22	<1	10	<1	19.1	0.23
13-Sep	0.09	<1	4	<1	18.50	0.23
19-Sep	0.34	<1	10	<1	18.2	0.36
27-Sep	0.16	<1	4	<1	17.3	0.25
04-Oct	0.19	<1	18	<1	17	0.29
10-Oct	0.16	<1	6	<1	16	0.26
12-Oct	0.03	<1	14	<1	15.9	0.23
16-Oct	0.15	<1	22	<1	16.1	0.25
19-Oct	0.11	<1	18	<1	15.2	0.36
24-Oct	0.16	<1	32	<1	14.8	0.38
27-Oct	0.08	<1	10	<1	14	0.44
30-Oct	0.17	<1	18	<1	13	0.35
01-Nov	0.31	<1	8	<1	12.6	0.29
07-Nov	0.24	<1	10	<1	11.8	0.32
09-Nov	0.07	<1	6	<1	12.4	0.35
14-Nov	0.25	<1	8	<1	11.5	0.32
22-Nov	0.20	<1	8	<1	10.5	0.30
27-Nov	0.17	<1	6	<1	10	0.35



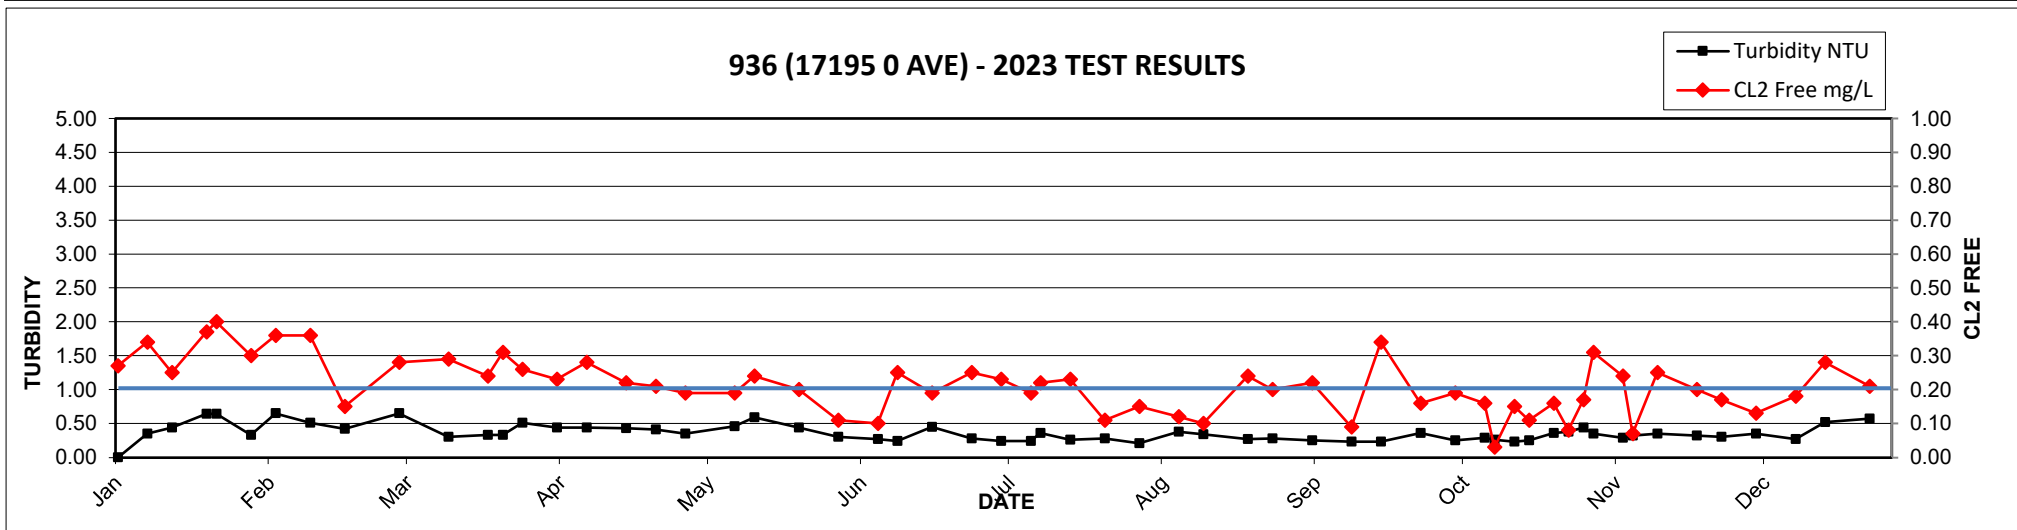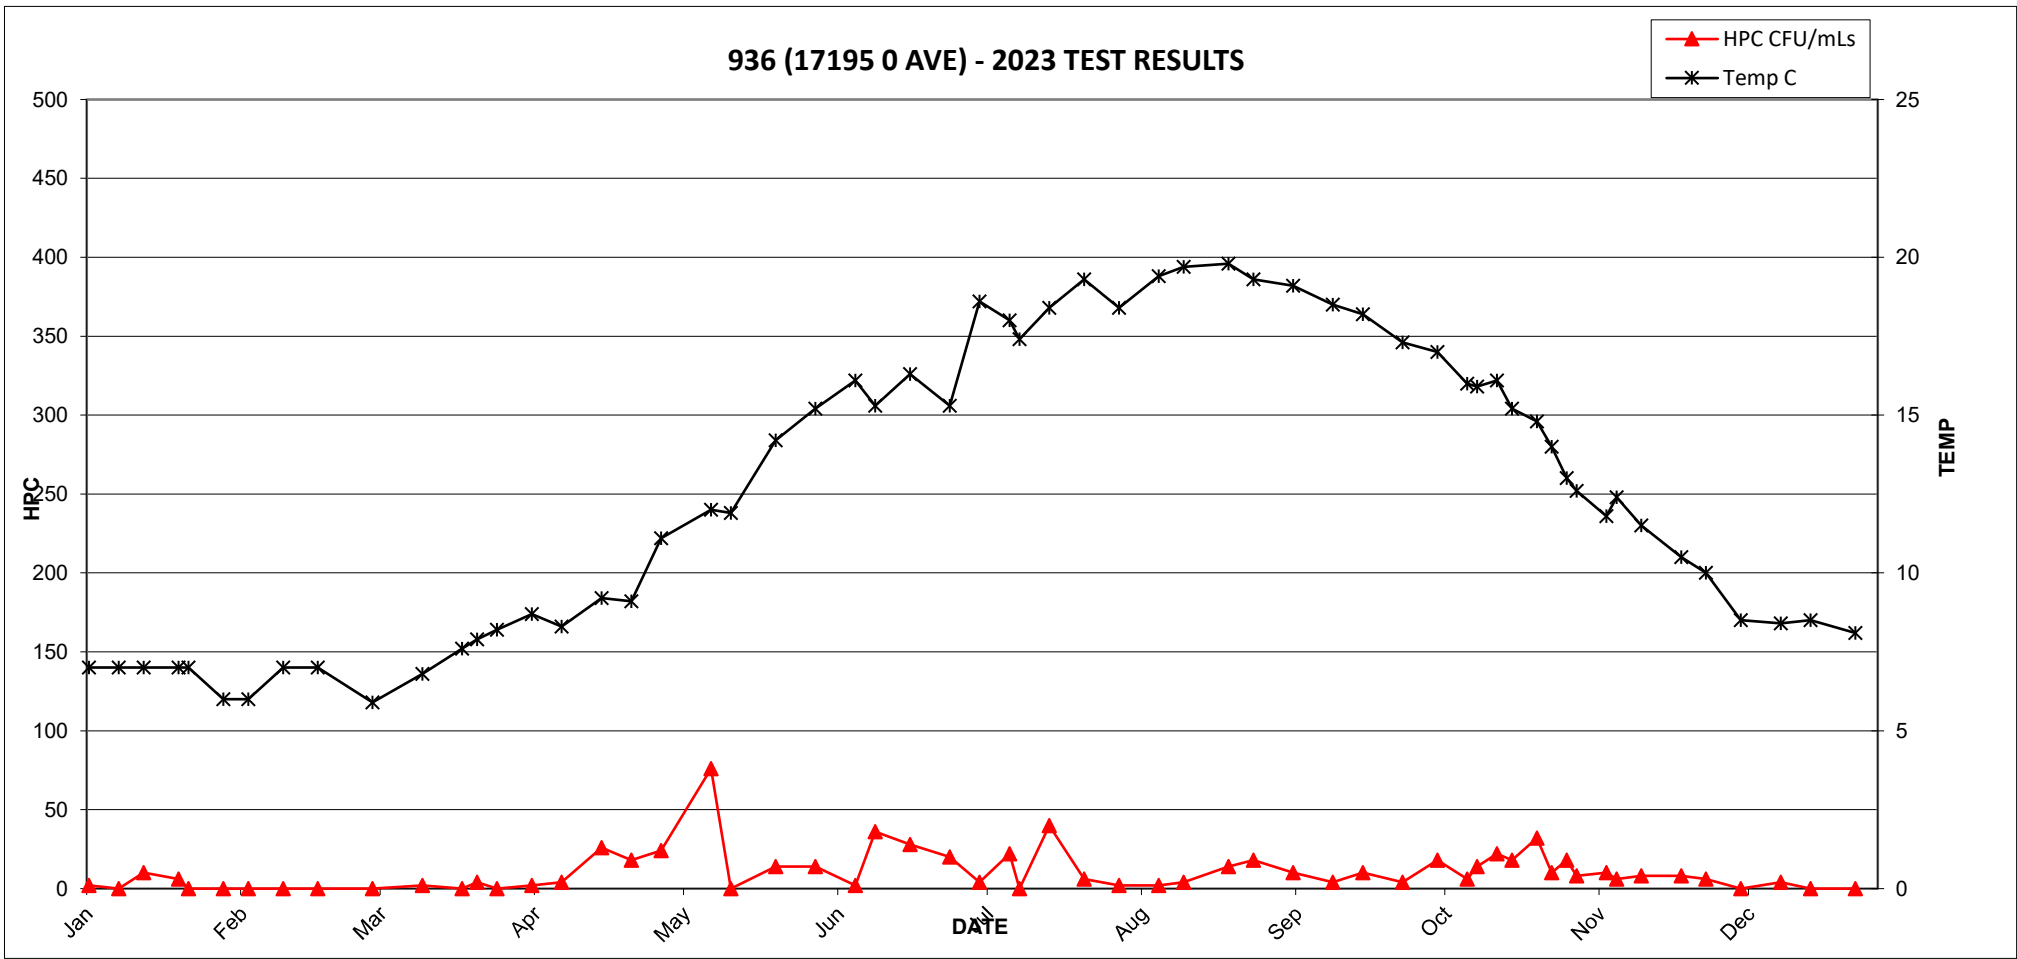



## 2023 MV Laboratory Report - 937 (2158 180 ST)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.45	<1	<2	<1	7	0.44
12-Jan	0.32	<1	<2	<1	7	0.26
17-Jan	0.32	<1	2	<1	7	0.25
24-Jan	0.44	<1	<2	<1	6	0.31
26-Jan	0.34	<1	<2	<1	6	0.28
02-Feb	0.39	<1	<2	<1	7	0.30
07-Feb	0.61	<1	<2	<1	6	0.35
14-Feb	0.47	<1	<2	<1	6	0.30
21-Feb	0.89	<1	<2	<1	7	0.23
24-Feb	0.37	<1	<2	<1	6	0.47
04-Mar	0.27	<1	<2	<1	5.8	0.25
14-Mar	0.18	<1	<2	<1	6.3	0.28
22-Mar	0.15	<1	<2	<1	6.8	0.35
25-Mar	0.22	<1	<2	<1	7	0.48
29-Mar	0.27	<1	<2	<1	7.3	0.35
05-Apr	0.31	<1	10	<1	7.5	0.39
11-Apr	0.20	<1	40	<1	7.7	0.47
19-Apr	0.36	<1	210	<1	8	0.54
25-Apr	0.18	<1	60	<1	8.1	0.37
26-Apr	0.24	<1	78	<1	8.4	0.36
01-May	0.28	<1	28	<1	8.8	0.55
04-May	0.30	<1	<2	<1	10.1	0.39
08-May	0.21	<1	<2	<1	9.6	0.43
11-May	0.17	<1	<2	<1	9.9	0.37
15-May	0.33	<1	2	<1	10	0.57
24-May	0.32	<1	<2	<1	11.8	0.34
01-Jun	0.28	<1	6	<1	11.4	0.26
05-Jun	0.32	<1	8	<1	12	0.54
07-Jun	0.35	<1	6	<1	12.7	0.33
13-Jun	0.20	<1	14	<1	13.1	0.34
20-Jun	0.23	<1	12	<1	13.7	0.25
28-Jun	0.21	<1	4	<1	12.8	0.24
04-Jul	0.27	<1	18	<1	14	0.30
10-Jul	0.41	<1	24	<1	14.6	0.32
18-Jul	0.38	<1	6	<1	16.8	0.38
24-Jul	0.23	<1	4	<1	16	0.38
25-Jul	0.21	<1	8	<1	16.2	0.27
26-Jul	0.35	<1	18	<1	16	0.31
01-Aug	0.22	<1	<2	<1	15.8	0.38
03-Aug	0.33	<1	2	<1	15.7	0.49
04-Aug	0.35	<1	<2	<1	15.7	0.34
09-Aug	0.29	<1	<2	<1	16.6	0.33
14-Aug	0.25	<1	<2	<1	16.8	0.26
23-Aug	0.28	<1	20	<1	17.2	0.51
28-Aug	0.28	<1	10	<1	17.7	0.26
01-Sep	0.24	<1	20	<1	17.5	0.22
13-Sep	0.25	<1	6	<1	17.1	0.25
15-Sep	0.39	<1	24	<1	16.6	0.51
19-Sep	0.30	<1	4	<1	16.5	0.30
27-Sep	0.21	<1	8	<1	16.1	0.24
29-Sep	0.21	<1	6	<1	17	0.30
04-Oct	0.44	<1	66	<1	16	0.25
06-Oct	0.11	<1	2	<1	15.3	0.33
10-Oct	0.11	<1	LA	<1	15.3	0.24
11-Oct	0.17	<1	12	<1	15.1	0.27
12-Oct	0.07	<1	4	<1	15.3	0.24
16-Oct	0.40	<1	26	<1	15	0.25
19-Oct	0.07	<1	36	<1	15	0.30
24-Oct	0.19	<1	4	<1	14.4	0.36
30-Oct	0.29	<1	2	<1	12.5	0.43
1-Nov-23	0.34	<1	16	<1	13.1	0.31
07-Nov	0.17	<1	10	<1	12.4	0.28
09-Nov	0.07	<1	110	<1	12.7	0.36

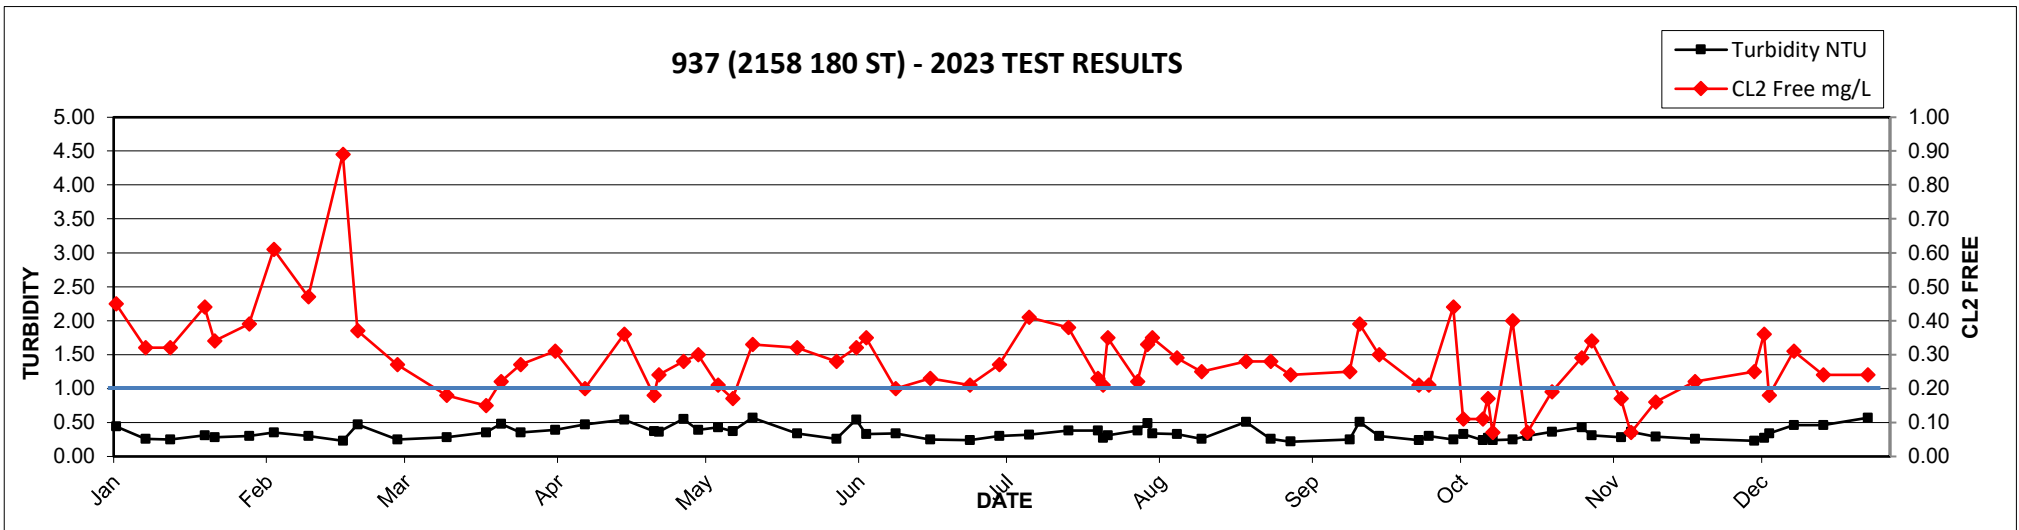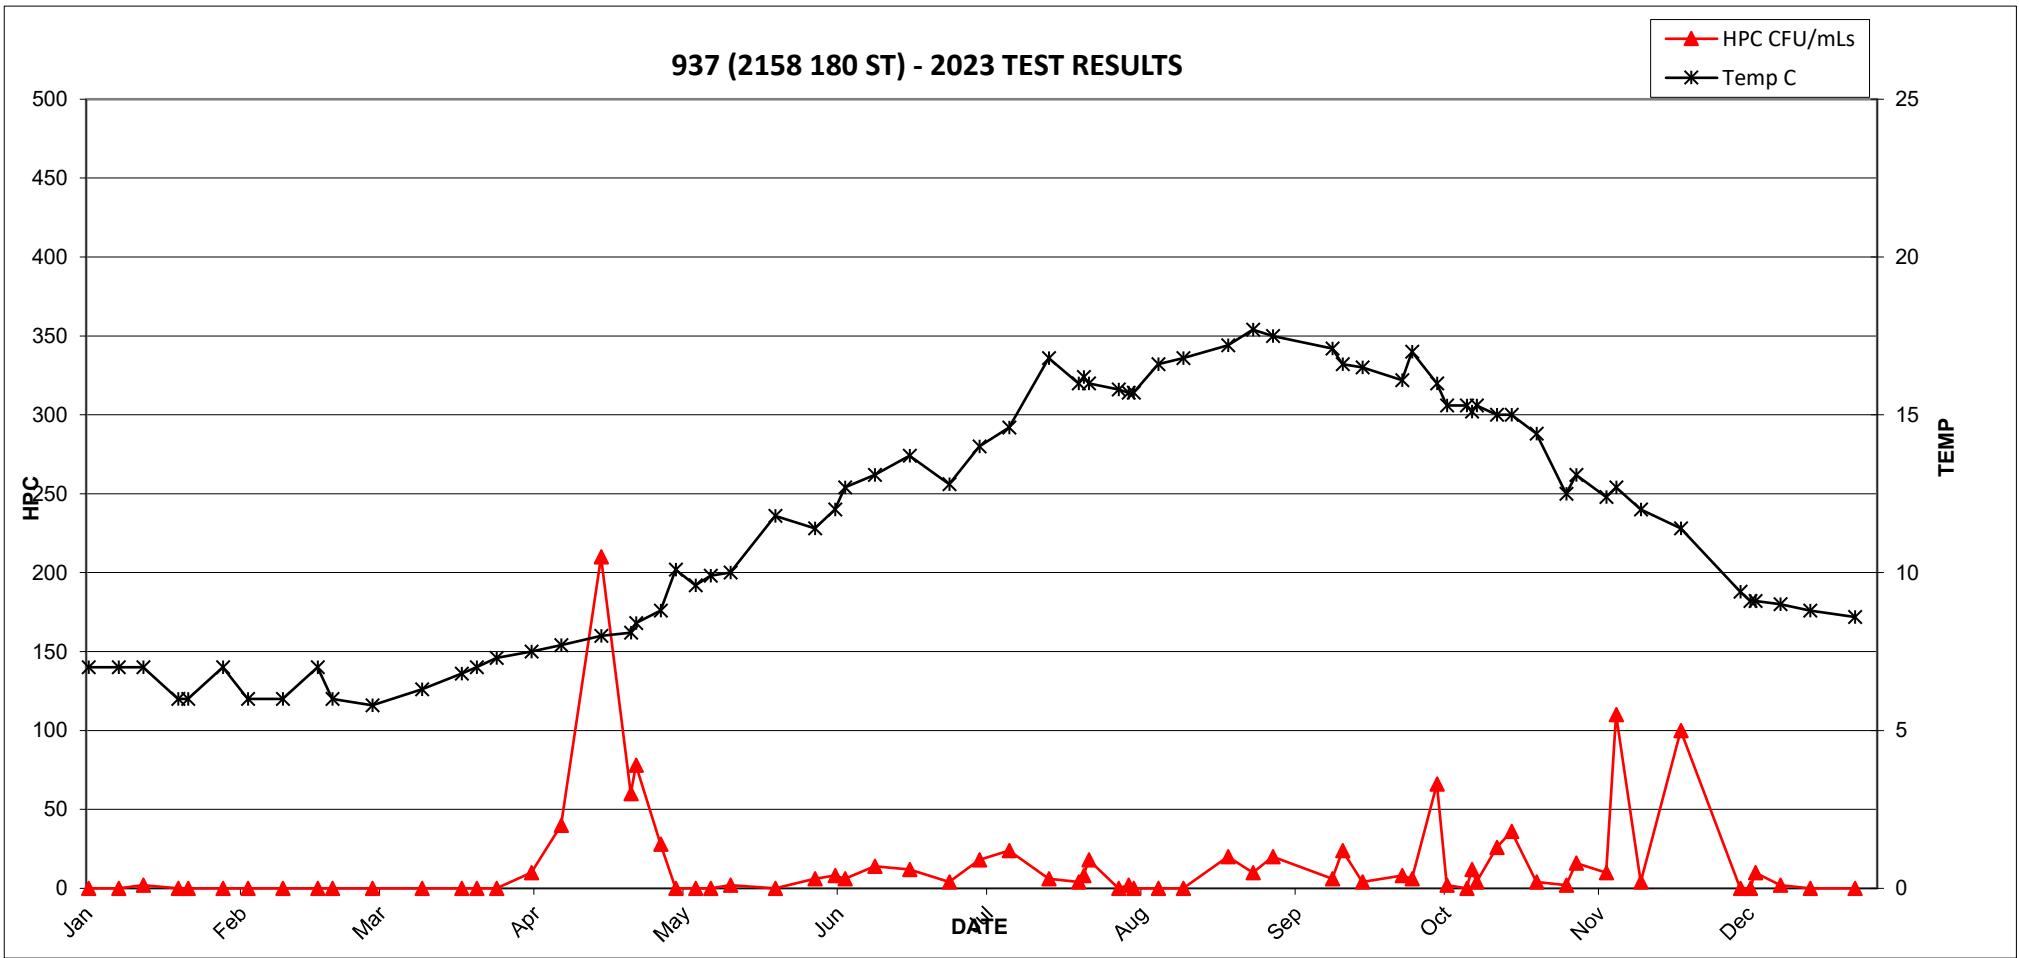



## 2023 MV Laboratory Report - 938 (17214 31 AVE)

Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
06-Jan	0.44	<1	<2	<1	6	0.42
12-Jan	0.34	<1	<2	<1	6	0.26
17-Jan	0.39	<1	<2	<1	7	0.28
24-Jan	0.48	<1	<2	<1	6	0.36
26-Jan	0.44	<1	<2	<1	6	0.54
02-Feb	0.47	<1	<2	<1	6	0.35
07-Feb	0.47	<1	<2	<1	6	0.35
14-Feb	0.55	<1	LA	<1	6	0.31
21-Feb	0.51	<1	<2	<1	6	0.49
24-Feb	0.39	<1	<2	<1	6	0.35
04-Mar	0.31	<1	<2	<1	5.3	0.23
14-Mar	0.36	<1	<2	<1	6.1	0.26
22-Mar	0.19	<1	<2	<1	6.8	0.27
25-Mar	0.36	<1	<2	<1	7	0.39
29-Mar	0.31	<1	<2	<1	7	0.37
05-Apr	0.35	<1	2	<1	7.4	0.52
11-Apr	0.24	<1	<2	<1	8	0.47
19-Apr	0.33	<1	<2	<1	7.9	0.55
25-Apr	0.22	<1	<2	<1	8	0.43
26-Apr	0.23	<1	<2	<1	8.4	0.39
01-May	0.32	<1	<2	<1	8.9	0.72
04-May	0.52	<1	<2	<1	9	0.43
08-May	0.24	<1	<2	<1	9.3	0.39
11-May	0.17	<1	<2	<1	9.8	0.34
15-May	0.38	<1	<2	<1	10	0.57
24-May	0.42	<1	<2	<1	11	0.34
01-Jun	0.38	<1	2	<1	11.4	0.32
05-Jun	0.39	<1	<2	<1	11.9	0.58
07-Jun	0.38	<1	<2	<1	12	0.50
13-Jun	0.37	<1	<2	<1	12.5	0.37
16-Jun	0.34	<1	<2	<1	12.3	0.25
20-Jun	0.39	<1	4	<1	12.7	0.29
28-Jun	0.26	<1	<2	<1	12.6	0.25
29-Jun	0.37	<1	<2	<1	13.8	0.23
04-Jul	0.33	<1	<2	<1	13.6	0.39
10-Jul	0.45	<1	2	<1	13.9	0.32
12-Jul	0.32	<1	<2	<1	14.5	0.28
18-Jul	0.35	<1	<2	<1	14.9	0.45
24-Jul	0.49	<1	4	<1	15.4	0.31
25-Jul	0.19	<1	12	<1	15.8	0.24
26-Jul	0.51	<1	<2	<1	15.9	0.44
01-Aug	0.26	<1	<2	<1	15.9	0.28
03-Aug	0.38	<1	<2	<1	16.4	0.33
04-Aug	0.28	<1	<2	<1	16	0.34
09-Aug	0.26	<1	<2	<1	16.7	0.32
14-Aug	0.32	<1	<2	<1	16.9	0.33
23-Aug	0.30	<1	4	<1	17.5	0.36
28-Aug	0.36	<1	2	<1	17.8	0.29
01-Sep	0.18	<1	2	<1	17.5	0.23
05-Sep	0.28	<1	<2	<1	17.4	0.23
13-Sep	0.22	<1	2	<1	17	0.24
15-Sep	0.37	<1	<2	<1	16.8	0.46
19-Sep	0.38	<1	<2	<1	17	0.41
27-Sep	0.37	<1	4	<1	16.4	0.27
04-Oct	0.33	<1	6	<1	16	0.28
06-Oct	0.19	<1	<2	<1	15	0.30
10-Oct	0.20	<1	4	<1	15.2	0.28
11-Oct	0.44	<1	2	<1	14.3	0.26
12-Oct	0.07	<1	4	<1	15	0.31

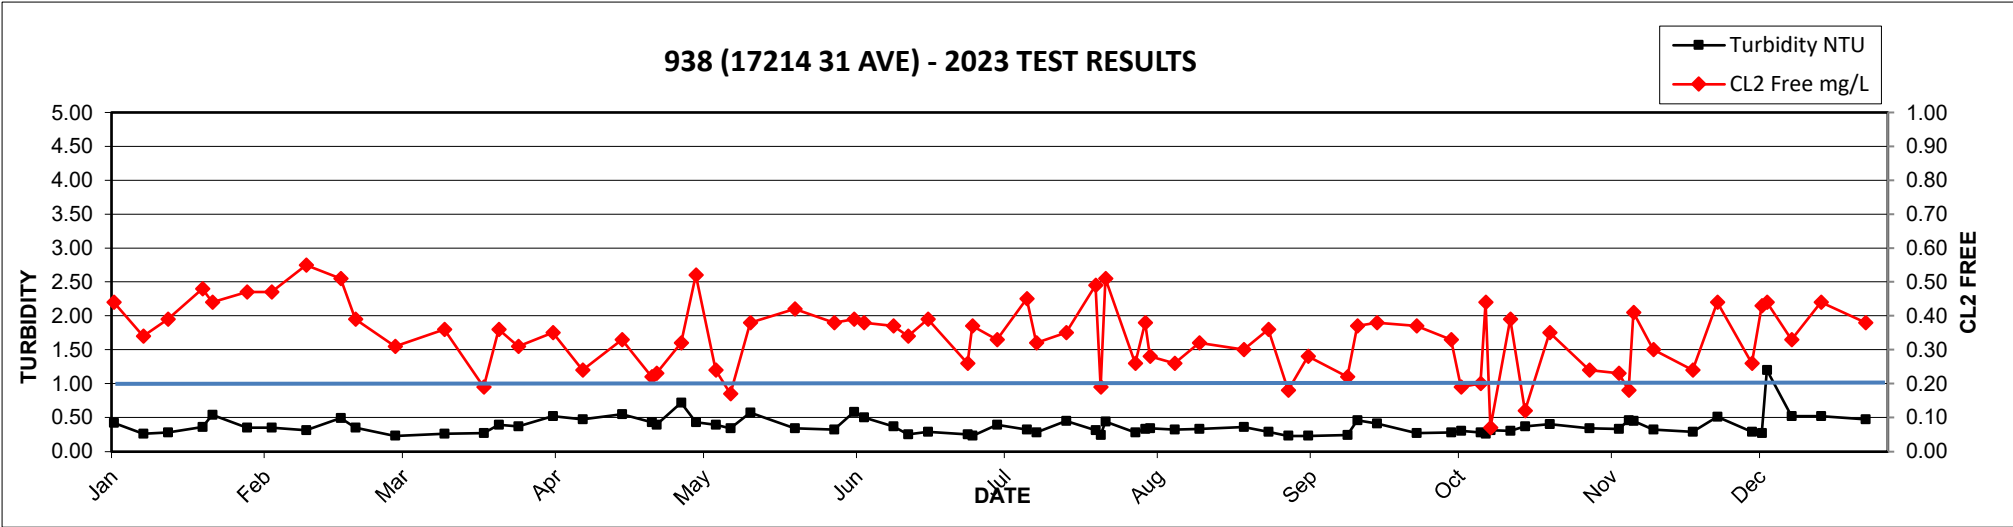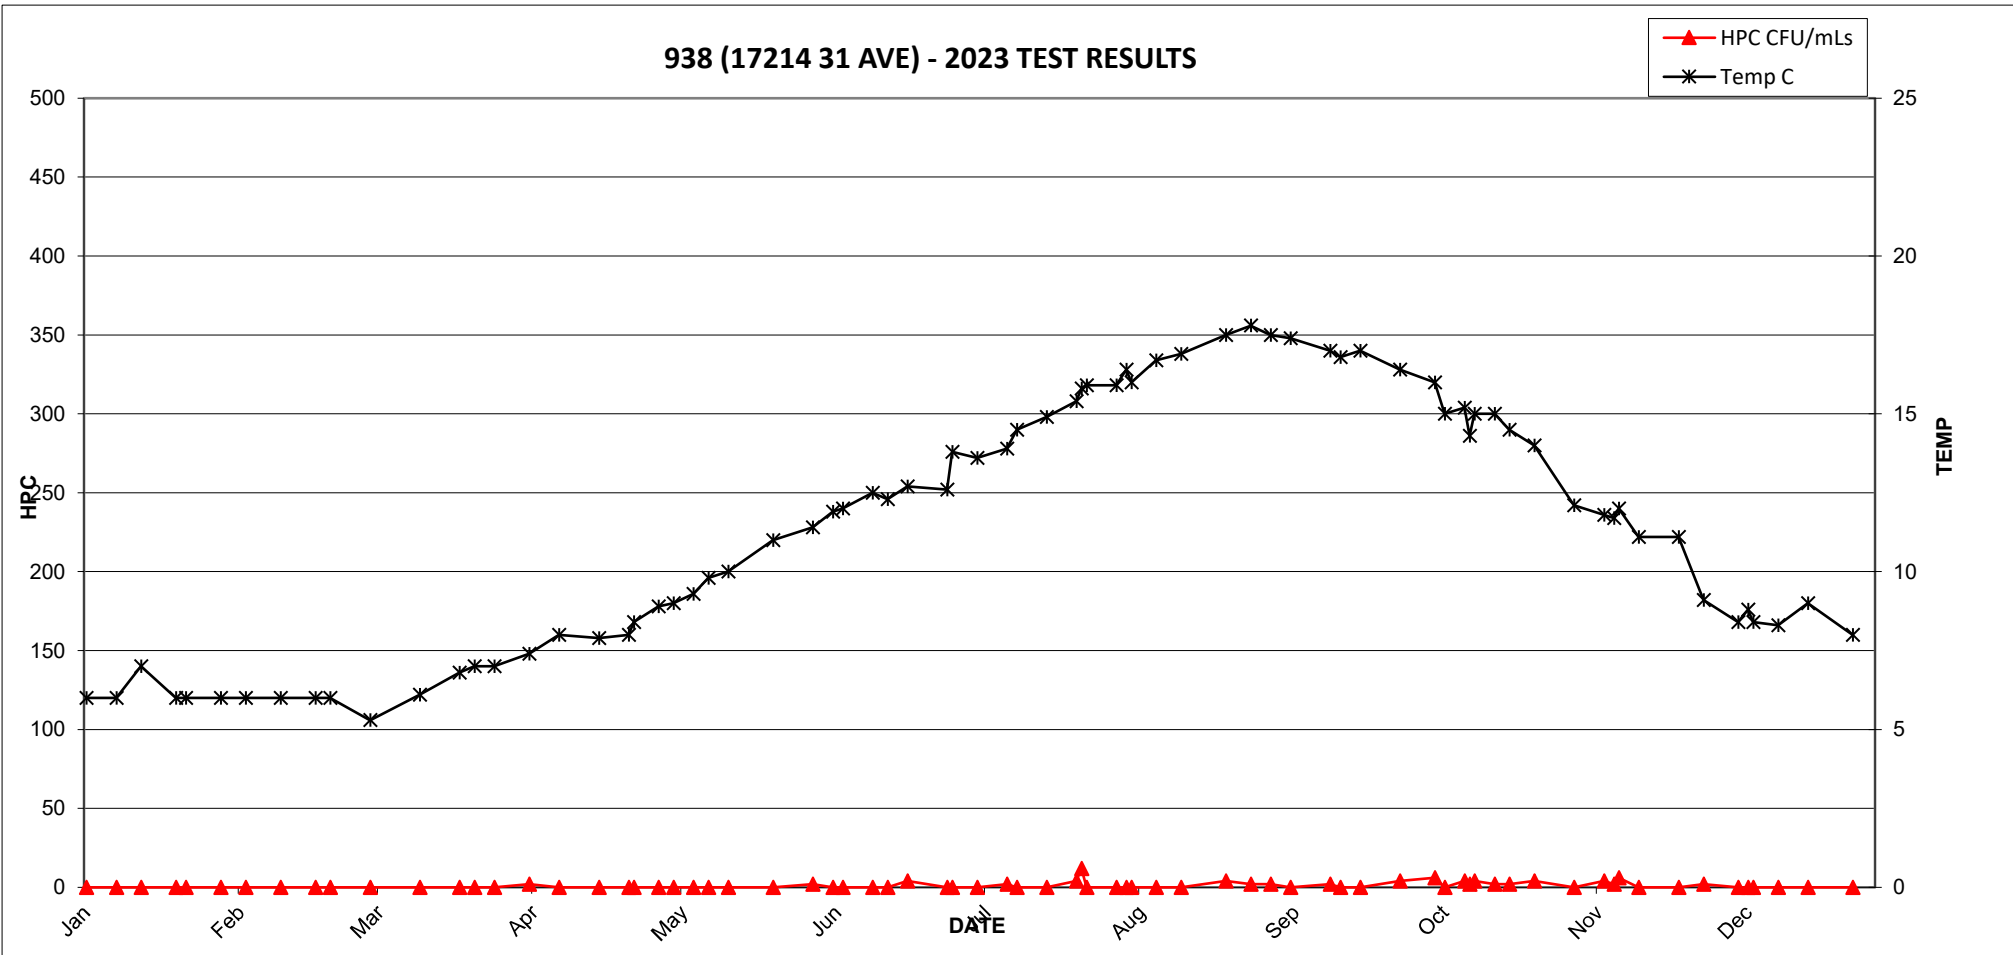

## 2023 MV Laboratory Report - 939 (3831 156 ST)

Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
06-Jan	0.52	<1	2	<1	7	0.43
12-Jan	0.82	<1	<2	<1	7	0.27
24-Jan	0.70	<1	<2	<1	7	0.35
02-Feb	0.58	<1	<2	<1	7	0.33
07-Feb	0.41	<1	<2	<1	6	0.88
14-Feb	0.70	<1	<2	<1	7	0.51
21-Feb	0.69	<1	<2	<1	7	0.39
04-Mar	0.64	<1	<2	<1	6	0.24
14-Mar	0.65	<1	<2	<1	6.5	0.26
22-Mar	0.66	<1	<2	<1	7.4	0.25
25-Mar	0.77	<1	<2	<1	7.3	0.50
29-Mar	0.62	<1	<2	<1	7.5	0.31
05-Apr	0.49	<1	<2	<1	7	0.42
11-Apr	0.66	<1	<2	<1	7.9	0.71
19-Apr	0.47	<1	<2	<1	8.3	0.56
25-Apr	0.46	<1	<2	<1	7.8	0.51
26-Apr	0.66	<1	<2	<1	8.6	0.35
01-May	0.75	<1	<2	<1	8.4	0.36
04-May	0.54	<1	6	<1	9.4	0.47
08-May	0.60	<1	4	<1	10	0.40
11-May	0.56	<1	2	<1	13.4	0.52
15-May	0.79	<1	<2	<1	9.7	0.61
24-May	0.52	<1	16	<1	11	0.39
01-Jun	0.61	<1	2	<1	11.5	0.31
05-Jun	0.66	<1	62	<1	11.9	0.45
07-Jun	0.68	<1	42	<1	12.9	0.44
13-Jun	0.71	<1	70	<1	11.8	0.34
16-Jun	0.63	<1	14	<1	12.6	0.28
20-Jun	0.62	<1	8	<1	13	0.30
28-Jun	0.69	<1	14	<1	12.5	0.29
04-Jul	0.59	<1	120	<1	13.1	5.50
05-Jul	0.82	<1	24	<1	13.1	0.44
10-Jul	0.76	<1	12	<1	14.5	0.29
11-Jul	0.63	<1	10	<1	13.3	0.29
12-Jul	0.68	<1	6	<1	14.7	0.24
18-Jul	0.69	<1	26	<1	16.5	0.34
24-Jul	0.62	<1	28	<1	15.7	0.39
26-Jul	0.67	<1	20	<1	15.6	0.33
01-Aug	0.62	<1	8	<1	16.5	0.34
03-Aug	0.68	<1	18	<1	16.7	0.32
09-Aug	0.57	<1	4	<1	16	0.34
14-Aug	0.48	<1	4	<1	17.5	0.26
28-Aug	0.67	<1	2	<1	18	0.25
01-Sep	0.66	<1	50	<1	17.8	0.24
05-Sep	0.55	<1	50	<1	17.9	0.28
13-Sep	0.57	<1	16	<1	17.5	0.29
19-Sep	0.79	<1	42	<1	16.6	0.37
27-Sep	0.65	<1	24	<1	16.3	0.42
04-Oct	0.57	<1	52	<1	16	0.33
10-Oct	0.50	<1	6	<1	15.5	0.24
11-Oct	0.46	<1	22	<1	15.1	0.27
12-Oct	0.57	<1	12	<1	15.3	0.26
13-Oct	0.60	<1	70	<1	15.4	0.27
19-Oct	0.50	<1	8	<1	14.8	0.35
24-Oct	0.51	<1	20	<1	14.4	0.44
01-Nov	0.51	<1	24	<1	12	0.37
07-Nov	0.56	<1	30	<1	12.2	0.36
09-Nov	0.55	<1	4	<1	12.1	0.42

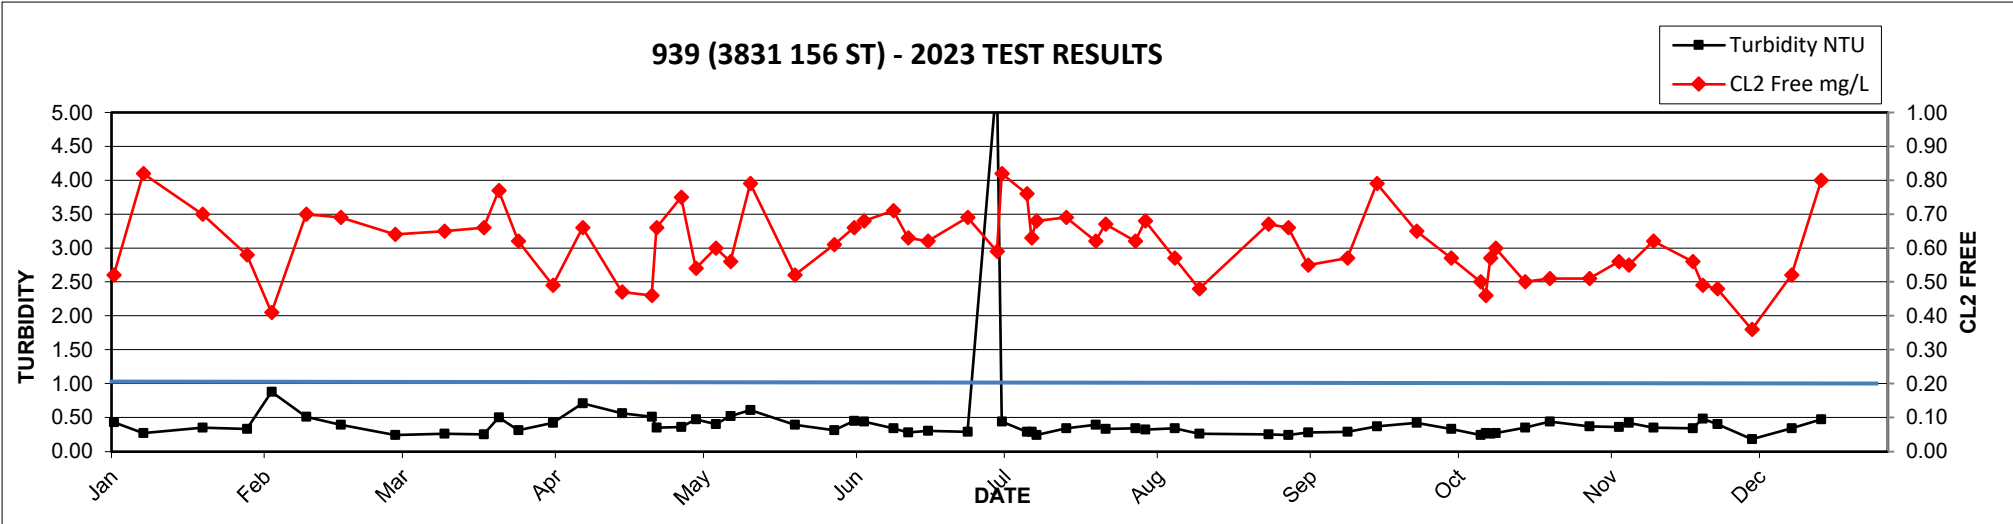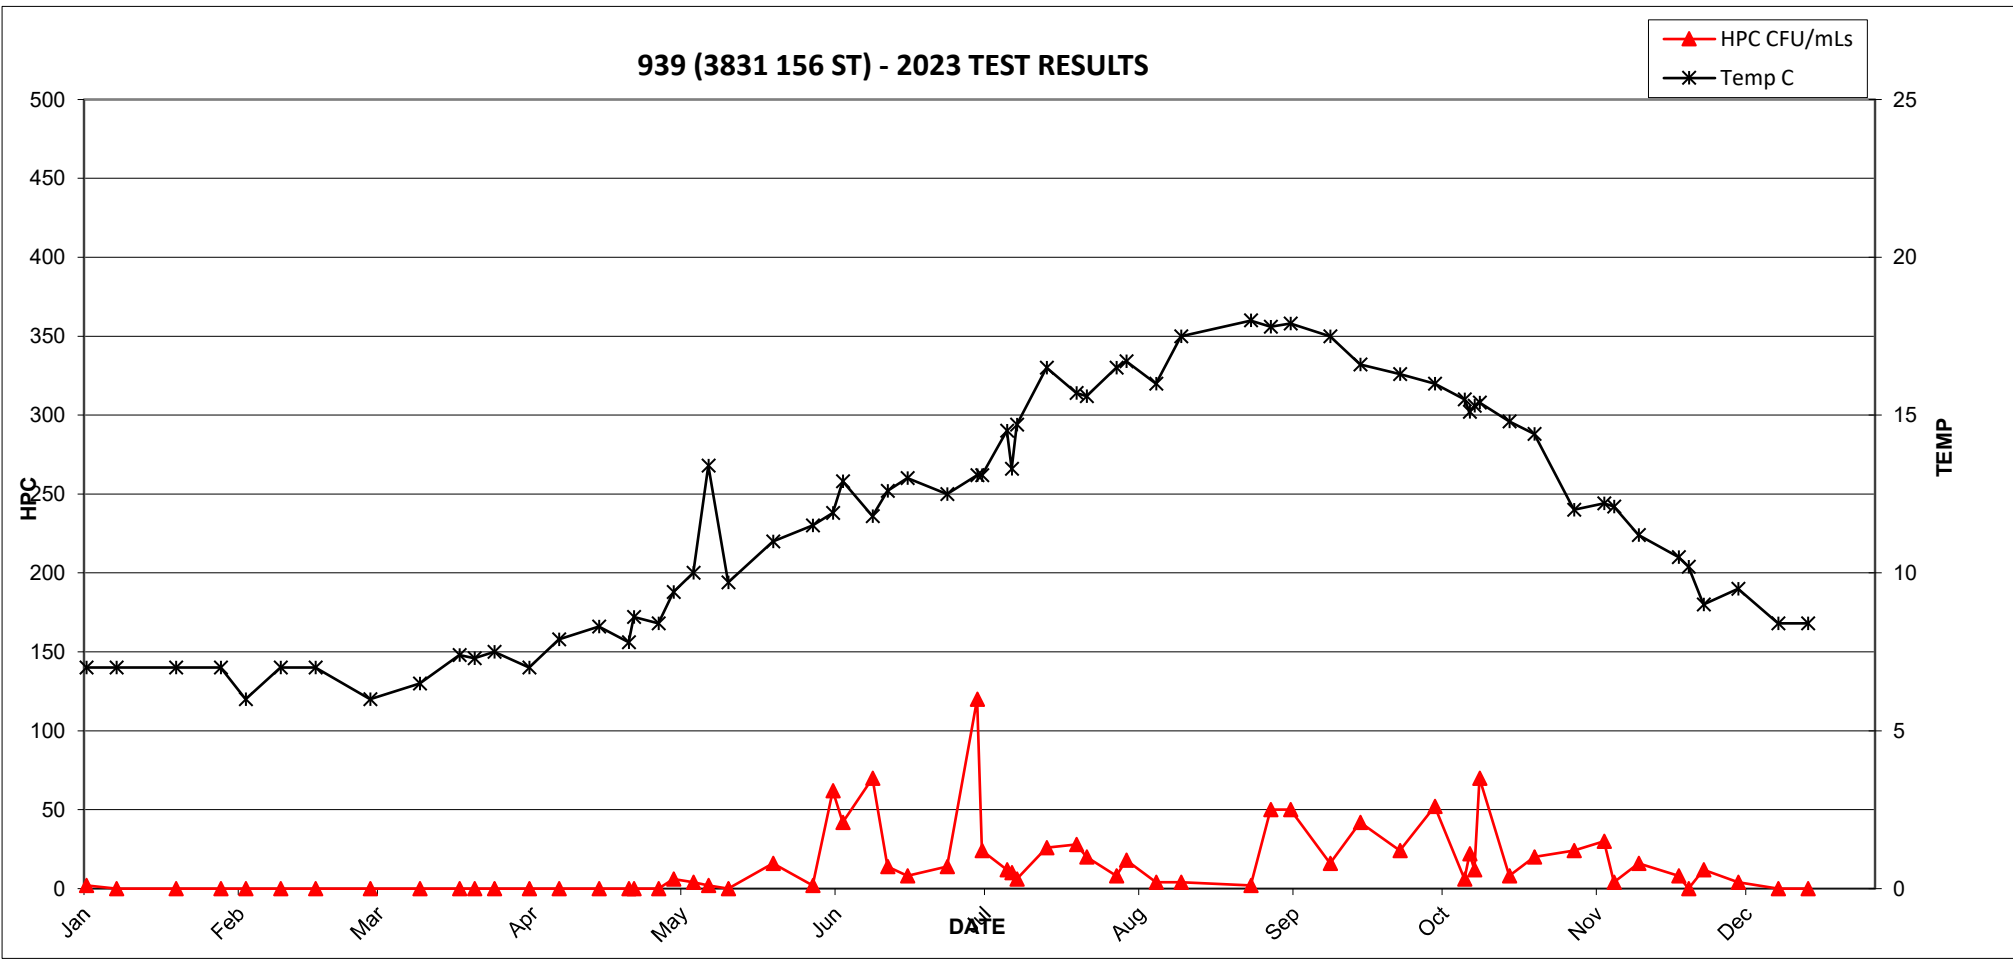


## 2023 MV Laboratory Report - 940 (CROYDON DR &amp; 24 AVE)


Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.97	<1	<2	<1	6	5.00
12-Jan	0.67	<1	<2	<1	7	0.27
17-Jan	0.59	<1	<2	<1	7	0.24
24-Jan	0.82	<1	<2	<1	7	0.28
02-Feb	0.54	<1	<2	<1	6	5.30
03-Feb	0.60	<1	<2	<1	6	0.38
07-Feb	0.59	<1	<2	<1	6	0.25
14-Feb	0.70	<1	<2	<1	6	0.29
21-Feb	0.60	<1	2	<1	6	0.32
24-Feb	0.70	<1	<2	<1	6	0.30
04-Mar	0.68	<1	<2	<1	5.5	0.34
11-Mar	0.49	<1	<2	<1	5.8	0.23
14-Mar	0.55	<1	<2	<1	5.8	0.25
22-Mar	0.69	<1	2	<1	7.6	0.24
25-Mar	0.71	<1	<2	<1	6.8	0.30
29-Mar	0.58	<1	<2	<1	8	0.43
05-Apr	0.67	<1	<2	<1	7.1	0.29
11-Apr	0.51	<1	<2	<1	8	0.32
19-Apr	0.61	<1	<2	<1	8	0.50
25-Apr	0.44	<1	<2	<1	7.9	0.34
26-Apr	0.40	<1	<2	<1	7.7	0.36
01-May	0.44	<1	<2	<1	8	0.41
08-May	0.61	<1	<2	<1	9.9	0.32
11-May	0.61	<1	2	<1	10.3	0.29
15-May	0.79	<1	<2	<1	11.2	0.41
24-May	0.44	<1	<2	<1	12	0.25
01-Jun	0.54	<1	<2	<1	12.2	0.29
09-Jun	0.61	<1	<2	<1	13.3	0.22
13-Jun	0.68	<1	6	<1	12.3	2.30
20-Jun	0.57	<1	<2	<1	13.1	0.73
28-Jun	0.49	<1	2	<1	12.6	0.23
04-Jul	0.59	<1	2	<1	14.3	0.33
10-Jul	0.65	<1	20	<1	15.2	0.47
11-Jul	0.48	<1	<2	<1	15.6	0.20
18-Jul	0.58	<1	<2	<1	16.1	0.44
25-Jul	0.39	<1	<2	<1	16.4	1.20
01-Aug	0.43	<1	4	<1	16.2	0.52
09-Aug	0.38	<1	<2	<1	16.7	0.37
14-Aug	0.39	<1	2	<1	17.3	0.36
23-Aug	0.43	<1	<2	<1	18.5	0.33
28-Aug	0.45	<1	4	<1	17.4	0.24
05-Sep	0.38	<1	<2	<1	17.5	0.23
13-Sep	0.76	<1	6	<1	17.9	4.40
19-Sep	0.55	<1	12	<1	16.6	0.36
27-Sep	0.37	<1	20	<1	16.7	0.28
04-Oct	0.49	<1	<2	<1	16	0.28
10-Oct	0.53	<1	10	<1	15.7	0.25
12-Oct	0.34	<1	14	<1	15.3	0.23
24-Oct	0.53	<1	6	<1	13.3	0.44
01-Nov	0.35	<1	12	<1	12	0.30
07-Nov	0.49	<1	<2	<1	11.7	0.38
09-Nov	0.55	<1	4	<1	11.4	0.49
14-Nov	0.37	<1	2	<1	10.4	0.27
22-Nov	0.65	<1	4	<1	9.7	0.28
27-Nov	0.60	<1	2	<1	9.1	0.57
04-Dec	0.66	<1	<2	<1	8.3	0.40
06-Dec	0.49	<1	<2	<1	8.5	0.35
12-Dec	0.67	<1	<2	<1	8	0.50
18-Dec-23	0.79	<1	NA	<1	8	0.5
27-Dec-23	0.66	<1	NA	<1	7.9	0.57



940 (CROYDON DR & 24 AVE) - 2023 TEST RESULTS

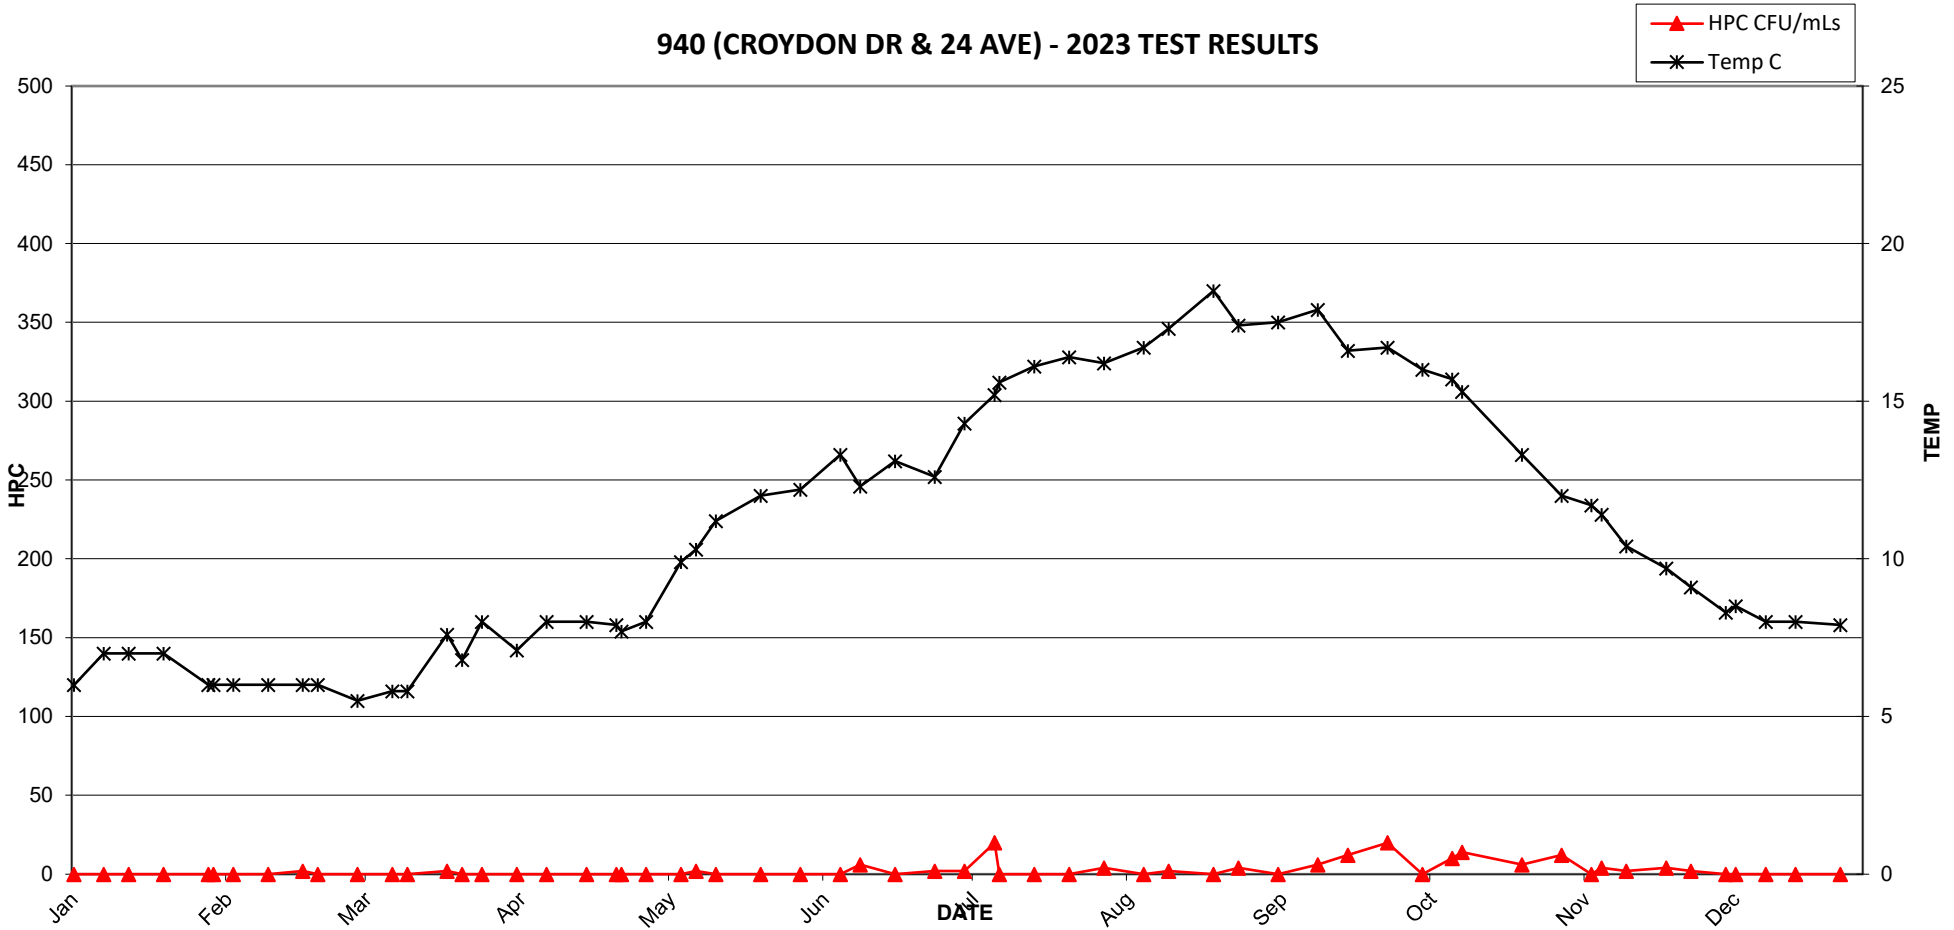


940 (CROYDON DR & 24 AVE) - 2023 TEST RESULTS

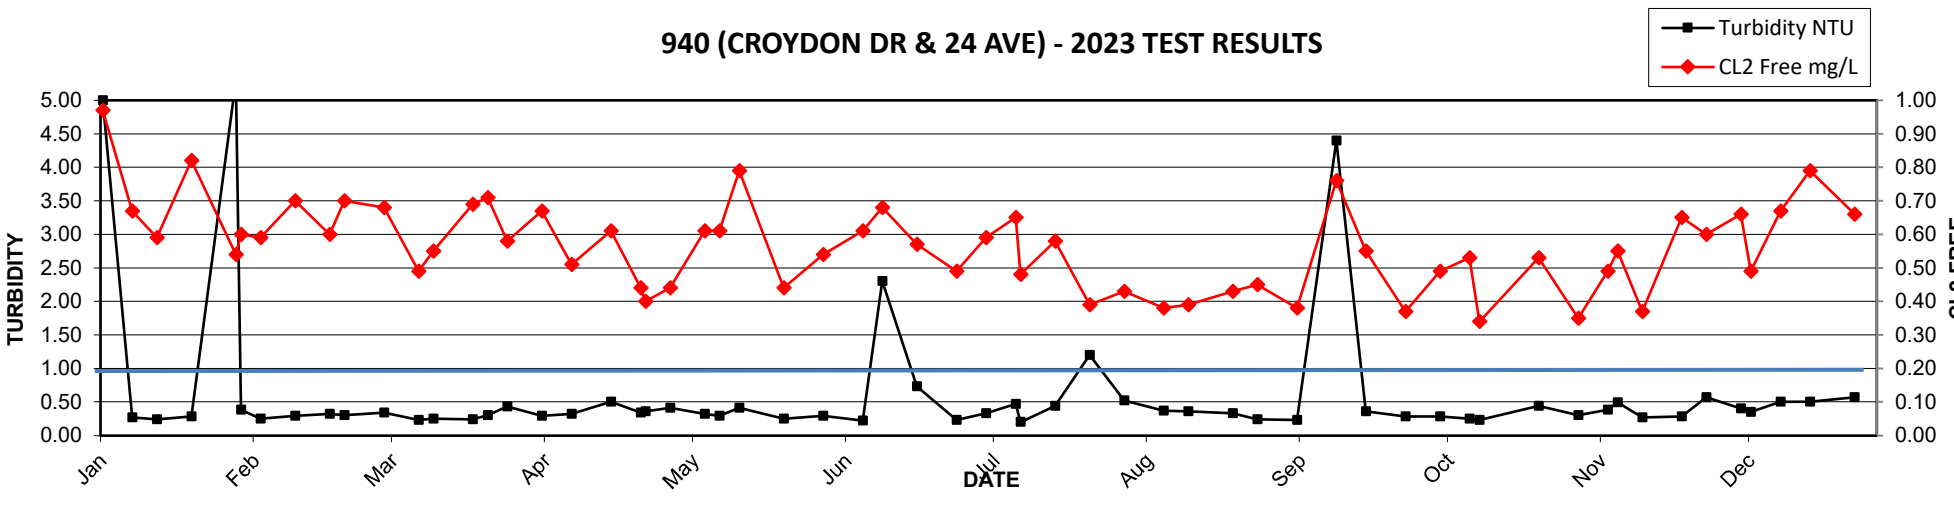


**2023 MV Laboratory Report - 941 (BELL ROAD & OLD McLELLAN ROAD)**

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
04-Jan	0.61	<1	2	<1	6	0.29
12-Jan	0.39	<1	<2	<1	8	0.32
18-Jan	0.61	<1	<2	<1	7	0.32
26-Jan	0.54	<1	<2	<1	7	0.26
03-Feb	0.39	<1	<2	<1	7	0.45
08-Feb	0.70	<1	<2	<1	7	0.28
15-Feb	0.58	<1	<2	<1	7	0.29
23-Feb	0.58	<1	<2	<1	7	0.27
24-Feb	0.53	<1	<2	<1	6	0.38
25-Feb	0.65	<1	<2	<1	7	0.30
11-Mar	0.62	<1	<2	<1	6.6	0.24
15-Mar	0.70	<1	<2	<1	6.8	0.33
20-Mar	0.84	<1	<2	<1	6.6	0.31
27-Mar	0.72	<1	<2	<1	7	0.51
06-Apr	0.72	<1	16	<1	8	0.37
12-Apr	0.82	<1	6	<1	8.2	0.59
20-Apr	0.45	<1	16	<1	8	0.56
26-Apr	0.58	<1	2	<1	8.9	0.43
02-May	0.57	<1	8	<1	10	0.36
12-May	0.67	<1	2	<1	9.6	0.37
17-May	0.62	<1	8	<1	11.8	0.43
25-May	0.68	<1	<2	<1	12.3	0.32
31-May	0.68	<1	2	<1	12.8	0.27
08-Jun	0.52	<1	2	<1	14.3	0.38
12-Jun	0.61	<1	<2	<1	14	0.27
20-Jun	0.58	<1	<2	<1	14	0.24
06-Jul	0.51	<1	4	<1	15.1	0.33
10-Jul	0.70	<1	10	<1	15.6	0.39
18-Jul	0.40	<1	<2	<1	14.9	0.34
25-Jul	0.83	<1	4	<1	18	0.33
01-Aug	0.61	<1	2	<1	17.4	0.35
10-Aug	0.32	<1	6	<1	18.4	0.23
17-Aug	0.43	<1	6	<1	18.7	0.30
24-Aug	0.50	<1	4	<1	18.5	0.28
30-Aug	0.28	<1	2	<1	18.8	0.20
06-Sep	0.41	<1	10	<1	18.2	0.30
13-Sep	0.47	<1	4	<1	17	0.26
21-Sep	0.45	<1	4	<1	16.6	0.33
28-Sep	0.40	<1	4	<1	16	0.43
03-Oct	0.41	<1	8	<1	16	0.28
10-Oct	0.24	<1	8	<1	15	0.29
17-Oct	0.40	<1	2	<1	15.9	0.23
19-Oct	0.37	<1	4	<1	15.2	0.35
23-Oct	0.41	<1	2	<1	15	0.40
31-Oct	0.27	<1	2	<1	13.2	0.31
06-Nov	0.40	<1	4	<1	12.8	0.29
14-Nov	0.37	<1	420	<1	11.7	0.33
21-Nov	0.38	<1	4	<1	10.7	0.33
28-Nov	0.35	<1	8	<1	9.8	0.34
06-Dec	0.45	<1	<2	<1	9	0.34
08-Dec	0.47	<1	<2	<1	9	0.92
14-Dec	0.41	<1	2	<1	9	0.75
19-Dec	0.39	<1	NA	<1	8.2	0.52

### 941 (BELL ROAD & OLD McLELLAN ROAD) - 2023 TEST RESULTS


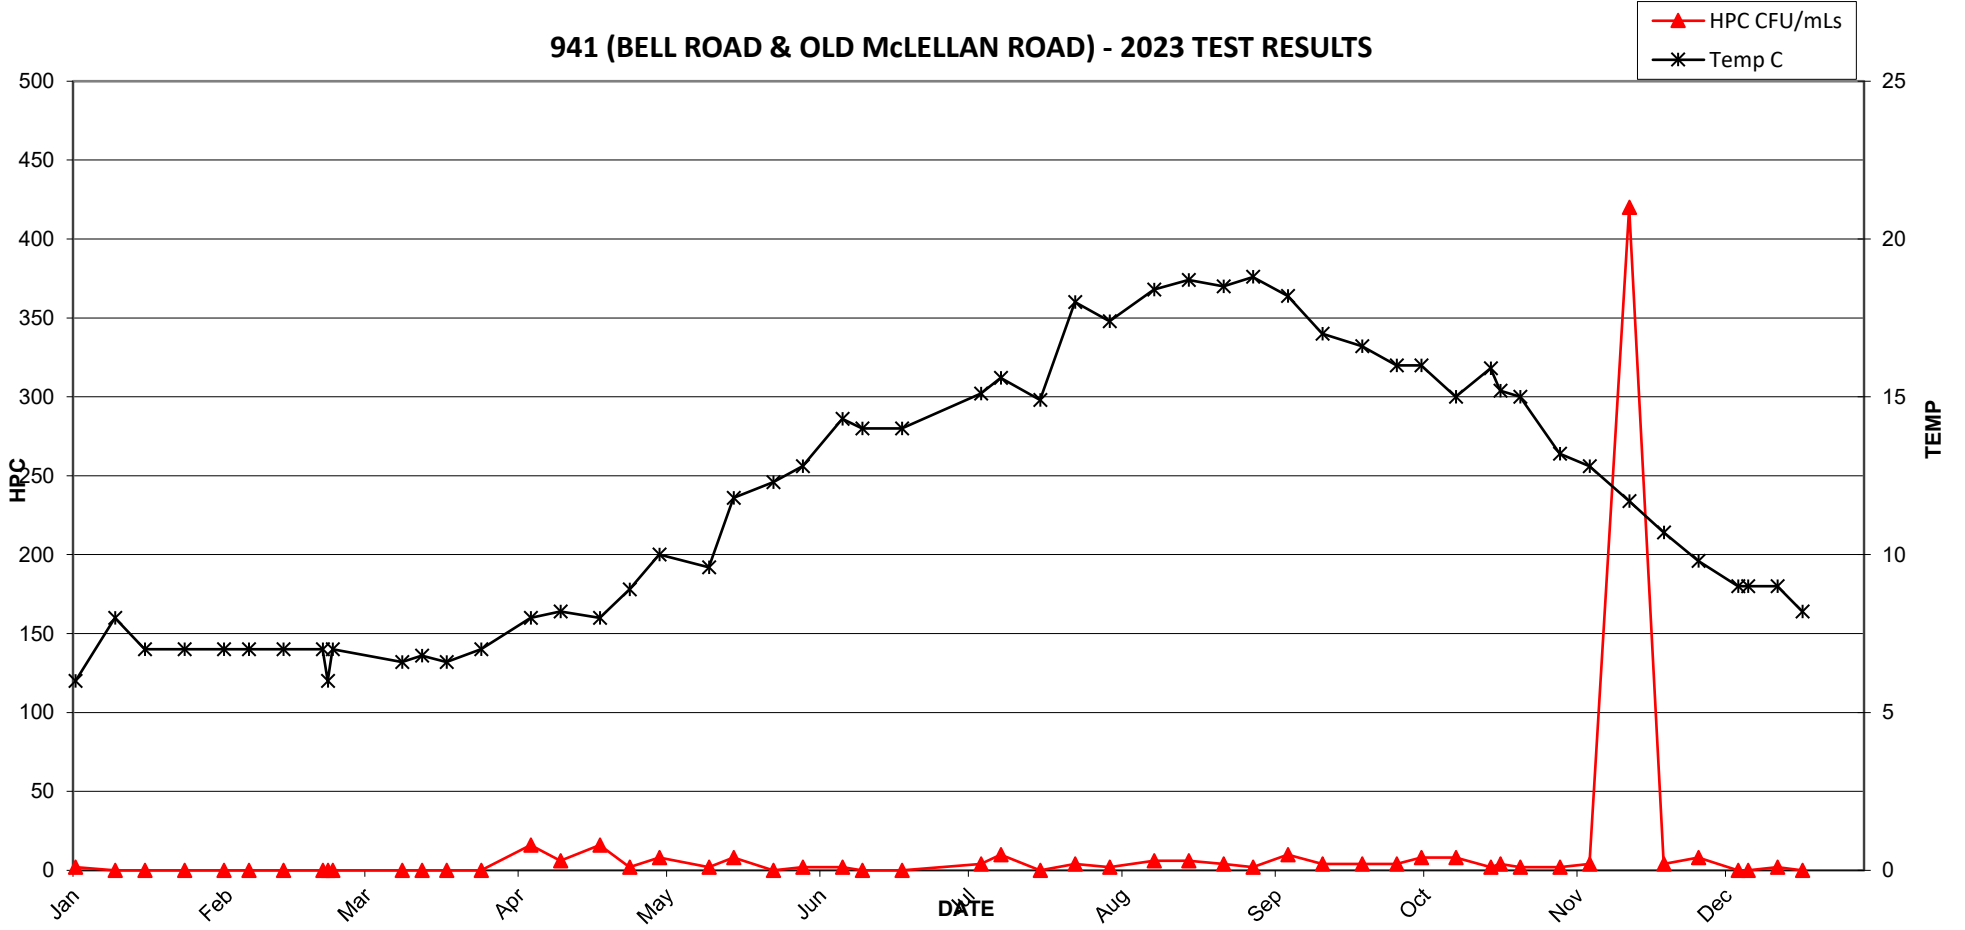


### 941 (BELL ROAD & OLD McLELLAN ROAD) - 2023 TEST RESULTS

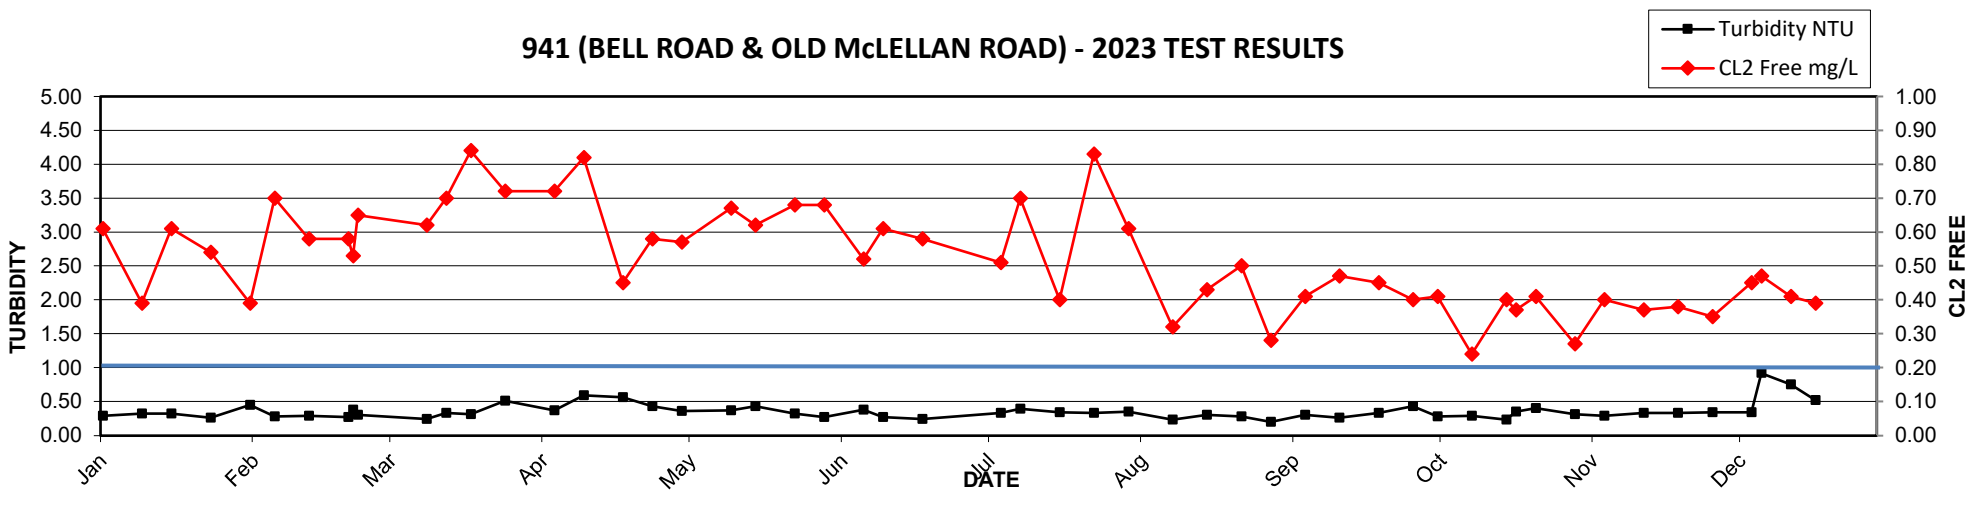

## 2023 MV Laboratory Report - 942 (5963 176 ST)


Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
06-Jan	0.79	<1	<2	<1	6	0.34
12-Jan	0.84	<1	<2	<1	6	0.37
17-Jan	1.08	<1	<2	<1	6	0.36
24-Jan	1.16	<1	<2	<1	6	0.45
02-Feb	1.07	<1	<2	<1	6	0.51
07-Feb	0.79	<1	2	<1	6	0.57
14-Feb	1.09	<1	<2	<1	6	0.51
21-Feb	1.36	<1	<2	<1	6	0.47
22-Feb	1.09	<1	<2	<1	6	0.41
24-Feb	0.98	<1	<2	<1	5	0.55
04-Mar	0.96	<1	<2	<1	4.9	0.30
14-Mar	0.66	<1	<2	<1	5.6	0.38
22-Mar	0.92	<1	<2	<1	6.7	0.31
24-Mar	1.17	<1	<2	<1	6.5	0.34
29-Mar	0.88	<1	2	<1	6.5	0.34
05-Apr	0.61	<1	<2	<1	6.8	0.58
11-Apr	1.21	<1	<2	<1	7.5	0.56
19-Apr	0.98	<1	<2	<1	7.4	0.46
25-Apr	0.81	<1	2	<1	7.5	0.53
26-Apr	0.94	<1	<2	<1	7.8	0.44
01-May	1.01	<1	<2	<1	7.9	0.44
08-May	0.99	<1	<2	<1	8.6	0.43
11-May	1.12	<1	<2	<1	8.3	0.51
15-May	0.98	<1	<2	<1	8.7	0.75
24-May	0.88	<1	2	<1	9.5	0.41
01-Jun	0.92	<1	4	<1	10.7	0.31
05-Jun	0.84	<1	2	<1	12.2	0.64
13-Jun	0.97	<1	4	<1	11.1	0.43
16-Jun	0.90	<1	<2	<1	10.8	0.34
20-Jun	0.93	<1	6	<1	11.3	0.30
28-Jun	0.86	<1	4	<1	11.7	0.19
29-Jun	0.84	<1	14	<1	11.9	0.27
04-Jul	0.71	<1	<2	<1	12.5	0.70
10-Jul	1.06	<1	2	<1	12.6	0.29
18-Jul	1.12	<1	<2	<1	15.9	0.41
25-Jul	0.99	<1	<2	<1	16.2	0.35
01-Aug	0.98	<1	<2	<1	15.4	0.40
09-Aug	0.95	<1	<2	<1	16	0.36
14-Aug	0.84	<1	4	<1	16.9	0.30
23-Aug	0.97	<1	<2	<1	17.2	0.37
28-Aug	0.89	<1	6	<1	17.6	0.32
01-Sep	0.87	<1	6	<1	17.2	0.32
05-Sep	0.97	<1	2	<1	16.6	0.29
13-Sep	0.82	<1	<2	<1	17.1	0.40
15-Sep	1.07	<1	4	<1	16.7	0.63
19-Sep	1.17	<1	4	<1	16.2	0.63
27-Sep	1.14	<1	4	<1	15.8	0.35
04-Oct	0.90	<1	4	<1	15	0.32
10-Oct	0.75	<1	2	<1	15.1	0.29
11-Oct	1.14	<1	<2	<1	15	0.35
12-Oct	1.06	<1	<2	<1	14.6	0.35
16-Oct	0.88	<1	2	<1	14.6	0.44
24-Oct	1.01	<1	<2	<1	13.1	0.54
27-Oct	1.27	<1	<2	<1	12.6	0.44
01-Nov	1.15	<1	<2	<1	11.9	0.35
07-Nov	1.09	<1	2	<1	11.1	0.3
09-Nov	1.06	<1	2	<1	11.2	0.46
14-Nov	1.26	<1	<2	<1	10	0.42

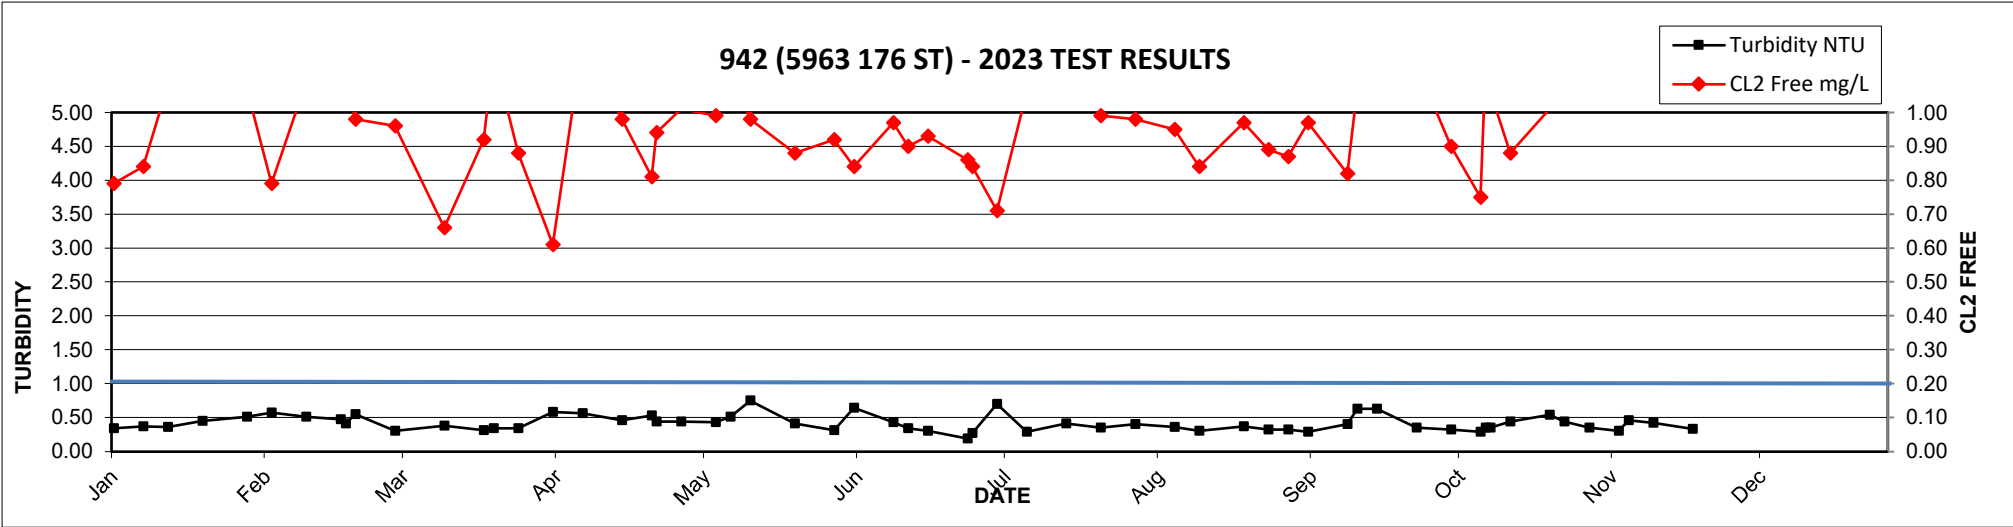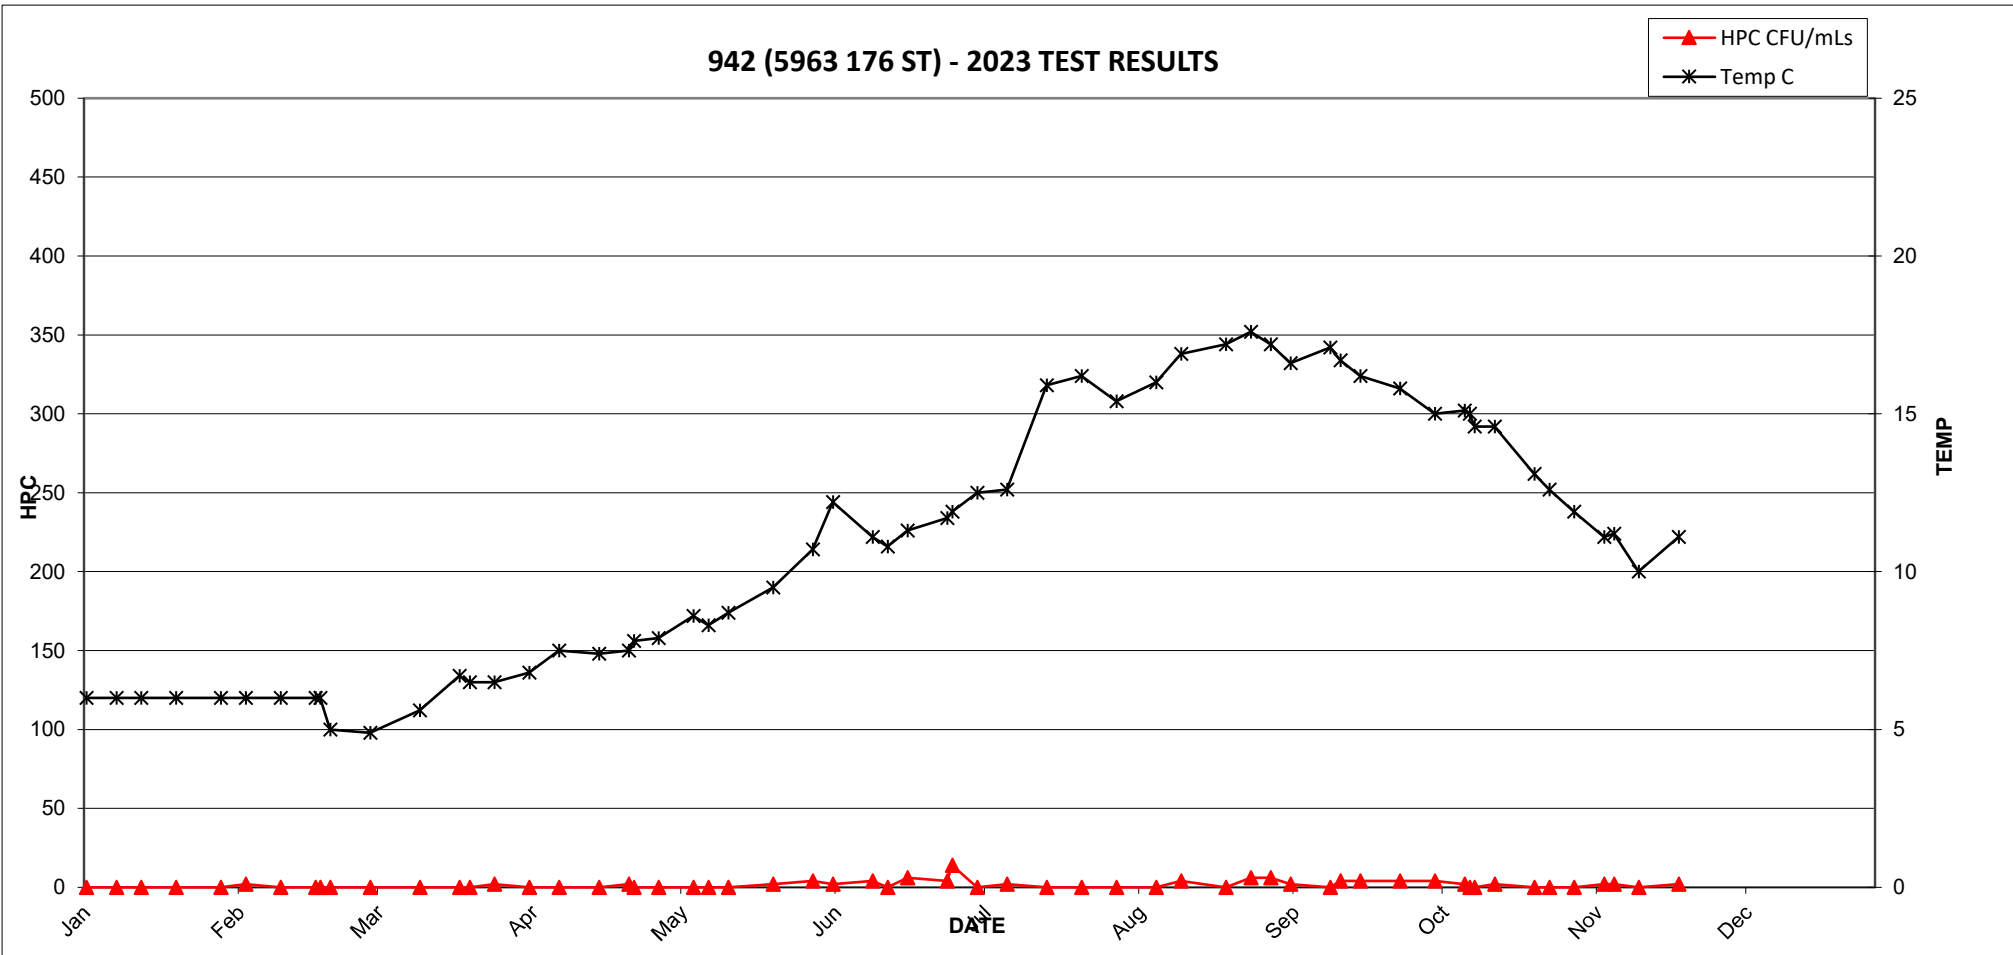


## 2023 MV Laboratory Report - 943 (18425 53 AVE)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.75	<1	<2	<1	6	0.30
12-Jan	0.88	<1	<2	<1	6	0.32
17-Jan	0.69	<1	<2	<1	6	0.24
24-Jan	0.88	<1	<2	<1	6	0.29
02-Feb	0.79	<1	<2	<1	6	0.36
07-Feb	0.69	<1	2	<1	6	0.28
14-Feb	0.93	<1	<2	<1	6	0.26
21-Feb	1.01	<1	<2	<1	6	0.28
24-Feb	0.81	<1	<2	<1	6	0.35
04-Mar	0.98	<1	<2	<1	5.1	0.26
14-Mar	0.84	<1	<2	<1	6.3	0.29
20-Mar	0.76	<1	<2	<1	6.5	0.29
22-Mar	0.88	<1	<2	<1	6.8	0.29
24-Mar	1.04	<1	<2	<1	6.5	0.29
29-Mar	0.91	<1	<2	<1	6.3	0.30
05-Apr	0.69	<1	<2	<1	6.6	0.41
11-Apr	1.04	<1	<2	<1	7.1	0.47
19-Apr	0.97	<1	<2	<1	7.5	0.36
25-Apr	0.90	<1	<2	<1	7.4	0.42
26-Apr	0.88	<1	<2	<1	7.7	0.41
01-May	0.99	<1	<2	<1	7.8	0.48
05-May	1.04	<1	LA	<1	7.7	0.42
11-May	1.00	<1	<2	<1	8.3	0.37
15-May	0.93	<1	<2	<1	8.4	0.37
24-May	0.87	<1	<2	<1	9.3	0.31
01-Jun	0.91	<1	<2	<1	9.9	0.34
09-Jun	0.84	<1	<2	<1	10	0.45
13-Jun	0.71	<1	<2	<1	10.9	0.34
16-Jun	0.76	<1	<2	<1	10.5	0.30
20-Jun	0.95	<1	<2	<1	11.1	0.32
23-Jun	0.99	<1	<2	<1	10.5	0.56
28-Jun	0.96	<1	<2	<1	11.1	0.34
04-Jul	0.77	<1	2	<1	12.4	0.56
10-Jul	0.71	<1	<2	<1	12.8	0.60
12-Jul	1.07	<1	<2	<1	13.1	0.40
18-Jul	1.12	<1	<2	<1	15.3	0.28
25-Jul	0.97	<1	<2	<1	15.7	0.23
01-Aug	0.98	<1	<2	<1	15	0.39
04-Aug	0.99	<1	<2	<1	15.6	0.33
09-Aug	0.95	<1	<2	<1	15.8	0.36
14-Aug	0.92	<1	<2	<1	16.5	0.30
23-Aug	0.99	<1	<2	<1	15.9	0.32
28-Aug	0.87	<1	<2	<1	16.8	0.32
05-Sep	0.91	<1	<2	<1	16.8	0.27
13-Sep	1.07	<1	<2	<1	17	0.28
19-Sep	0.99	<1	<2	<1	16.2	0.54
27-Sep	1.10	<1	2	<1	15.6	0.27
04-Oct	0.91	<1	2	<1	15	0.35
06-Oct	0.84	<1	<2	<1	14.8	0.35
10-Oct	0.83	<1	<2	<1	15	0.29
12-Oct	0.88	<1	2	<1	14.8	0.36
16-Oct	0.84	<1	2	<1	14.4	0.34
19-Oct	0.98	<1	<2	<1	14.2	0.52
24-Oct	0.99	<1	<2	<1	13	0.61
27-Oct	1.51	<1	<2	<1	12.8	0.41
01-Nov	1.11	<1	<2	<1	11.5	0.32
07-Nov	1.03	<1	<2	<1	11.2	0.28
08-Nov	0.93	<1	<2	<1	11.2	0.45
09-Nov	1.1	<1	<2	<1	11.5	0.5
14-Nov	1.22	<1	<2	<1	10.5	0.34
27-Nov	1.07	<1	<2	<1	9	0.35
04-Dec	0.94	<1	<2	<1	8.4	0.36
06-Dec	1.18	<1	<2	<1	8.1	1.20
12-Dec	1.08	<1	<2	<1	8	0.52

943 (18425 53 AVE) - 2023 TEST RESULTS

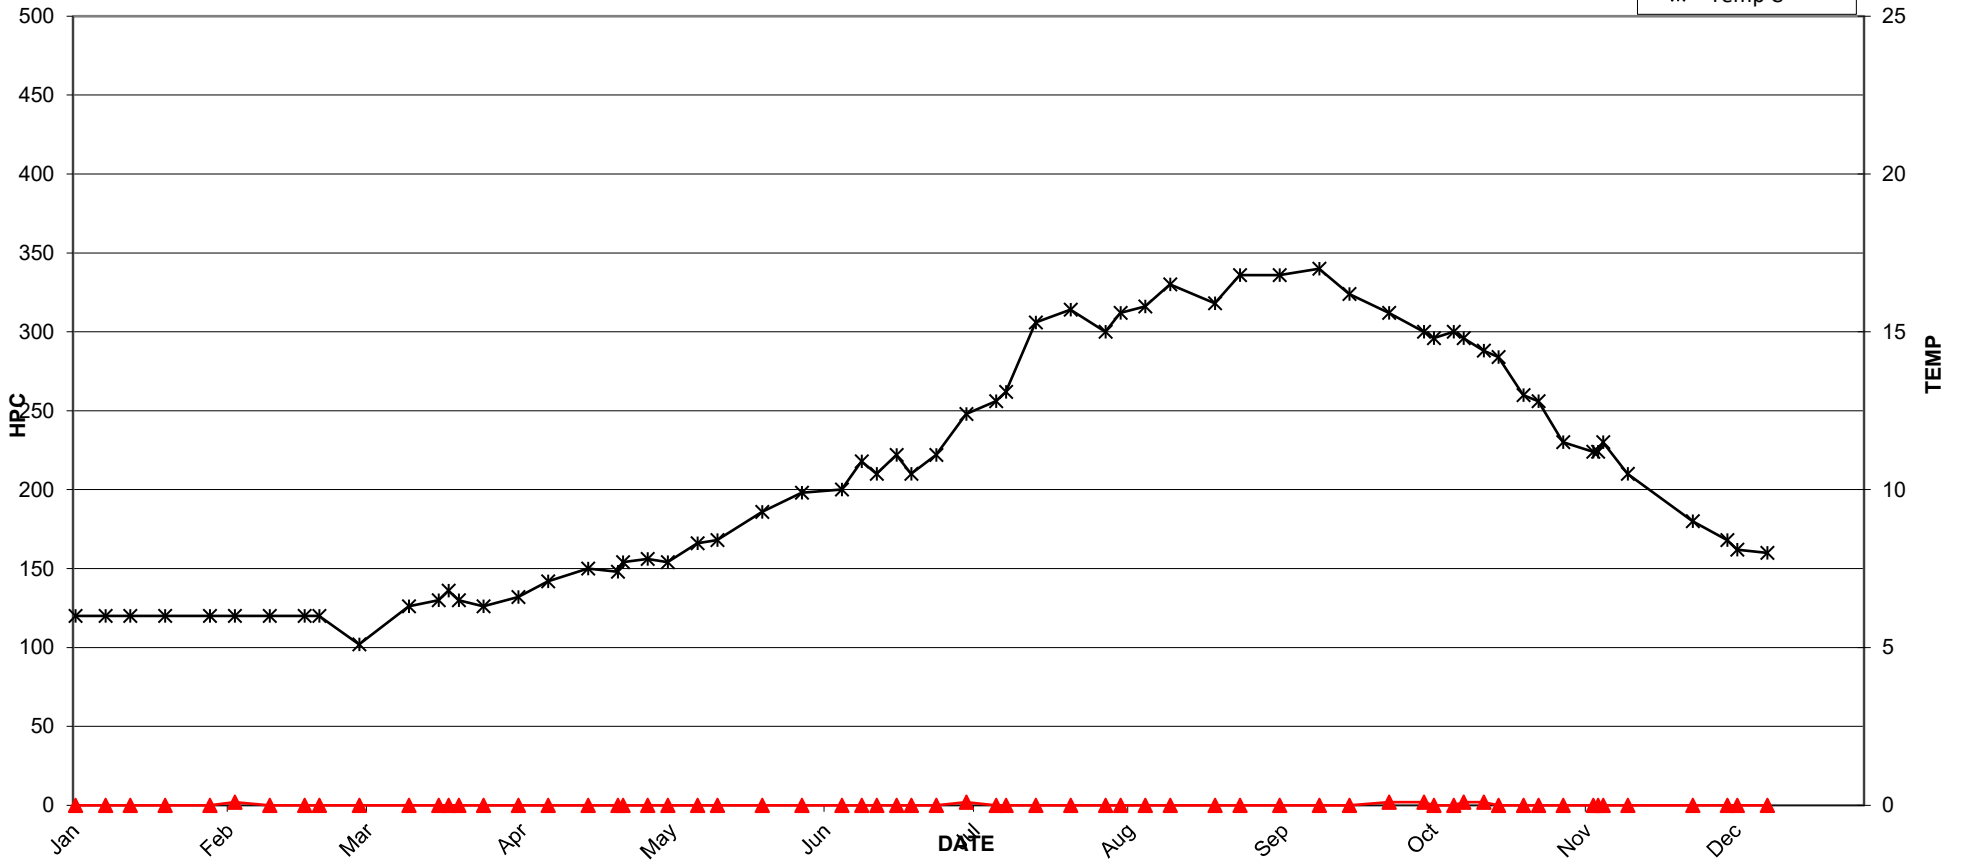



943 (18425 53 AVE) - 2023 TEST RESULTS

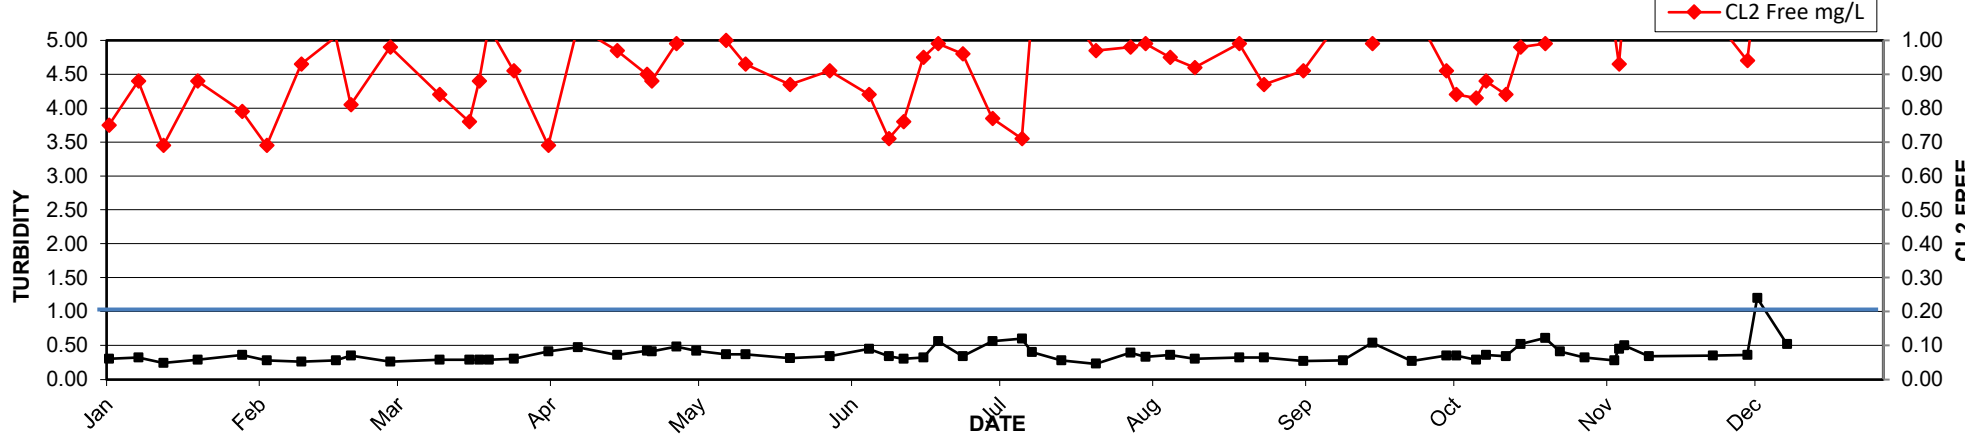

## 2023 MV Laboratory Report - 944 (6008 189 ST)



Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.61	<1	<2	<1	6	0.30
12-Jan	0.39	<1	<2	<1	7	0.32
17-Jan	0.65	<1	<2	<1	7	0.23
24-Jan	0.65	<1	<2	<1	6	0.35
26-Jan	0.99	<1	<2	<1	6	0.30
02-Feb	0.77	<1	<2	<1	6	0.65
07-Feb	0.58	<1	<2	<1	6	0.43
14-Feb	0.92	<1	<2	<1	6	0.32
21-Feb	0.85	<1	<2	<1	6	0.32
22-Feb	0.88	<1	4	<1	6	0.27
24-Feb	0.91	<1	<2	<1	6	0.36
25-Feb	0.68	<1	<2	<1	7	0.27
04-Mar	0.52	<1	<2	<1	6	0.27
14-Mar	0.48	<1	<2	<1	7	0.30
22-Mar	0.66	<1	2	<1	8	0.23
24-Mar	0.72	<1	2	<1	8.1	0.26
29-Mar	0.66	<1	<2	<1	8.1	0.30
05-Apr	0.67	<1	60	<1	6.5	0.38
11-Apr	0.89	<1	<2	<1	7.4	0.34
19-Apr	0.66	<1	<2	<1	7.7	0.52
25-Apr	0.88	<1	<2	<1	7.7	0.42
26-Apr	0.91	<1	<2	<1	8	0.30
01-May	0.79	<1	<2	<1	8.4	0.38
04-May	0.77	<1	<2	<1	8.5	0.34
08-May	0.91	<1	<2	<1	8.5	0.29
11-May	0.60	<1	<2	<1	11.3	0.39
15-May	0.58	<1	<2	<1	12.4	0.39
24-May	0.48	<1	<2	<1	14.5	0.26
01-Jun	0.46	<1	6	<1	14.6	0.28
05-Jun	0.34	<1	22	<1	14.6	0.32
07-Jun	0.77	<1	24	<1	14.9	0.92
13-Jun	0.47	<1	14	<1	15.3	0.56
16-Jun	0.52	<1	<2	<1	15.6	0.23
20-Jun	0.45	<1	24	<1	15.4	0.26
23-Jun	0.36	<1	6	<1	14.9	0.38
28-Jun	0.47	<1	4	<1	15.6	0.28
29-Jun	0.51	<1	6	<1	15.9	0.27
04-Jul	0.69	<1	12	<1	15.1	0.36
10-Jul	0.41	<1	10	<1	17.3	0.30
18-Jul	0.35	<1	24	<1	15.9	0.27
25-Jul	0.23	<1	<2	<1	19.4	0.23
01-Aug	0.32	<1	2	<1	19	0.39
09-Aug	0.21	<1	<2	<1	20.1	0.38
14-Aug	0.28	<1	<2	<1	19.6	0.28
23-Aug	0.91	<1	160	<1	18.8	0.33
28-Aug	0.77	<1	62	<1	18	0.24
01-Sep	0.88	<1	44	<1	18	0.23
05-Sep	0.88	<1	12	<1	18.8	0.24
13-Sep	0.28	<1	4	<1	19.3	0.23
15-Sep	1.00	<1	110	<1	17	0.34
19-Sep	0.77	<1	38	<1	17	0.57
27-Sep	0.88	<1	12	<1	16.1	0.24
04-Oct	0.83	<1	82	<1	16	0.31
06-Oct	0.29	<1	28	<1	16.9	0.57
10-Oct	0.09	<1	<2	<1	17	0.28
11-Oct	0.29	<1	34	<1	17	0.29
12-Oct	0.13	<1	28	<1	17	0.42
16-Oct	0.35	<1	LA	<1	16.6	0.27
27-Oct	0.3	<1	8	<1	14.7	0.37
1-Nov-23	0.89	<1	270	<1	12.7	0.3
7-Nov-23	0.41	<1	110	<1	13.4	0.28
09-Nov	0.29	<1	2	<1	13.3	0.45
14-Nov	1.03	<1	64	<1	10.7	0.29
22-Nov	0.88	<1	68	<1	12	0.26



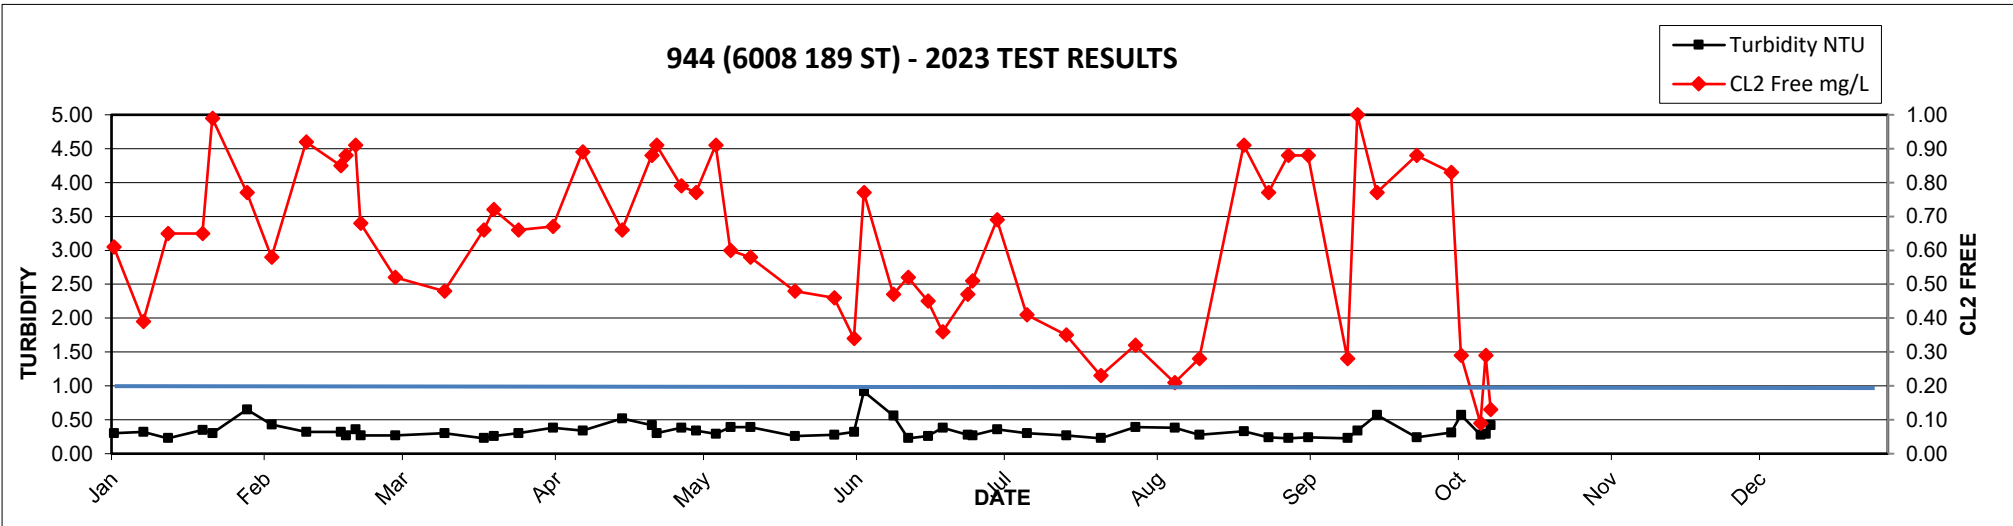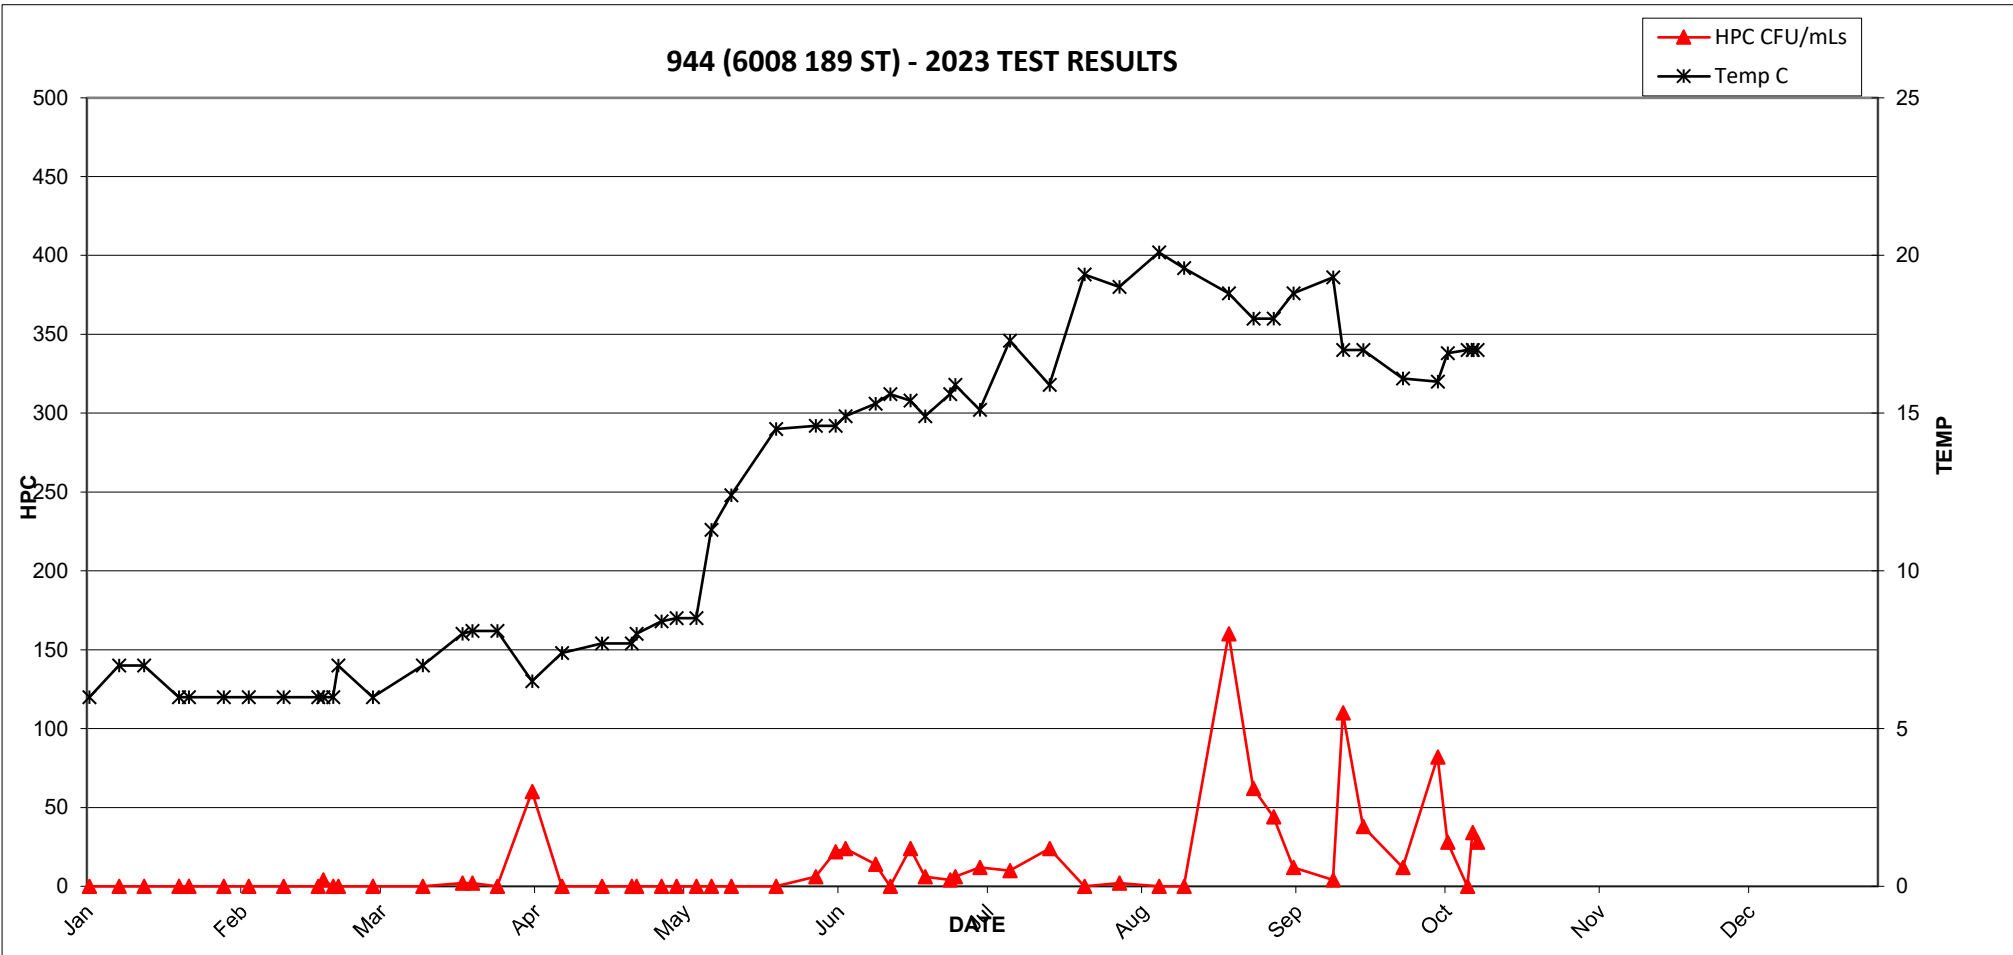



## 2023 MV Laboratory Report - 945 (5517 PRODUCTION BLVD)

Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
06-Jan	1.02	<1	<2	<1	6	0.40
12-Jan	0.83	<1	<2	<1	6	0.28
13-Jan	0.82	<1	<2	<1	6	0.27
17-Jan	0.86	<1	<2	<1	6	0.25
24-Jan	1.00	<1	<2	<1	6	0.37
26-Jan	1.13	<1	<2	<1	6	0.40
02-Feb	1.00	<1	<2	<1	6	0.35
07-Feb	0.88	<1	<2	<1	6	0.31
14-Feb	0.77	<1	<2	<1	6	0.38
21-Feb	1.08	<1	<2	<1	6	0.33
04-Mar	1.05	<1	<2	<1	5	0.27
14-Mar	0.77	<1	<2	<1	5.8	0.28
20-Mar	0.88	<1	<2	<1	6.5	0.29
22-Mar	0.90	<1	<2	<1	6.6	0.30
24-Mar	1.14	<1	<2	<1	6.5	0.31
24-Mar	0.87	<1	<2	<1	6.5	0.31
29-Mar	0.96	<1	<2	<1	6.5	0.36
05-Apr	0.88	<1	16	<1	6.6	0.41
11-Apr	0.94	<1	<2	<1	7.6	0.53
19-Apr	0.92	<1	<2	<1	7.2	0.56
25-Apr	0.81	<1	<2	<1	7.5	0.44
26-Apr	1.00	<1	<2	<1	7.5	0.37
28-Apr	0.95	<1	<2	<1	7.1	0.38
01-May	1.07	<1	<2	<1	7.8	0.42
05-May	1.03	<1	<2	<1	7.6	0.36
08-May	0.94	<1	<2	<1	8.4	0.33
11-May	1.00	<1	<2	<1	8.3	0.32
12-May	0.88	<1	<2	<1	7.9	0.53
15-May	0.91	<1	<2	<1	8.4	0.44
24-May	0.83	<1	<2	<1	9.8	0.32
01-Jun	0.99	<1	<2	<1	10.5	0.26
05-Jun	0.84	<1	2	<1	10.3	0.44
07-Jun	0.88	<1	<2	<1	12.9	0.29
09-Jun	0.51	<1	2	<1	9.8	0.42
13-Jun	0.83	<1	4	<1	10.9	0.34
16-Jun	0.88	<1	2	<1	11.1	0.26
20-Jun	1.03	<1	<2	<1	11.8	0.28
23-Jun	0.91	<1	<2	<1	10.5	0.48
28-Jun	0.89	<1	<2	<1	11.6	0.24
29-Jun	0.95	<1	<2	<1	11.9	0.30
30-Jun	0.92	<1	8	<1	11.7	0.33
04-Jul	0.77	<1	48	<1	12.4	0.45
10-Jul	1.02	<1	<2	<1	12.7	0.45
12-Jul	1.08	<1	4	<1	14	0.27
18-Jul	0.98	<1	<2	<1	15.4	0.40
25-Jul	0.92	<1	4	<1	16.1	0.28
01-Aug	0.89	<1	<2	<1	15.3	0.44
04-Aug	0.93	<1	4	<1	15.9	0.31
09-Aug	0.82	<1	4	<1	16.2	0.42
14-Aug	0.82	<1	4	<1	17	0.29
23-Aug	0.80	<1	36	<1	17.2	0.55
28-Aug	0.77	<1	8	<1	16.6	0.25
05-Sep	0.94	<1	4	<1	16.7	0.29
13-Sep	1.00	<1	<2	<1	17.3	0.26
15-Sep	1.08	<1	8	<1	16.1	0.48
19-Sep	1.02	<1	2	<1	16	0.45
27-Sep	0.80	<1	10	<1	15.8	0.32
04-Oct	0.69	<1	2	<1	15	0.31
06-Oct	0.85	<1	4	<1	14.9	0.59
10-Oct	0.92	<1	6	<1	15	0.29
12-Oct	0.98	<1	2	<1	14.6	0.31

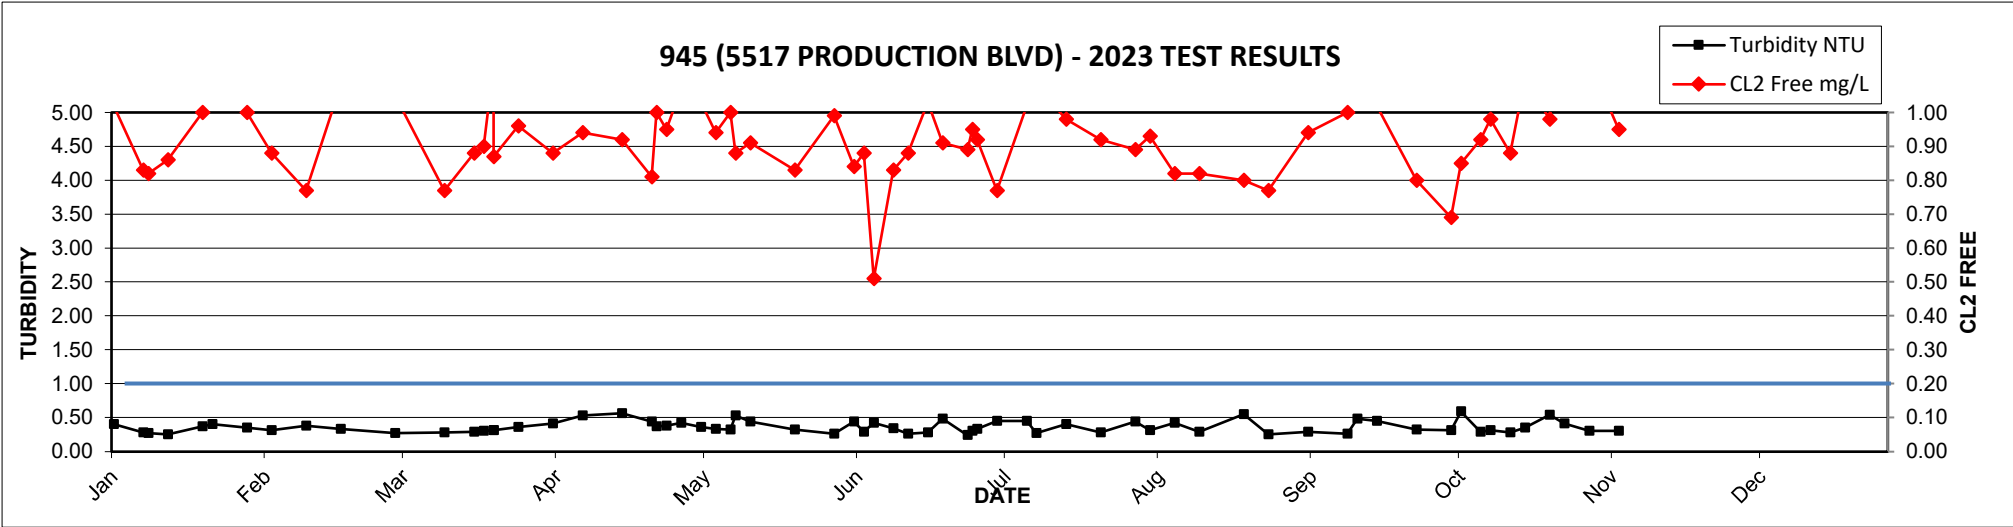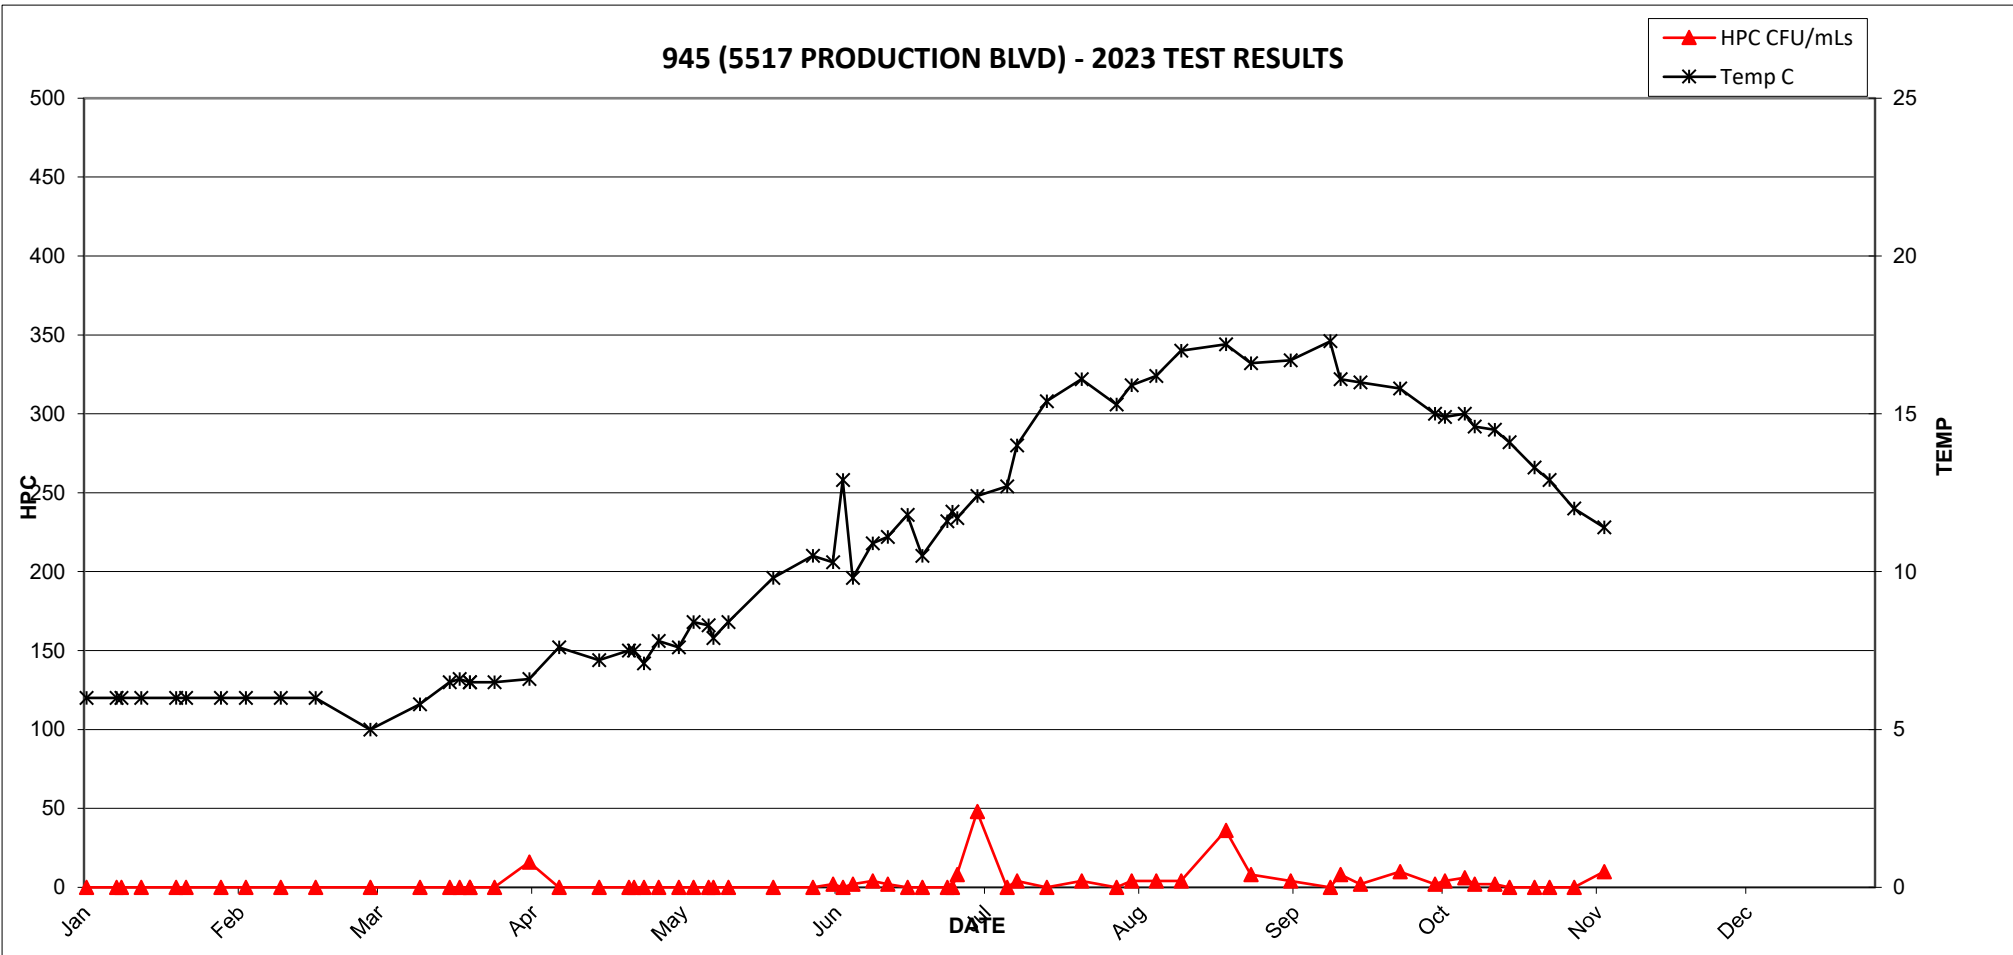



## 2023 MV Laboratory Report - 946 (6332 195B ST)

<b>Date Collected</b>	<b>CL2 Free mg/L</b>	<b>Ecoli MF/100mLs</b>	<b>HPC CFU/mLs</b>	<b>Tcoli MF/100mLs</b>	<b>Temp C</b>	<b>Turbidity NTU</b>
05-Jan	0.71	<1	<2	<1	7	0.29
10-Jan	0.39	<1	<2	<1	7	0.26
13-Jan	0.71	<1	<2	<1	7	0.24
19-Jan	0.64	<1	2	<1	7	0.30
25-Jan	0.77	<1	<2	<1	7	0.27
03-Feb	0.71	<1	<2	<1	7	0.30
09-Feb	0.67	<1	<2	<1	6	0.36
16-Feb	0.63	<1	<2	<1	7	0.27
22-Feb	0.67	<1	<2	<1	6	0.26
25-Feb	0.85	<1	<2	<1	7	0.28
07-Mar	0.62	<1	<2	<1	5.7	0.26
14-Mar	0.68	<1	<2	<1	6	0.23
21-Mar	0.71	<1	<2	<1	7.5	0.30
24-Mar	0.78	<1	<2	<1	7.5	0.33
28-Mar	0.73	<1	510	<1	7	0.30
04-Apr	0.73	<1	<2	<1	7.7	0.30
14-Apr	0.76	<1	<2	<1	8.1	0.62
21-Apr	0.50	<1	2	<1	8.4	0.41
28-Apr	0.60	<1	<2	<1	8.8	0.40
01-May	0.75	<1	<2	<1	9.4	0.45
04-May	0.65	<1	<2	<1	9.8	0.44
10-May	0.47	<1	<2	<1	11	0.31
12-May	0.97	<1	<2	<1	10.9	0.47
17-May	0.81	<1	<2	<1	11.3	0.37
24-May	0.69	<1	4	<1	12.7	0.31
01-Jun	0.79	<1	6	<1	13	0.40
06-Jun	0.74	<1	4	<1	12.8	0.29
15-Jun	0.73	<1	4	<1	14.6	0.31
23-Jun	0.43	<1	10	<1	13.6	0.36
29-Jun	0.78	<1	16	<1	14.1	0.25
05-Jul	0.49	<1	4	<1	15.3	0.28
12-Jul	0.71	<1	40	<1	18	0.21
18-Jul	0.76	<1	24	<1	17.2	0.39
27-Jul	0.38	<1	12	<1	18.5	0.25
11-Aug	0.48	<1	2	<1	18.7	0.33
16-Aug	0.17	<1	8	<1	19.3	0.32
25-Aug	0.21	<1	<2	<1	19.5	0.38
31-Aug	0.38	<1	6	<1	19.4	0.22
06-Sep	0.71	<1	10	<1	18.4	0.29
12-Sep	0.41	<1	10	<1	17.1	0.24
14-Sep	0.56	<1	<2	<1	18.8	0.24
19-Sep	0.51	<1	2	<1	18.6	0.34
28-Sep	0.45	<1	2	<1	18	0.29
06-Oct	0.39	<1	2	<1	16.8	0.37
12-Oct	0.55	<1	8	<1	16.7	0.35
13-Oct	0.36	<1	<2	<1	16.6	0.27
20-Oct	0.40	<1	<2	<1	14.5	0.35
24-Oct	0.51	<1	2	<1	14.9	0.41
27-Oct	0.49	<1	<2	<1	14.7	0.37
31-Oct	0.54	<1	2	<1	9	0.35
03-Nov	0.80	<1	<2	<1	13.3	0.29
08-Nov	0.49	<1	<2	<1	13	0.42
17-Nov	0.54	<1	<2	<1	11.9	0.31
21-Nov	0.49	<1	<2	<1	9.3	0.37
07-Dec	0.60	<1	<2	<1	9.7	0.25

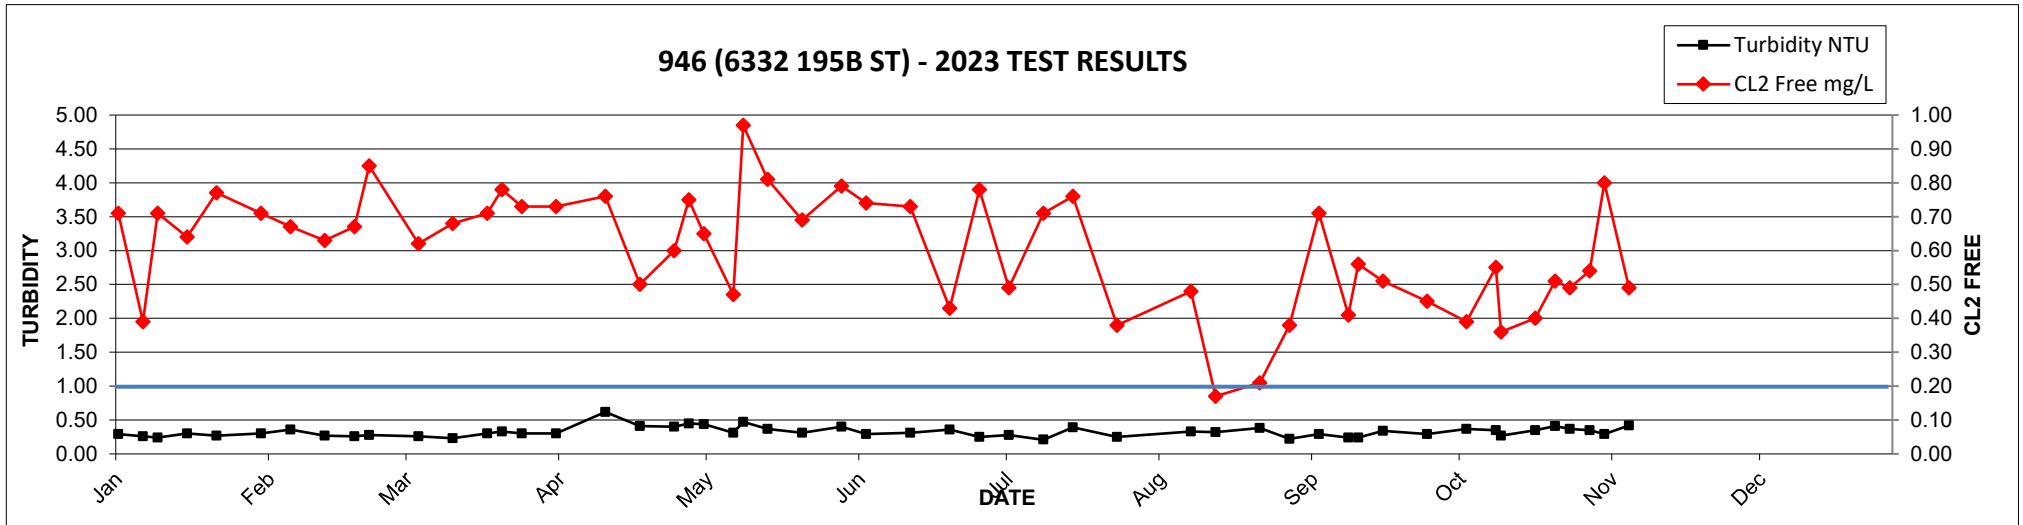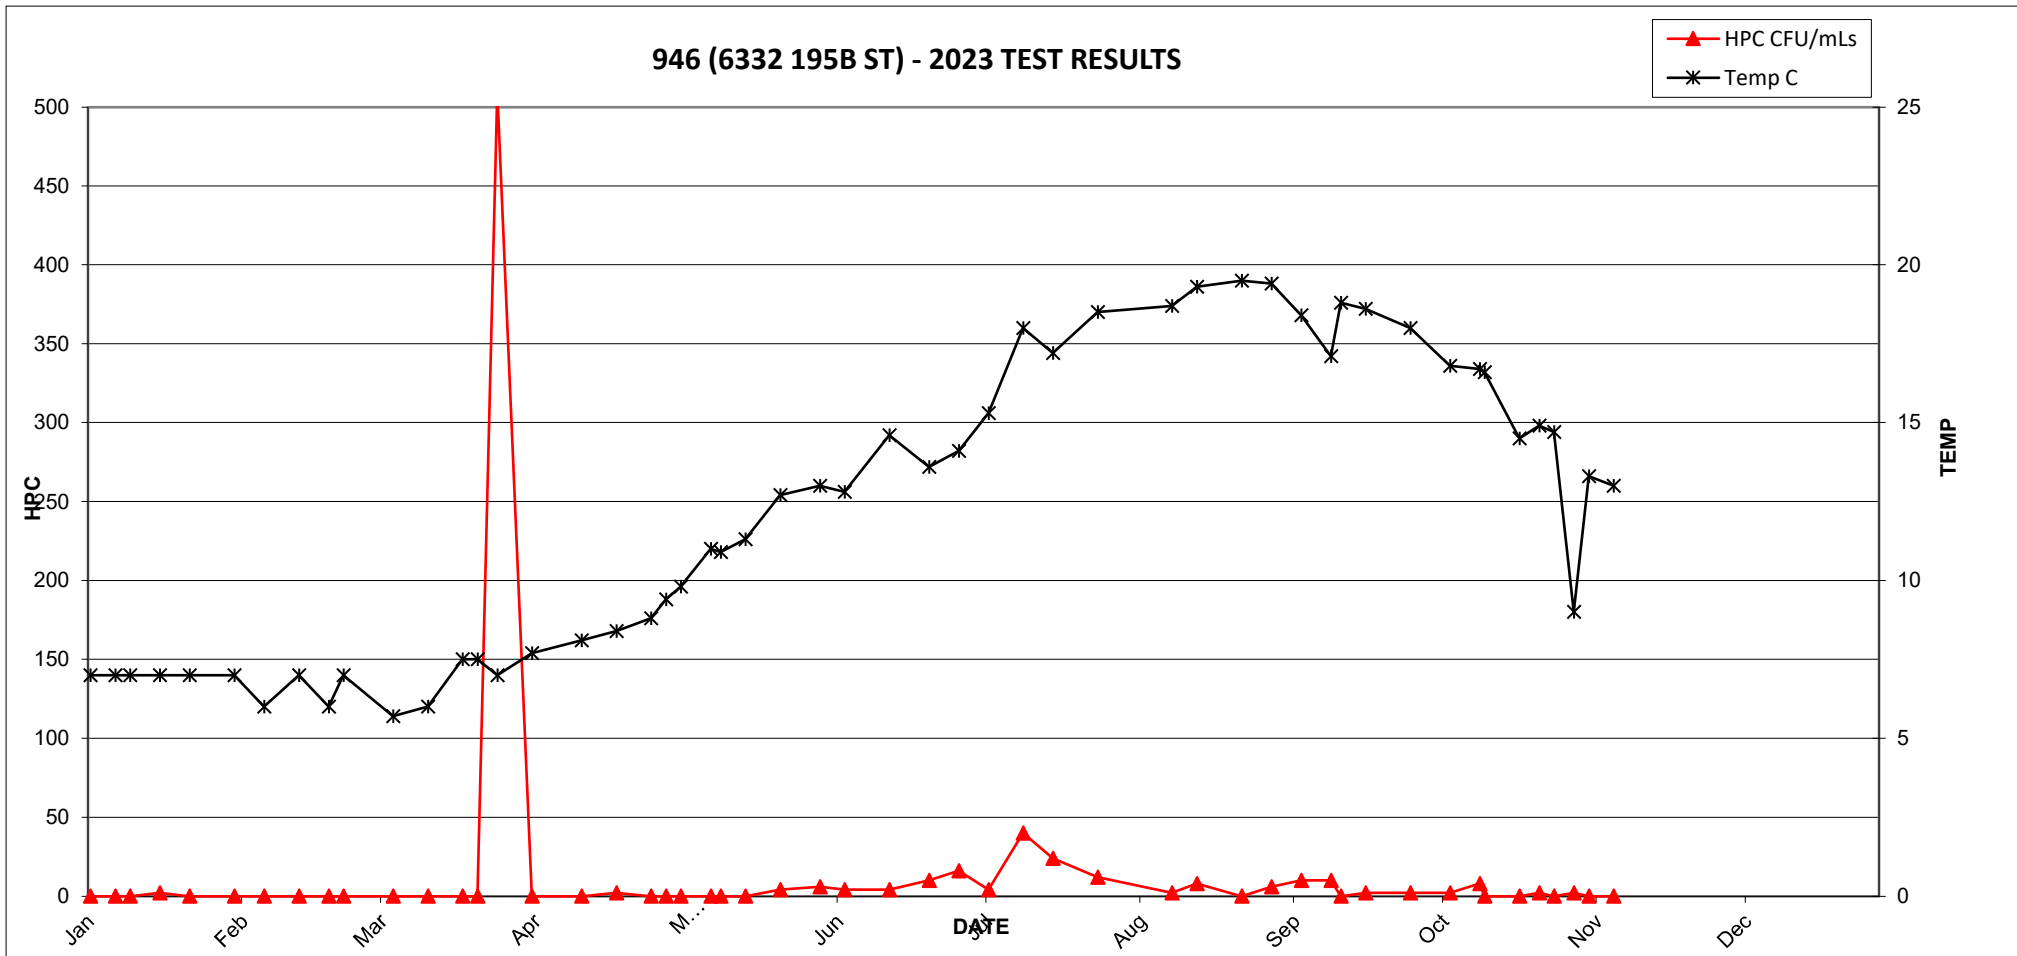

## 2023 MV Laboratory Report - 947 (6803 192 ST)



Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
05-Jan	0.98	<1	2	<1	6	0.27
10-Jan	1.06	<1	<2	<1	6	0.30
19-Jan	1.09	<1	<2	<1	6	0.29
25-Jan	0.88	<1	2	<1	6	0.23
03-Feb	0.89	<1	<2	<1	5	0.30
09-Feb	0.98	<1	<2	<1	6	0.67
16-Feb	0.91	<1	<2	<1	6	0.27
22-Feb	0.87	<1	<2	<1	5	0.27
25-Feb	0.92	<1	<2	<1	5	0.26
07-Mar	0.93	<1	<2	<1	5.3	0.21
14-Mar	0.85	<1	<2	<1	5.9	0.25
21-Mar	0.88	<1	<2	<1	7.3	0.26
28-Mar	0.90	<1	54	<1	6.9	0.26
04-Apr	0.90	<1	<2	<1	6.4	0.31
14-Apr	0.96	<1	<2	<1	8.1	0.57
21-Apr	0.59	<1	<2	<1	8.1	0.45
28-Apr	0.73	<1	<2	<1	9.5	0.55
04-May	0.95	<1	<2	<1	11.2	0.35
05-May	0.88	<1	<2	<1	11.4	0.46
10-May	0.83	<1	<2	<1	8.9	0.29
17-May	0.85	<1	<2	<1	13.9	0.27
24-May	0.88	<1	<2	<1	11.3	0.24
01-Jun	0.84	<1	<2	<1	13	0.41
06-Jun	0.96	<1	<2	<1	15	0.24
15-Jun	1.20	<1	2	<1	15.1	0.26
29-Jun	0.85	<1	2	<1	18.1	0.21
05-Jul	0.49	<1	<2	<1	17.5	0.33
12-Jul	0.81	<1	<2	<1	18.4	0.23
18-Jul	0.95	<1	<2	<1	18.9	0.28
27-Jul	0.72	<1	2	<1	19	0.22
03-Aug	0.74	<1	<2	<1	19.8	0.41
04-Aug	0.53	<1	<2	<1	19.8	0.21
11-Aug	0.62	<1	2	<1	19.7	0.40
16-Aug	0.68	<1	<2	<1	20.7	0.24
25-Aug	0.63	<1	<2	<1	20	0.27
31-Aug	0.67	<1	<2	<1	19.5	0.23
06-Sep	0.84	<1	<2	<1	18.9	0.28
12-Sep	0.56	<1	2	<1	19.3	0.24
15-Sep	0.60	<1	<2	<1	19	0.24
19-Sep	0.86	<1	<2	<1	18.9	0.31
28-Sep	0.57	<1	<2	<1	17	0.25
05-Oct	0.60	<1	<2	<1	16	0.35
12-Oct	0.87	<1	<2	<1	15.9	0.28
13-Oct	0.73	<1	2	<1	16.7	0.31
20-Oct	0.44	<1	<2	<1	14.7	0.30
24-Oct	0.69	<1	<2	<1	13.9	0.38
31-Oct	0.58	<1	<2	<1	9.3	0.30
03-Nov	0.92	<1	<2	<1	12	0.31
08-Nov	0.53	<1	<2	<1	12	0.37
17-Nov	0.88	<1	<2	<1	10.9	0.43
21-Nov	0.85	<1	2	<1	9.9	0.34
30-Nov-23	0.62	<1	<2	<1	8.1	0.28
07-Dec	0.87	<1	<2	<1	8.3	0.32
08-Dec	1.24	<1	<2	<1	7.9	1.40
20-Dec	0.97	<1	NA	<1	8.2	0.60

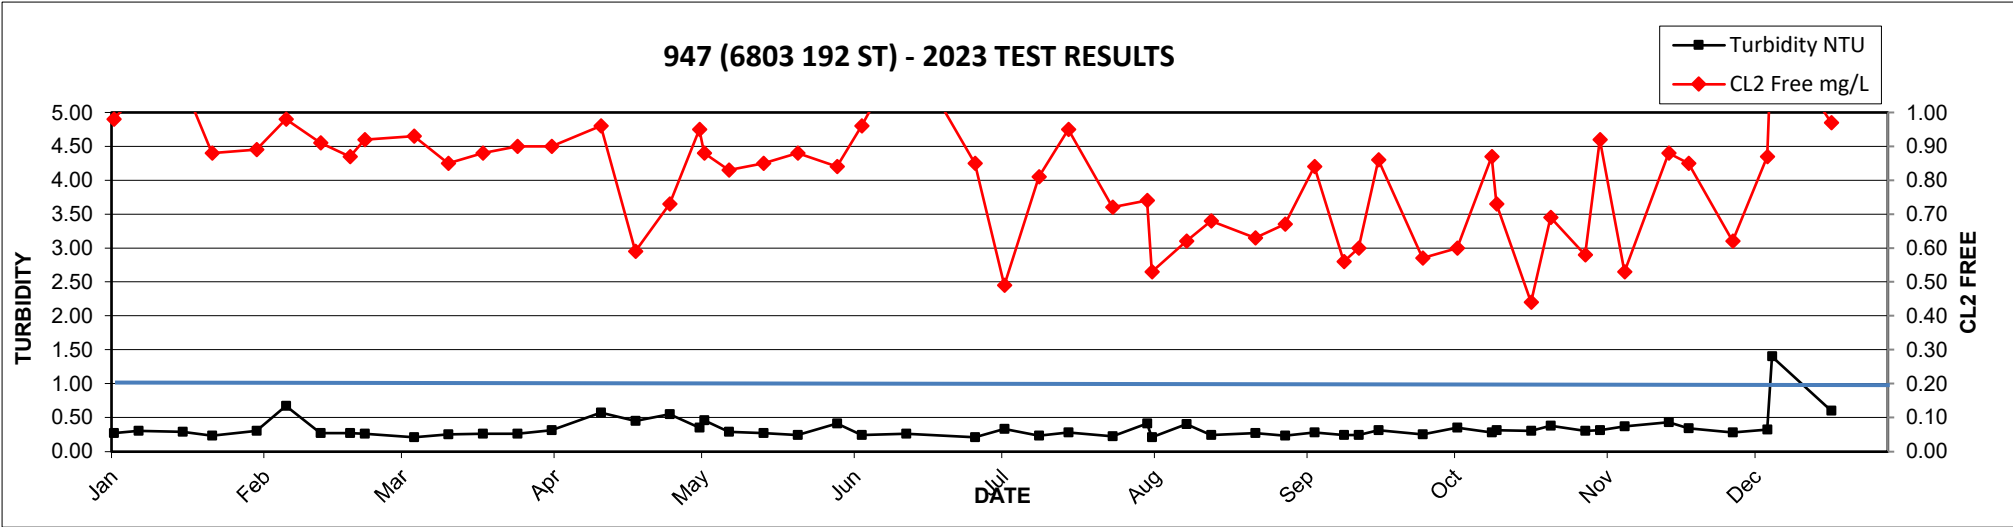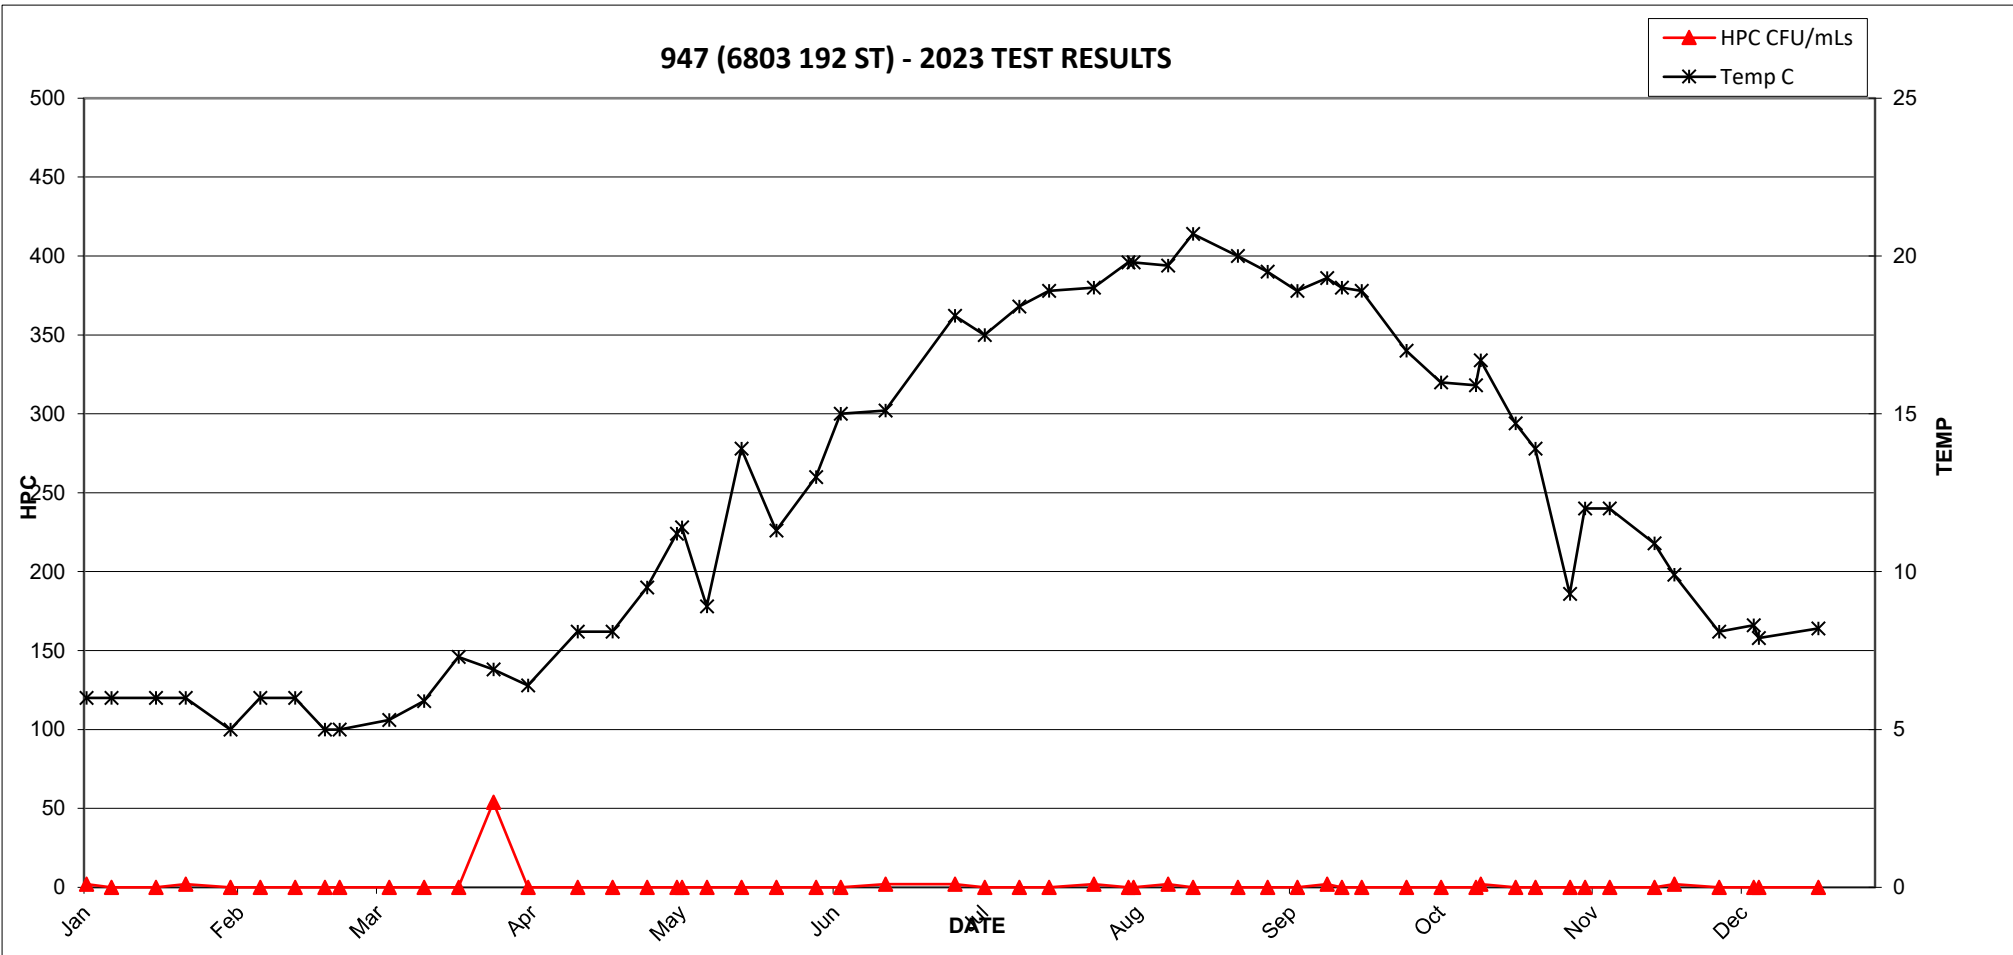

## 2023 MV Laboratory Report - 948 (66 AVE &amp; 172 ST)



Date Collected	CL2 Free mg/L	Ecoli MF/100mLs	HPC CFU/mLs	Tcoli MF/100mLs	Temp C	Turbidity NTU
04-Jan	0.05	<1	16	<1	8	0.33
12-Jan	0.43	<1	120	<1	8	0.22
18-Jan	0.06	<1	20	<1	8	0.23
26-Jan	0.03	<1	100	<1	8	0.21
03-Feb	0.22	<1	56	<1	7	0.26
08-Feb	0.04	<1	64	<1	8	0.23
15-Feb	0.03	<1	230	<1	8	0.29
23-Feb	0.10	<1	250	<1	7	0.20
11-Mar	0.11	<1	<2	<1	7	0.26
15-Mar	0.17	<1	<2	<1	7.2	0.20
20-Mar	0.20	<1	4	<1	7	0.23
27-Mar	0.16	<1	8	<1	7.4	0.25
06-Apr	0.11	<1	<2	<1	7.3	0.30
12-Apr	0.17	<1	2	<1	7.4	0.29
20-Apr	0.17	<1	<2	<1	8.2	0.31
26-Apr	0.17	<1	<2	<1	8.3	0.30
27-Apr	0.17	<1	4	<1	8.6	0.29
02-May	0.16	<1	10	<1	10.4	0.36
12-May	0.11	<1	10	<1	9.8	0.30
17-May	0.26	<1	<2	<1	10.9	0.26
25-May	0.19	<1	<2	<1	11.1	0.35
31-May	0.12	<1	<2	<1	11.4	0.32
05-Jun	0.11	<1	<2	<1	11.4	0.31
08-Jun	0.07	<1	8	<1	11.9	0.39
12-Jun	0.22	<1	36	<1	13.8	0.22
20-Jun	0.26	<1	<2	<1	12.6	0.33
29-Jun	0.17	<1	2	<1	12.8	0.21
06-Jul	0.19	<1	<2	<1	13.6	0.31
10-Jul	0.29	<1	<2	<1	13.8	0.26
11-Jul	0.26	<1	<2	<1	12.9	0.24
12-Jul	0.23	<1	<2	<1	12.8	0.17
18-Jul	0.33	<1	<2	<1	14.5	0.40
19-Jul	0.21	<1	<2	<1	14.4	0.22
25-Jul	0.19	<1	120	<1	14.8	0.26
01-Aug	0.17	<1	16	<1	14.8	0.28
10-Aug	0.13	<1	46	<1	14.8	0.23
17-Aug	0.23	<1	14	<1	16	0.25
24-Aug	0.11	<1	14	<1	15.5	0.30
30-Aug	0.02	<1	26	<1	15.4	0.22
06-Sep	0.17	<1	46	<1	15.3	0.25
13-Sep	0.19	<1	10	<1	15.8	0.18
15-Sep	0.14	<1	54	<1	15.7	0.33
21-Sep	0.15	<1	62	<1	15.3	0.21
27-Sep	0.17	<1	38	<1	14.9	0.23
28-Sep	0.29	<1	38	<1	15	0.27
03-Oct	0.19	<1	90	<1	15	0.26
10-Oct	0.22	<1	84	<1	14	0.25
11-Oct	0.15	<1	88	<1	13.9	0.24
16-Oct	0.17	<1	60	<1	14.7	0.23
17-Oct	0.08	<1	80	<1	14.3	0.21
23-Oct	0.03	<1	260	<1	14	0.32
24-Oct	0.16	<1	8	<1	14.8	0.36
31-Oct	0.03	<1	46	<1	13.7	0.36
02-Nov	0.17	<1	130	<1	13.5	0.24
06-Nov	0.06	<1	28	<1	12.7	0.24
09-Nov	0.16	<1	120	<1	12.5	0.31
10-Nov	0.15	<1	100	<1	11.9	0.33
14-Nov	0.07	<1	160	<1	12.2	0.29
21-Nov	0.12	<1	100	<1	11.6	0.27
28-Nov	0.07	<1	36	<1	11	0.34



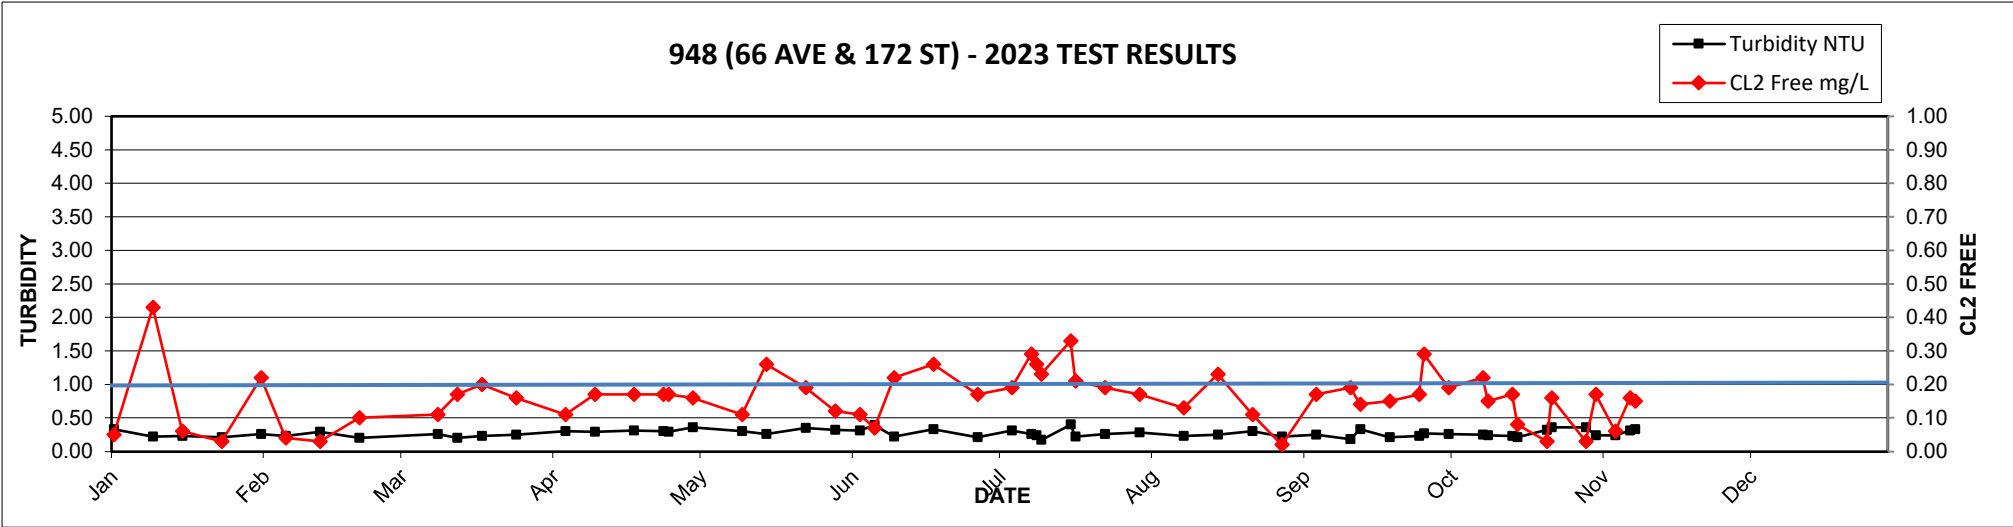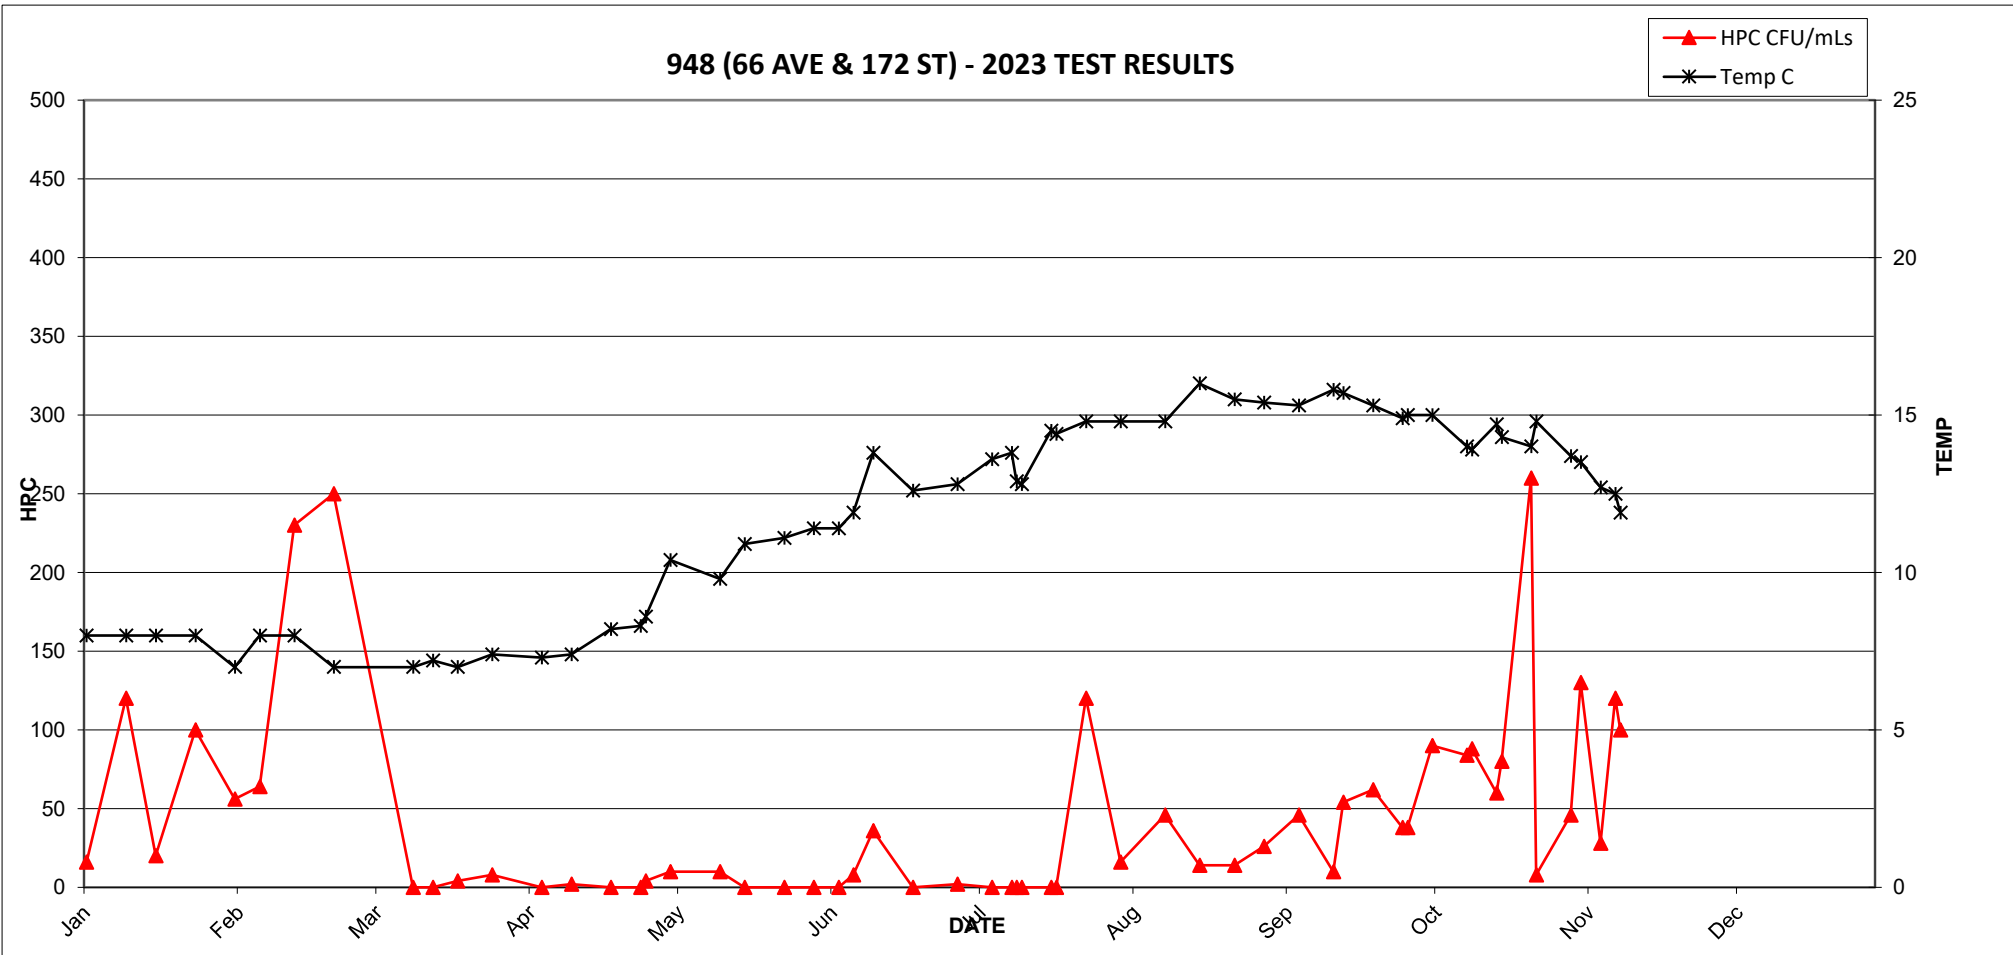

## 2023 MV Laboratory Report - 949 (7362 182 ST)


Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
05-Jan	0.72	<1	<2	<1	6	0.29
10-Jan	1.09	<1	<2	<1	6	0.25
19-Jan	0.94	<1	<2	<1	6	0.28
25-Jan	0.67	<1	<2	<1	6	0.23
03-Feb	0.91	<1	<2	<1	5	0.31
09-Feb	0.97	<1	<2	<1	5	0.60
16-Feb	0.80	<1	<2	<1	6	0.29
22-Feb	0.91	<1	<2	<1	5	0.23
25-Feb	0.91	<1	<2	<1	6	0.44
05-Mar	0.82	<1	<2	<1	4.7	0.28
07-Mar	0.87	<1	<2	<1	4.9	0.23
14-Mar	0.88	<1	2	<1	5.7	0.25
17-Mar	0.94	<1	<2	<1	6	0.64
21-Mar	0.98	<1	<2	<1	6.3	0.28
28-Mar	0.88	<1	18	<1	7.5	0.28
04-Apr	0.78	<1	<2	<1	6.8	0.29
14-Apr	1.00	<1	<2	<1	7.3	0.59
21-Apr	0.75	<1	<2	<1	7.6	0.46
26-Apr	0.68	<1	<2	<1	9	0.36
28-Apr	0.85	<1	2	<1	8.4	0.50
04-May	0.99	<1	<2	<1	9.3	0.51
10-May	1.12	<1	<2	<1	11	0.34
17-May	0.88	<1	<2	<1	13.4	0.29
24-May	0.81	<1	<2	<1	13.5	0.29
01-Jun	0.76	<1	<2	<1	12.8	0.61
06-Jun	0.70	<1	<2	<1	14	0.30
14-Jun	1.22	<1	<2	<1	14.2	0.22
15-Jun	1.04	<1	<2	<1	14.2	0.30
29-Jun	1.11	<1	<2	<1	15.4	0.19
05-Jul	0.86	<1	<2	<1	14.7	0.37
12-Jul	0.69	<1	<2	<1	16.4	0.24
18-Jul	0.78	<1	<2	<1	17	0.24
27-Jul	0.70	<1	2	<1	17.1	0.26
03-Aug	0.65	<1	<2	<1	18.4	0.32
04-Aug	0.74	<1	<2	<1	17.1	0.29
11-Aug	0.61	<1	<2	<1	18.3	0.30
16-Aug	0.60	<1	<2	<1	17.9	0.34
25-Aug	0.53	<1	<2	<1	17.9	0.39
31-Aug	0.53	<1	<2	<1	17.7	0.34
06-Sep	0.70	<1	<2	<1	17.3	0.25
12-Sep	0.52	<1	60	<1	17.3	0.25
15-Sep	0.00	<1	2	<1	16.8	0.31
19-Sep	0.50	<1	<2	<1	17.7	0.28
28-Sep	0.78	<1	<2	<1	15	0.30
29-Sep	0.76	<1	<2	<1	16	0.29
05-Oct	0.51	<1	2	<1	15	0.32
12-Oct	0.84	<1	2	<1	14	0.30
13-Oct	0.57	<1	<2	<1	14.6	0.27
20-Oct	0.75	<1	<2	<1	14	0.29
24-Oct	0.87	<1	<2	<1	13.5	0.94
27-Oct	0.72	<1	2	<1	12.9	9.60
28-Oct	0.64	<1	2	<1	12	0.34
03-Nov	0.80	<1	<2	<1	11	0.27
08-Nov	0.70	<1	2	<1	11.2	0.40
17-Nov	0.62	<1	<2	<1	9.9	0.31
21-Nov	0.78	<1	<2	<1	9.4	0.36
30-Nov	0.62	<1	<2	<1	8	0.32
07-Dec	0.93	<1	<2	<1	8	0.33
08-Dec	1.16	<1	<2	<1	7.8	0.25
13-Dec	1.01	<1	<2	<1	8.6	0.75
20-Dec	0.93	<1	NA	<1	7.8	0.57

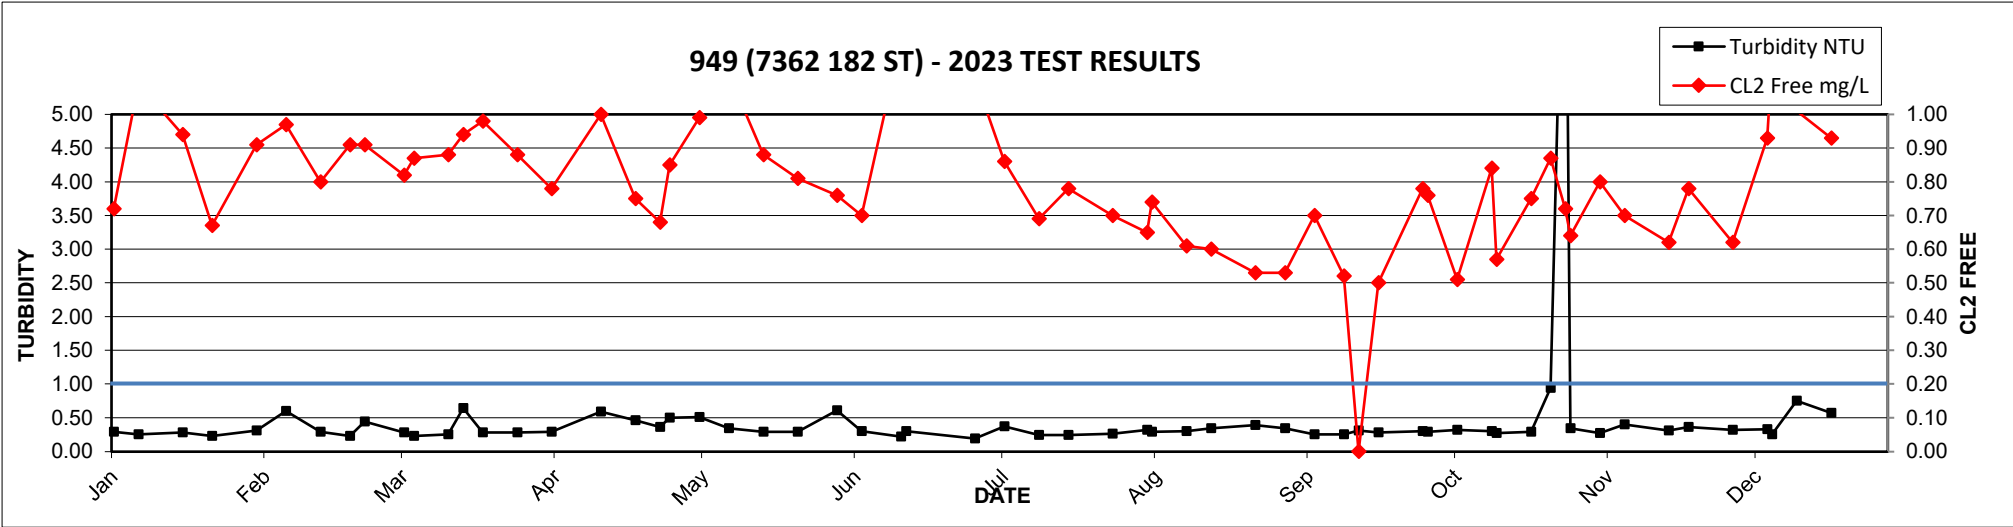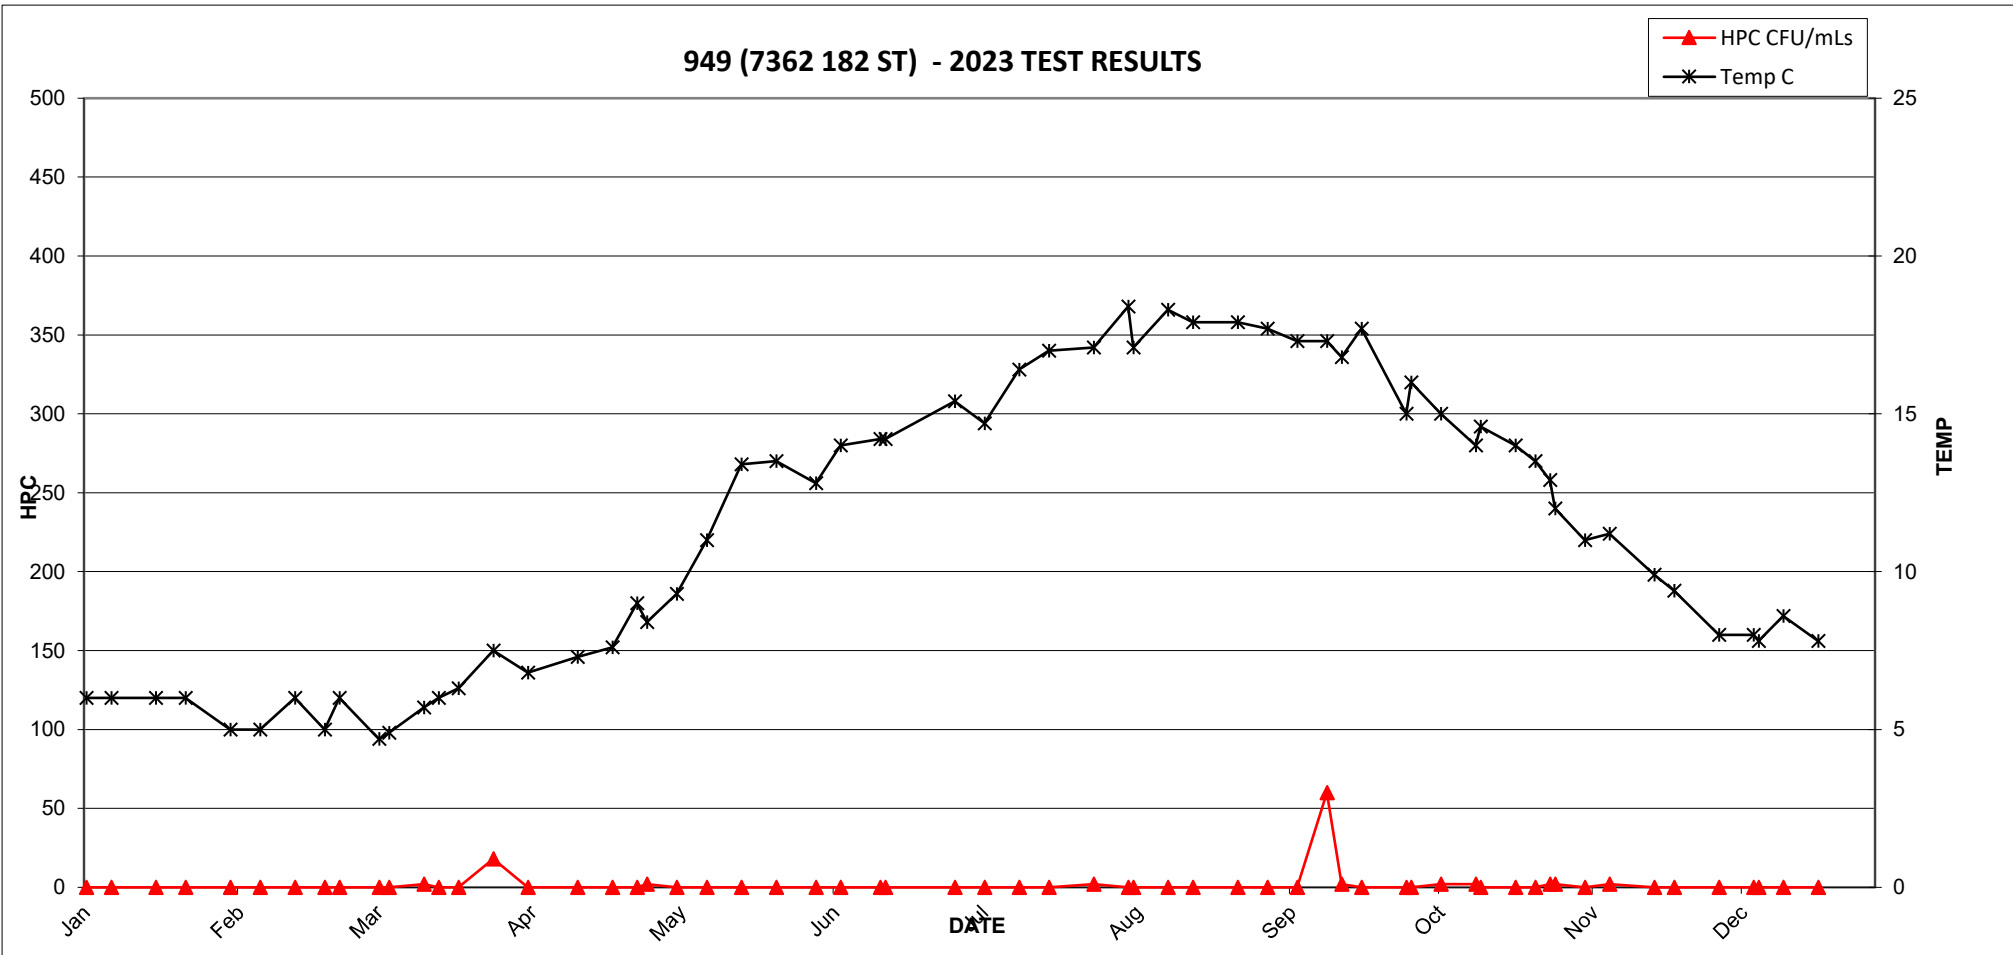


## 2023 MV Laboratory Report - 951 (2010 192 ST)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.71	<1	<2	<1	7	0.39
12-Jan	0.55	<1	32	<1	7	0.27
17-Jan	0.55	<1	2	<1	8	0.25
24-Jan	0.57	<1	<2	<1	8	0.36
02-Feb	0.55	<1	<2	<1	7	0.45
07-Feb	0.55	<1	<2	<1	7	0.31
14-Feb	0.41	<1	<2	<1	6	0.29
21-Feb	0.44	<1	<2	<1	8	0.31
04-Mar	0.52	<1	<2	<1	6.4	0.25
14-Mar	0.53	<1	<2	<1	7	0.29
22-Mar	0.54	<1	<2	<1	7.1	0.25
29-Mar	0.45	<1	<2	<1	8.1	0.34
05-Apr	0.50	<1	4	<1	8.8	0.31
11-Apr	0.45	<1	4	<1	9	0.76
19-Apr	0.47	<1	6	<1	9.2	0.67
25-Apr	0.33	<1	8	<1	7.9	0.42
26-Apr	0.47	<1	<2	<1	9.3	0.35
01-May	0.35	<1	4	<1	10.7	0.55
08-May	0.37	<1	14	<1	11.1	0.43
11-May	0.58	<1	2	<1	11.4	0.40
15-May	0.69	<1	<2	<1	10.5	0.47
24-May	0.64	<1	<2	<1	13.2	0.26
01-Jun	0.59	<1	2	<1	13	0.27
05-Jun	0.44	<1	<2	<1	14	0.34
13-Jun	0.64	<1	2	<1	13.1	0.28
20-Jun	0.69	<1	6	<1	15.1	0.34
23-Jun	0.55	<1	<2	<1	13.7	0.26
28-Jun	0.47	<1	<2	<1	14.6	0.22
04-Jul	0.42	<1	2	<1	15.7	0.30
10-Jul	0.78	<1	<2	<1	15.5	0.37
18-Jul	0.69	<1	<2	<1	16.9	0.28
25-Jul	0.63	<1	<2	<1	17.1	0.25
01-Aug	0.58	<1	<2	<1	17	0.38
04-Aug	0.54	<1	<2	<1	17.5	0.23
09-Aug	0.53	<1	<2	<1	18	0.28
14-Aug	0.55	<1	2	<1	18.3	0.31
23-Aug	0.65	<1	14	<1	18.8	0.33
28-Aug	0.73	<1	2	<1	18.7	0.31
01-Sep	0.51	<1	4	<1	18.2	0.22
05-Sep	0.39	<1	8	<1	18.2	1.20
13-Sep	0.70	<1	<2	<1	18	0.26
15-Sep	0.64	<1	10	<1	18.2	0.30
19-Sep	0.72	<1	4	<1	17.3	1.30
27-Sep	0.81	<1	<2	<1	15.9	0.30
04-Oct	0.41	<1	18	<1	16	0.27
06-Oct	0.44	<1	<2	<1	16	0.35
10-Oct	0.44	<1	<2	<1	16	0.28
11-Oct	0.65	<1	76	<1	16.1	0.32
12-Oct	0.56	<1	24	<1	15.8	0.28
16-Oct	0.41	<1	90	<1	16	0.27
19-Oct	0.56	<1	<2	<1	15.1	0.31
24-Oct	0.30	<1	30	<1	14.7	0.43
01-Nov	0.57	<1	46	<1	13.1	0.29
07-Nov	0.50	<1	130	<1	12.5	0.32
09-Nov	0.41	<1	12	<1	12.5	0.41
14-Nov	0.17	<1	24	<1	10.3	0.22
22-Nov	0.54	<1	<2	<1	11	0.27
27-Nov	0.44	<1	<2	<1	10.7	0.27
04-Dec	0.25	<1	32	<1	9.8	0.33
06-Dec	0.47	<1	<2	<1	9.5	0.30
12-Dec	0.40	<1	<2	<1	9.2	0.42
18-Dec	0.42	<1	NA	<1	9.1	0.43

951 (2010 192 ST) - 2023 TEST RESULTS

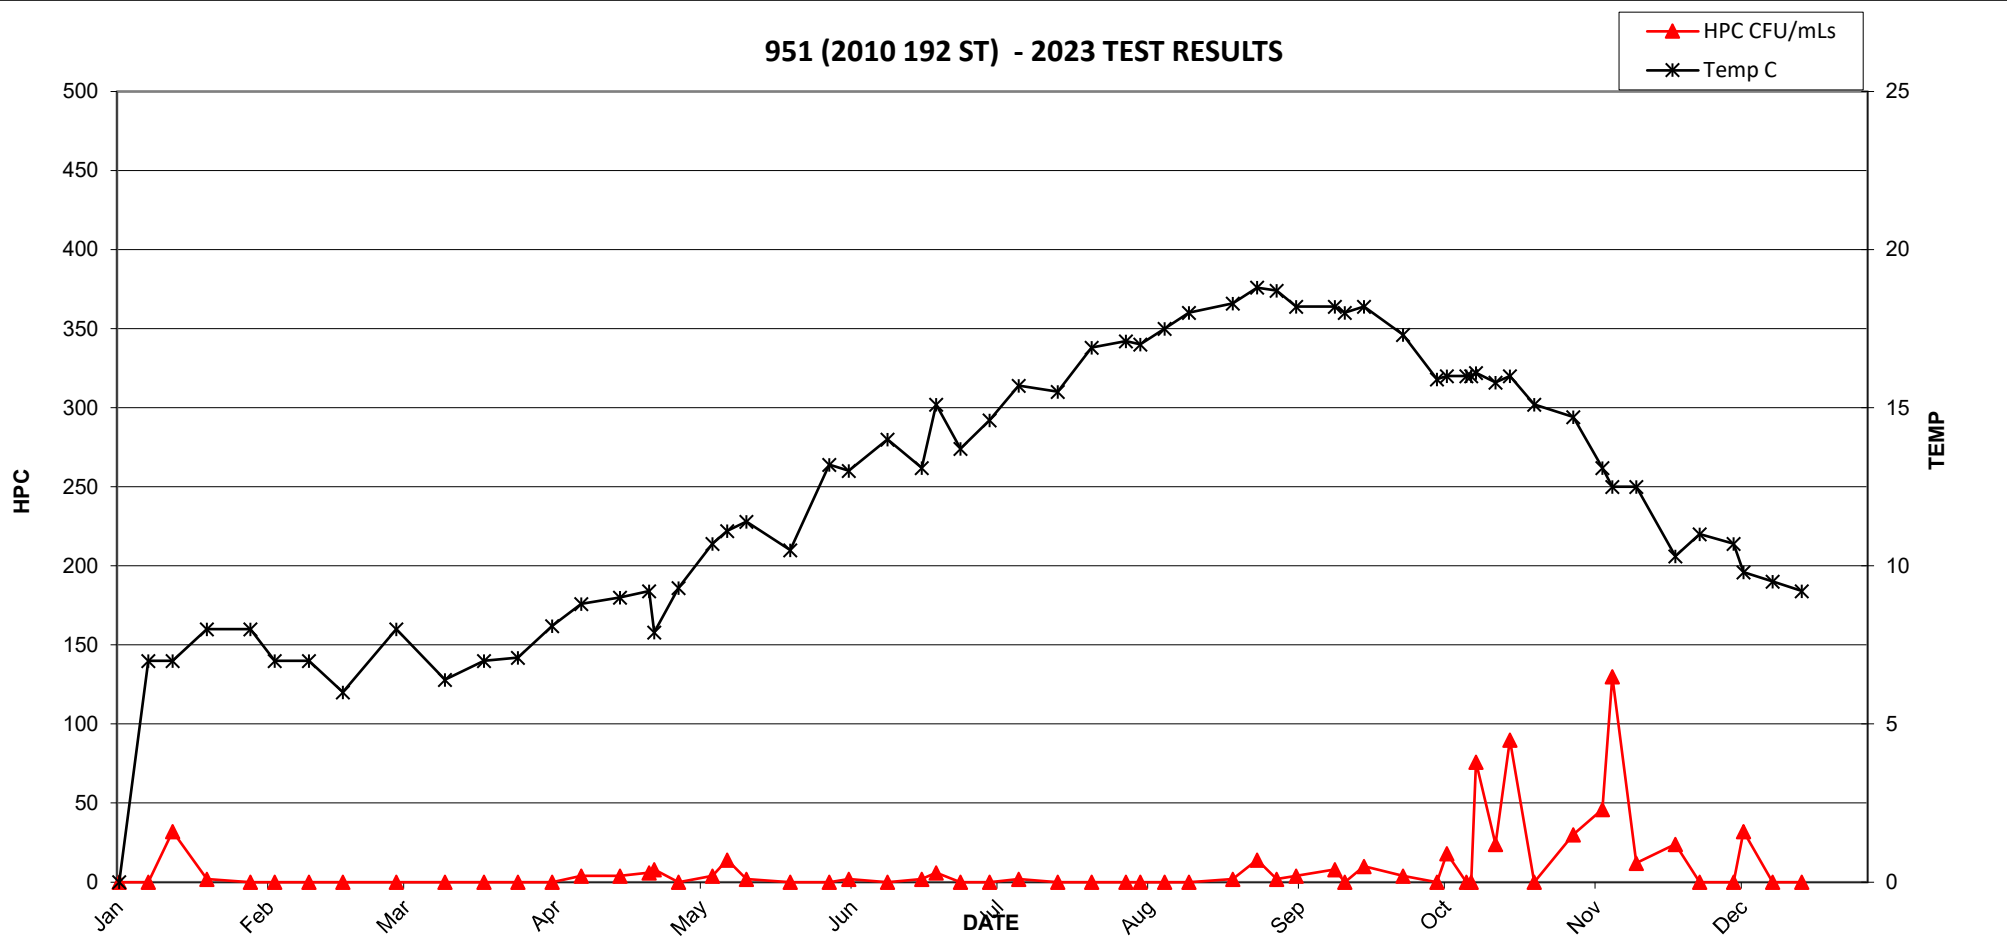


951 (2010 192 ST) - 2023 TEST RESULTS

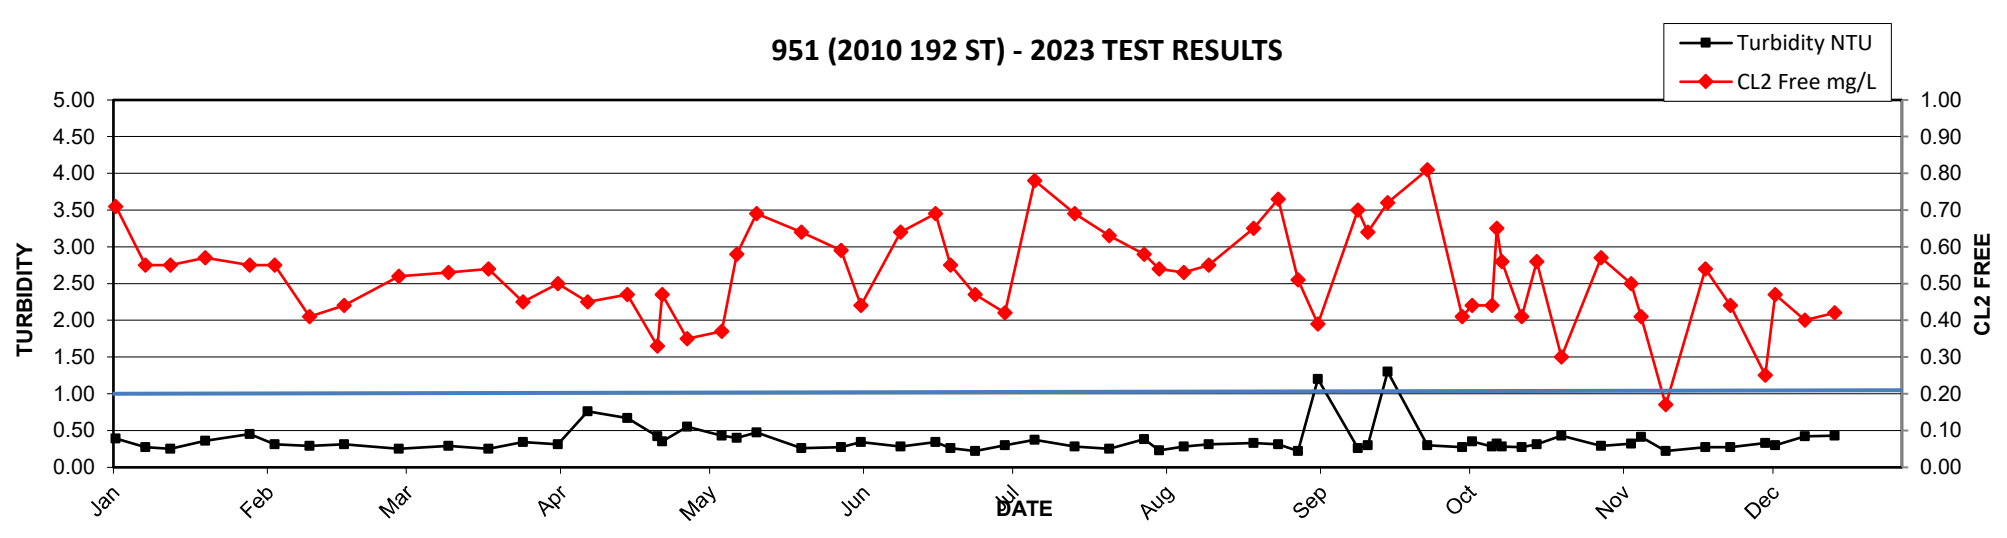


## 2023 MV Laboratory Report - 952 (19026 28 AVE)

Date Collected	CL2 Free	Ecoli	HPC	Tcoli	Temp	Turbidity
	mg/L	MF/100mLs	CFU/mLs	MF/100mLs	C	NTU
06-Jan	0.50	<1	<2	<1	6	0.32
12-Jan	0.74	<1	2	<1	6	0.24
17-Jan	0.49	<1	<2	<1	7	0.26
24-Jan	0.88	<1	<2	<1	6	0.27
26-Jan	0.74	<1	<2	<1	6	0.25
02-Feb	0.41	<1	<2	<1	7	0.67
07-Feb	0.50	<1	<2	<1	7	0.30
14-Feb	0.49	<1	<2	<1	6	0.24
21-Feb	0.39	<1	<2	<1	7	0.50
04-Mar	0.84	<1	<2	<1	5.1	0.24
14-Mar	0.90	<1	<2	<1	6.2	0.27
22-Mar	0.98	<1	2	<1	6.1	0.25
25-Mar	0.77	<1	2	<1	6.1	0.27
29-Mar	0.81	<1	<2	<1	6.5	0.30
05-Apr	0.55	<1	<2	<1	8.1	0.32
11-Apr	0.49	<1	LA	<1	8.4	0.40
19-Apr	1.35	<1	<2	<1	8.1	0.57
25-Apr	0.55	<1	<2	<1	7.9	0.81
26-Apr	0.47	<1	<2	<1	8.3	0.39
01-May	0.39	<1	<2	<1	9.1	0.37
04-May	0.49	<1	<2	<1	9.7	0.33
08-May	0.41	<1	<2	<1	10.4	0.34
11-May	0.74	<1	<2	<1	8.4	0.39
15-May	0.99	<1	<2	<1	9	0.55
24-May	0.73	<1	<2	<1	9.8	0.39
01-Jun	0.97	<1	<2	<1	9.9	0.31
05-Jun	0.46	<1	<2	<1	13.5	0.47
13-Jun	0.66	<1	<2	<1	10.8	0.33
20-Jun	1.12	<1	<2	<1	10.9	0.26
23-Jun	0.85	<1	<2	<1	10.9	0.36
28-Jun	0.90	<1	<2	<1	11.9	0.21
04-Jul	0.69	<1	<2	<1	14.3	0.47
10-Jul	1.08	<1	<2	<1	13.3	0.44
18-Jul	0.92	<1	<2	<1	15.7	0.48
25-Jul	0.98	<1	<2	<1	16.1	0.32
01-Aug	0.83	<1	<2	<1	14.9	0.37
04-Aug	0.89	<1	2	<1	15.9	0.28
09-Aug	0.83	<1	<2	<1	16	0.38
14-Aug	0.99	<1	<2	<1	16.8	0.39
23-Aug	0.51	<1	<2	<1	16.9	0.32
28-Aug	0.85	<1	<2	<1	17.2	0.28
01-Sep	0.48	<1	<2	<1	18	0.23
05-Sep	0.95	<1	<2	<1	16.3	0.31
13-Sep	0.95	<1	<2	<1	16.8	0.25
19-Sep	0.79	<1	<2	<1	16.9	0.41
27-Sep	0.61	<1	<2	<1	16.2	0.33
04-Oct	0.98	<1	<2	<1	15	0.38
10-Oct	0.77	<1	2	<1	14.8	0.34
11-Oct	0.39	<1	<2	<1	14.8	0.32
12-Oct	0.80	<1	<2	<1	14.5	0.29
16-Oct	0.80	<1	2	<1	14.6	0.31
19-Oct	0.85	<1	<2	<1	13.9	0.52
24-Oct	0.79	<1	<2	<1	12.9	0.51
01-Nov	0.95	<1	<2	<1	12	0.28
07-Nov	0.87	<1	<2	<1	11.2	0.31
09-Nov	0.87	<1	<2	<1	11.2	0.46
14-Nov	0.67	<1	<2	<1	10.7	0.3
22-Nov	0.94	<1	2	<1	9.6	0.26
27-Nov	0.48	<1	<2	<1	9.9	0.31
04-Dec	0.59	<1	<2	<1	8.4	0.28
06-Dec	0.55	<1	<2	<1	9	0.58
12-Dec	0.88	<1	<2	<1	7.8	0.47
18-Dec	0.49	<1	NA	<1	8	0.49
27-Dec	0.88	<1	NA	<1	7.9	0.49

952 (19026 28 AVE) - 2023 TEST RESULTS

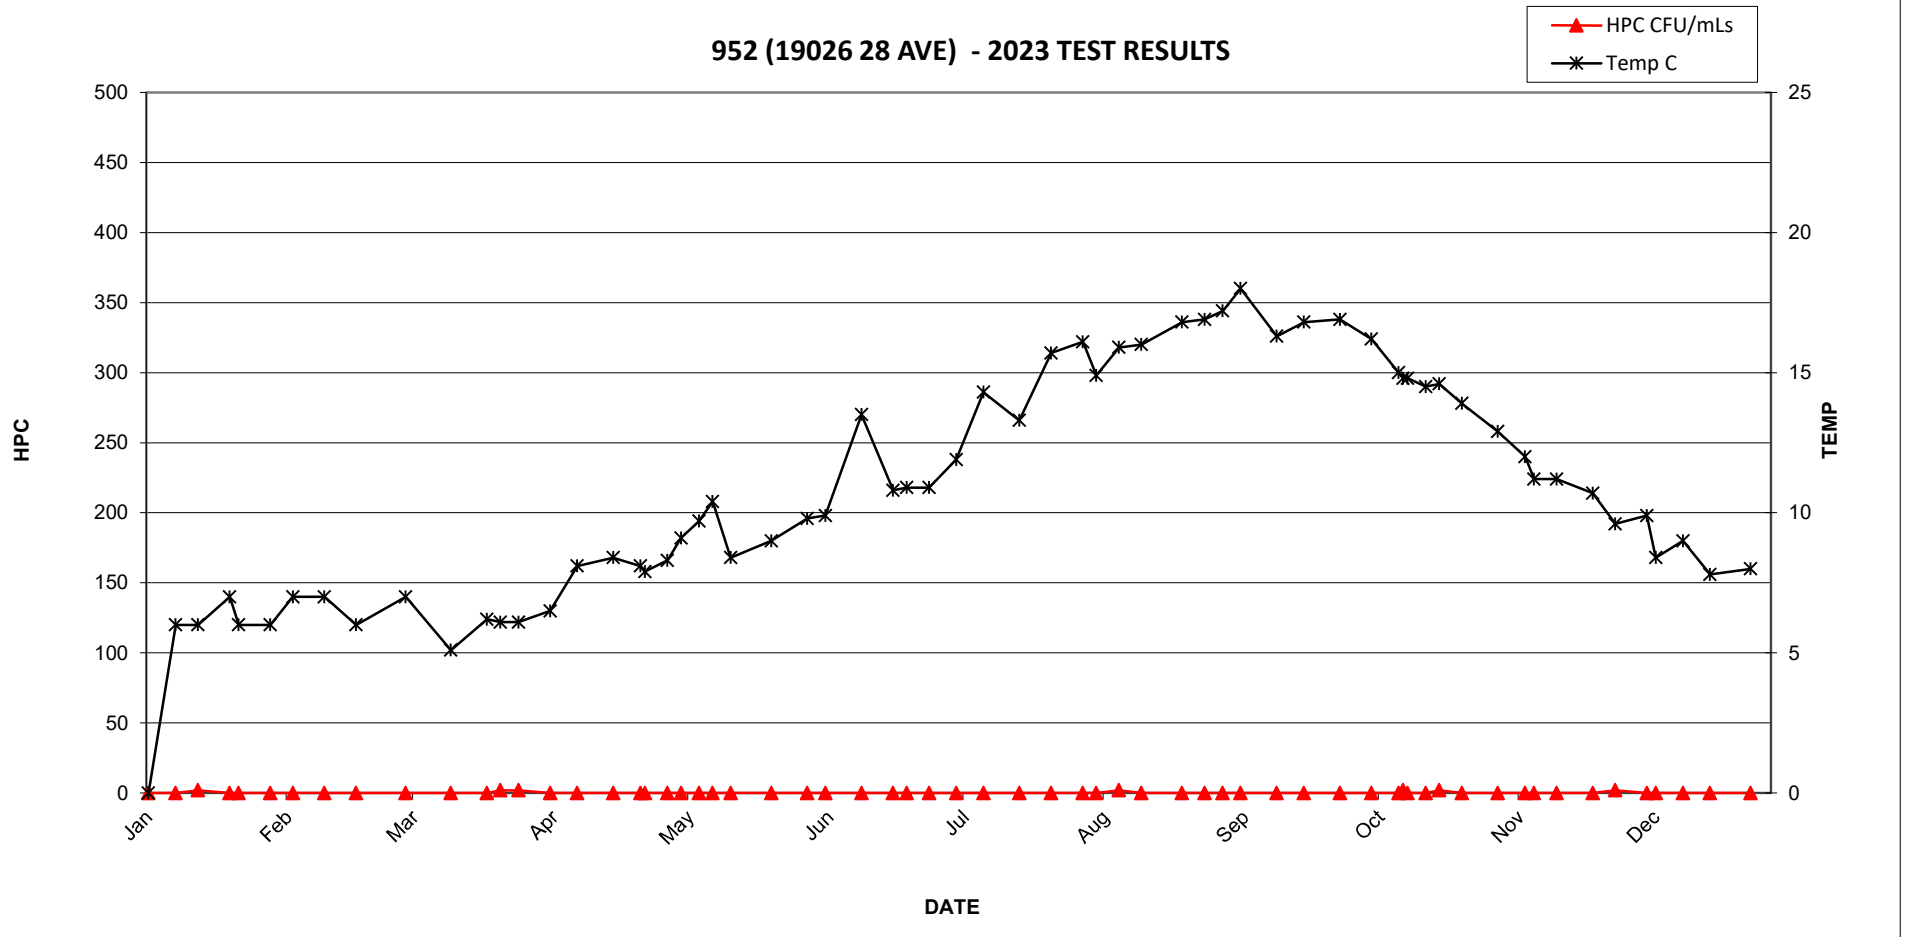

952 (19026 28 AVE) - 2023 TEST RESULTS

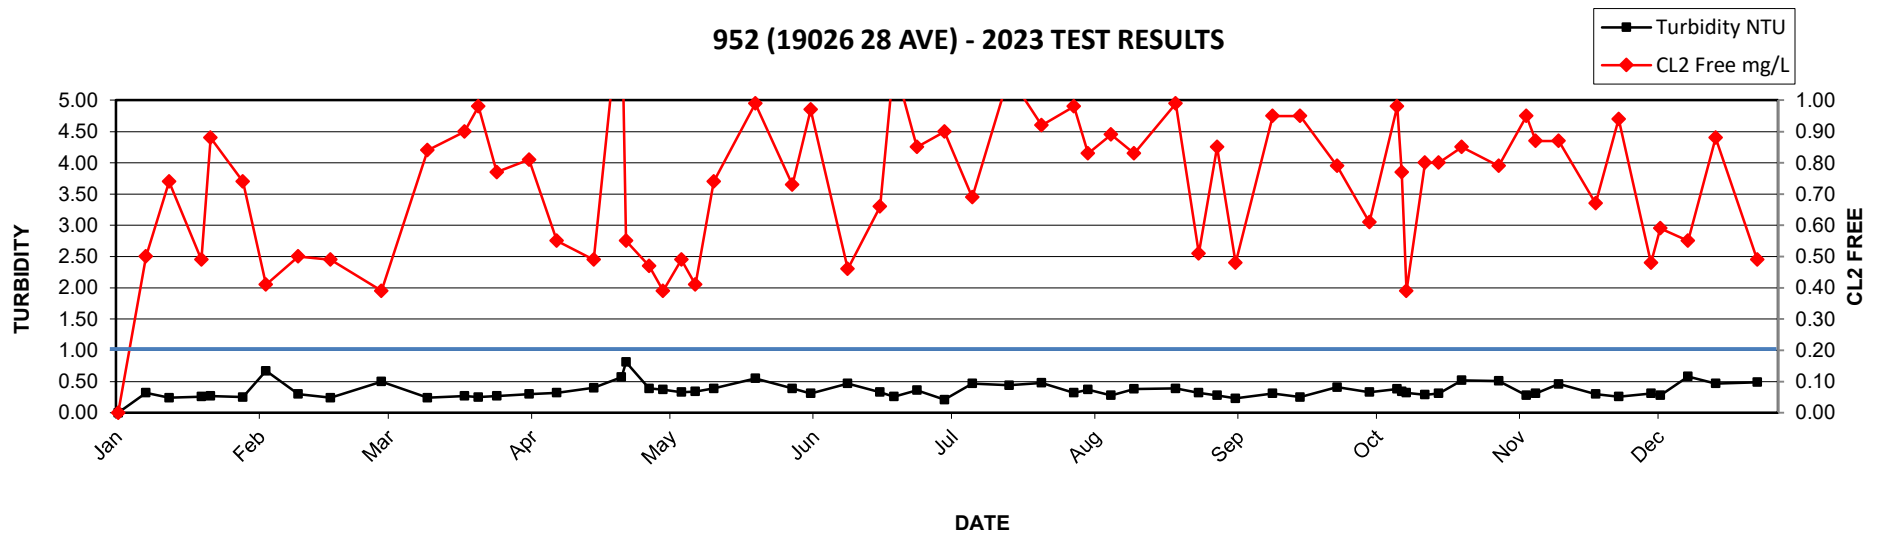

## APPENDIX B

---

### **Metro Vancouver Drinking Water Management Plan**

[Click Here to Access](#)



## APPENDIX C

---

### **British Columbia Drinking Water Protection Regulation**

**[Click Here to Access](#)**

## APPENDIX D

---

### **Guidelines for Canadian Drinking Water Quality Summary Table**

**[Click Here To Access](#)**